



PART GIRDER ELEVATION

NOTE: USE THREE FIELD WELDED 7/8" DIA. X 5' LONG @ STUDS EQUALLY SPACED WITH A MIN. OF 1 1/2" CL. FROM THE FLANGE EDGE. STUDS SHALL NOT BE PLACED OVER FIELD SPLICE PLATES.

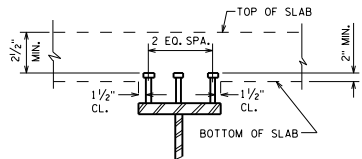


⊕ USE DIFFERENT LENGTH STUDS IF 2 1/2" MIN. CLEARANCE OR 2" EXTENSION CRITERIA IS VIOLATED.


SHEAR CONN. DETAILS

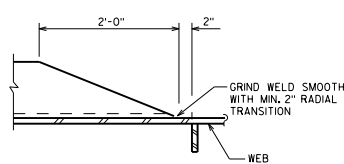

LONGIT. STIFF. TERMINATION

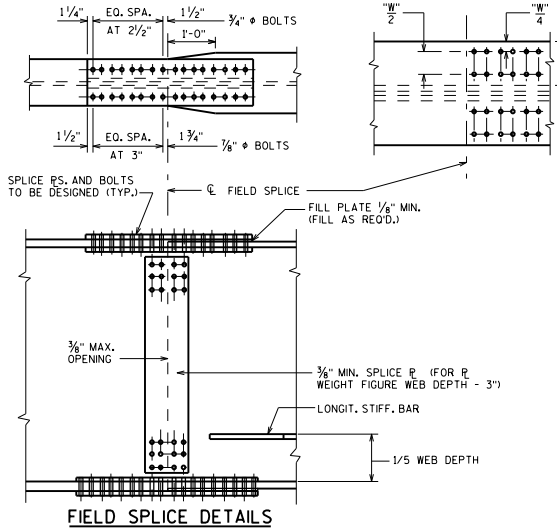

FIELD SPLICE DETAILS

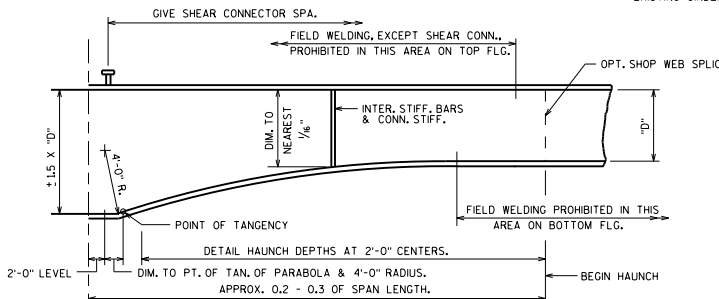

PARABOLIC HAUNCH DETAILS

NOTES

OPTIONAL WELDED SHOP SPLICES MAY BE USED FOR ALL FLANGE AND WEB PLATES OVER 60'-0" LONG. IF USED, THE LOCATION OF THE SPLICE SHALL BE SHOWN ON SHOP DRAWINGS AND WILL BE SUBJECT TO THE APPROVAL OF THE STRUCTURES DESIGN SECTION.

OPTIONAL FLANGE BUTT SPLICE: A FLANGE PLATE OF THE LARGER SIZE MAY BE FURNISHED FULL LENGTH, BUT PAY WEIGHT SHALL BE BASED ON SECTIONS AS DETAILED. IF A PERMANENT HOLD DOWN DEVICE IS USED AT THE ABUTMENT, THEN THE BUTT SPLICE SHALL NOT BE OPTIONAL.

PRIOR TO STEEL BLAST, ALL FLAME CUT EDGES OF PLATE THAT ARE TO BE PAINTED SHALL BE GROUND OR PLANED TO REMOVE THE HARDENED SURFACE CAUSED BY THE FLAME, AND CORNERS CHAMFERED 1/16" MINIMUM.

DESIGNER NOTES

BASE BEAM SEAT ELEVATIONS AT ABUTMENT ON THICKER FLANGE AND DETAIL SHIM PLATES TO ACCOMMODATE THINNER FLANGE.

AT EXTERIOR GIRDERS PLACE INTERMEDIATE TRANSVERSE STIFFENERS ON INTERIOR FACE OF GIRDER AND LONGITUDINAL STIFFENERS ON THE OUTSIDE FACE.


AT INTERIOR GIRDERS PLACE INTERMEDIATE TRANSVERSE STIFFENERS ON ONE SIDE OF GIRDER AND LONGITUDINAL STIFFENERS ON THE OPPOSITE SIDE OF GIRDER. KEEP INTERMEDIATE STIFFENERS ON ONE SIDE WHEN LONGITUDINAL STIFFENERS ARE NOT REQUIRED.

AVOID USE OF LONGITUDINAL STIFFENERS IF PRACTICAL BY THICKENING WEB, WHERE LONGITUDINAL STIFFENERS ARE USED, RUN THEM CONTINUOUS WITHOUT BREAKS AT CONNECTION STIFFENERS.


AT EXTERIOR GIRDER PLACE INTERMEDIATE STIFFENERS ALONG ENTIRE LENGTH OF GIRDER AT A MAX. SPACING EQUAL TO 1.5 X THE DEPTH OF WEB. SPACE EQUALLY BETWEEN DIAPHRAGM CONNECTION STIFFENER. THIS REQUIREMENT IS NECESSARY TO SUPPORT THE FALSEWORK FOR THE SLAB OVERHANG AND MAY BE DISREGARDED IF THE SLAB OVERHANG, MEASURED FROM C. WEB, IS 1'-6" OR LESS OR ANY OF THE FOLLOWING CRITERIA ARE SATISFIED:

- ...WEB THICKNESS > 3/8" AND WEB DEPTH < 48"
- ...WEB THICKNESS > 1/16" AND WEB DEPTH < 60"
- ...WEB THICKNESS > 1/2" AND WEB DEPTH < 66"


SEE STANDARD 40.07 FOR CONNECTING ANY NEW STIFFENERS TO EXISTING GIRDERS.

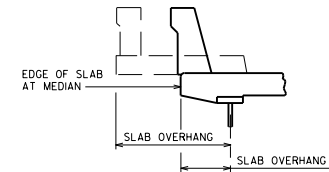

SLAB OVERHANG DEFINITION

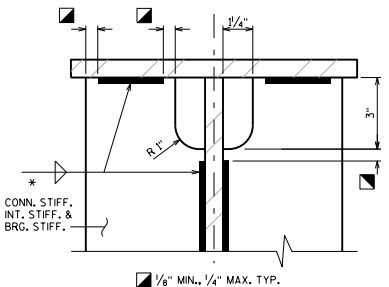


STIFF. & CONN. STIFF. TO WEB/FLANGE CONN. WELDS

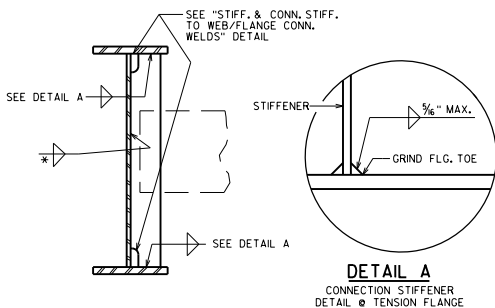


CONNECTION STIFF. DETAILS

DETAIL A
CONNECTION STIFFENER
DETAIL ⊕ TENSION FLANGE

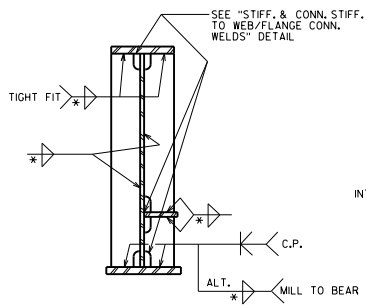

BRG. STIFF. DETAILS
TYP. AT ABUT. & PIER

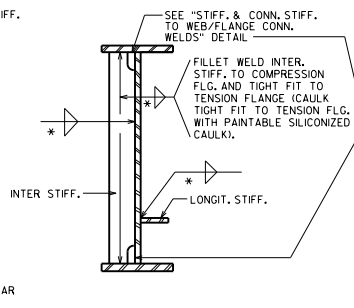

INTERMEDIATE & LONGITUDINAL STIFF. DETAILS
(ALL GIRDERS)

*** TABLE OF FILLET WELD SIZES**

MATERIAL THICKNESS OF THICKER PART JOINED.	⊕ MIN. SIZE OF FILLET WELD
TO 1/2" INCLUSIVE	3/8"
OVER 1/2" TO 3/4"	1/4"
OVER 3/4" TO 1 1/2"	Δ 3/8"
OVER 1 1/2"	Δ 3/8"

⊕ EXCEPT THAT THE WELD SIZE SHALL NOT EXCEED THE THICKNESS OF THE THINNER PART JOINED.
Δ MIN. PASS SIZE IS 3/8"

PLATE GIRDER DETAILS



APPROVED: *Laura Shadewald*

DATE: 1-19