



**TYPICAL SECTION  
THRU ABUTMENT**

(A3 ABUTMENT WITHOUT STRUCTURAL APPROACH)

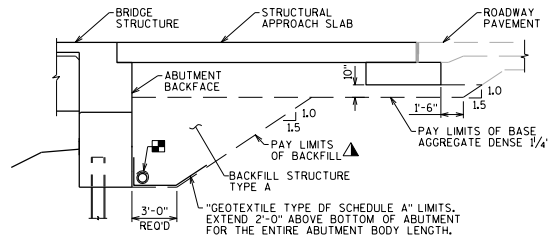


**TYPICAL SECTION  
THRU ABUTMENT**

(A1 ABUTMENT WITH STRUCTURAL APPROACH)

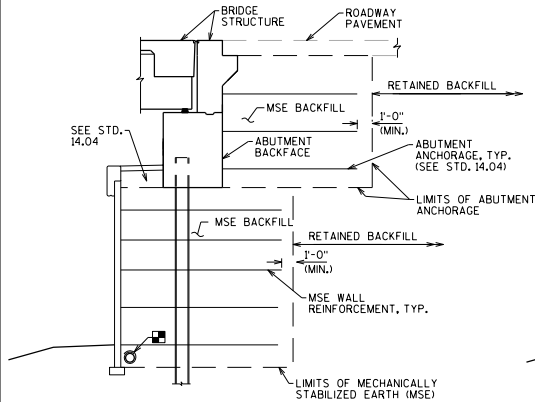


**TYPICAL SECTION  
THRU ABUTMENT AT MSE WALL**

(A3 ABUTMENT WITH ABUTMENT ANCHORAGE)

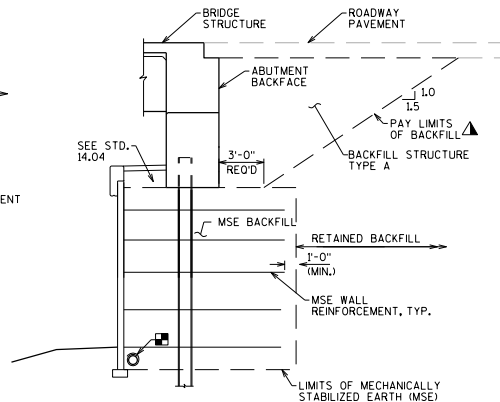


**TYPICAL SECTION  
THRU ABUTMENT AT MSE WALL**

(A1 ABUTMENT WITHOUT STRUCTURAL APPROACH)



**ABUTMENT BACKFILL DIAGRAM  
FOR WINGS PARALLEL TO ROADWAY**

L = OUT TO OUT OF ABUTMENT BODY (FT)  
H = AVERAGE ABUTMENT FILL HEIGHT (FT)  
W1 = WING 1 LENGTH (FT)  
W2 = WING 2 LENGTH (FT)  
EF = EXPANSION FACTOR (1.20 FOR CY BID ITEMS AND 1.00 FOR TON BID ITEMS)  
 $V_{CF} = (L \times 3.0 \times H) + (L \times W_1 \times 1.5 \times H) + (L \times W_2 \times 1.5 \times H)$   
 $V_{CY} = V_{CF} / 2.7$   
 $V_{TON} = V_{CY} \times 2.0$



**ABUTMENT BACKFILL DIAGRAM  
FOR WINGS PARALLEL TO ABUTMENT**

L = OUT TO OUT OF ABUTMENT BODY (FT)  
H = AVERAGE ABUTMENT FILL HEIGHT (FT)  
W1 = WING 1 LENGTH (FT)  
W2 = WING 2 LENGTH (FT)  
EF = EXPANSION FACTOR (1.20 FOR CY BID ITEMS AND 1.00 FOR TON BID ITEMS)  
 $V_{CF} = (L \times 3.0 \times H) + (L \times W_1 \times 1.5 \times H) + (3.0 \times W_2 \times 1.5 \times H)$   
 $V_{CY} = V_{CF} / 2.7$   
 $V_{TON} = V_{CY} \times 2.0$

**NOTES**

THE UPPER LIMITS OF EXCAVATION FOR STRUCTURES BRIDGES B-... SHALL BE THE EXISTING GROUNDLINE.

THE BACKFILL QUANTITIES ARE BASED ON THE PAY LIMITS SHOWN ON THE PLANS AND MAY NOT REFLECT ACTUAL PLACED QUANTITIES. "BACKFILL STRUCTURE TYPE A" REQUIRED DIRECTLY BEHIND ABUTMENTS AND ABUTMENT WINGS FOR 3 FEET; BACKFILL PLACED BEYOND PAY LIMITS OR EXCEEDING PLAN QUANTITIES SHALL BE INCIDENTAL TO EXCAVATION FOR STRUCTURES.

EXCAVATION BELOW THE ABUTMENT AND ABUTMENT BEDDING MATERIALS REQUIRES ENGINEER APPROVAL. GEOTEXTILE SHALL BE SET AT THE BOTTOM OF EXCAVATION AND EXTEND 2'-0" ABOVE BOTTOM OF ABUTMENT. (NOTE INTENDED FOR PILE SUPPORTED ABUTMENTS. SEE DESIGNER NOTES FOR MORE INFORMATION)

**DESIGNER NOTES**

THE DESIGN ENGINEER SHOULD PROVIDE ALL NECESSARY BACKFILL PAY LIMITS AND NOTES IN ORDER TO DETERMINE QUANTITIES. FOR ABUTMENTS, PROVIDE AN ABUTMENT BACKFILL DIAGRAM AS SHOWN ON THIS SHEET. SEE BRIDGE MANUAL SECTIONS 6.4.2 AND 9.10 FOR ADDITIONAL INFORMATION.

SUBSURFACE DRAINAGE DETAILS AND NOTES SHOULD DIRECT DRAINAGE AROUND THE ABUTMENT RATHER THAN BELOW THE ABUTMENT. DRAINAGE UNDER THE ABUTMENT MAY CAUSE SLOPE PAVING DAMAGE OR FAILURE. GEOTEXTILE SHALL EXTEND THE ENTIRE LENGTH OF THE ABUTMENT BODY. SEE STANDARD 12.08 FOR GUIDANCE ON UNDERDRAIN PLACED ABOVE NORMAL WATER. FOR UNDERDRAIN EXPOSED TO HIGH WATER, CONSIDER CAPPING THE UPSTREAM END TO PREVENT CLOGGING.


FOR ABUTMENTS WITH MSE BACKFILL BELOW THE REQUIRED "BACKFILL STRUCTURE TYPE A" WIDTH, PIPE UNDERDRAIN AND GEOTEXTILE ARE NOT REQUIRED BEHIND ABUTMENTS. PIPE UNDERDRAIN IS REQUIRED AT THE BOTTOM OF THE MSE WALL.

SEE STANDARD 9.02 FOR RETAINING WALL AND BOX CULVERT DETAILS. SEE STANDARD 9.03 FOR WING FILL SECTIONS AT WING TIPS.

**LEGEND**

BACKFILL PAY LIMITS, BACKFILL BEYOND BACKFILL PAY LIMITS SHALL BE INCIDENTAL TO EXCAVATION FOR STRUCTURES. LIMITS OF EXCAVATION SHALL BE DETERMINED BY THE CONTRACTOR.

PIPE UNDERDRAIN WRAPPED (6-INCH), SLOPE 0.5% MIN. TO SUITABLE DRAINAGE. ATTACH RODENT SHIELD AT ENDS OF PIPE UNDERDRAIN. (SHOW DETAIL ON PLANS)

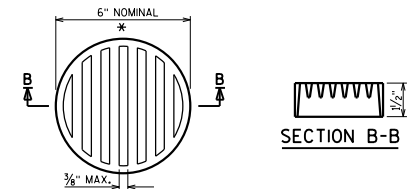

**RODENT SHIELD DETAIL**

\* DIMENSIONS ARE APPROXIMATE. THE GRATE IS SIZED TO FIT INTO A PIPE COUPLING. ORIENT SO SLOTS ARE VERTICAL.

THE RODENT SHIELD, PIPE COUPLING AND SCREWS SHALL BE CONSIDERED INCIDENTAL TO THE BID ITEM "PIPE UNDERDRAIN WRAPPED 6-INCH".

THE RODENT SHIELD SHALL BE A PVC GRATE TO THIS DETAIL. THE GRATE IS COMMERCIALY AVAILABLE AS A FLOOR STRAINER. A PIPE COUPLING IS REQUIRED FOR THE ATTACHMENT OF THIS SHIELD TO THE EXPOSED END OF THE PIPE UNDERDRAIN. THE SHIELD SHALL BE FASTENED TO THE PIPE COUPLING WITH TWO OR MORE NO. 10 X 1-INCH STAINLESS STEEL SHEET METAL SCREWS.

**STRUCTURE BACKFILL  
LIMITS AND NOTES 1**



APPROVED: *Laura Shadewald* DATE: 7-21