



BROKEN RIB
 FORMLINER THICKNESS = $3'' \pm 1/2''$
 WIDTH = $2'' \pm 1/2''$
 MAX. RELIEF = $2'' \pm 1/2''$

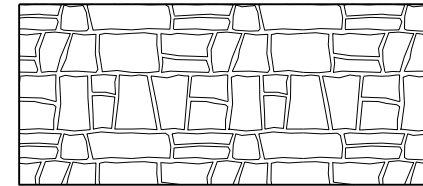


RUSTIC ASHLAR
 FORMLINER THICKNESS = $3''$
 WIDTH = $8''$ TO $32''$
 MAX. RELIEF = $2''$


WARNING
 FORMLINER SHOWN ON THIS STANDARD IS A
 NON-PARTICIPATING ITEM (CSSI).

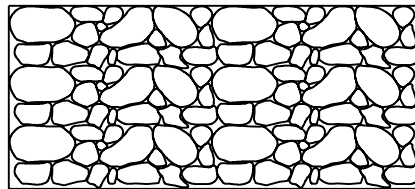

FIELD STONE - RANDOM
 FORMLINER THICKNESS = $3/2''$
 SIZES BETWEEN $6''$ & $24''$
 MAX. RELIEF = $2/2''$

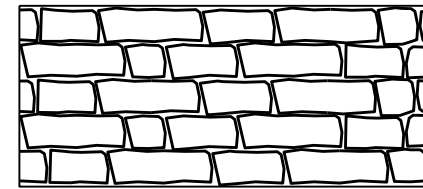


RECTANGULAR CUT STONE
 FORMLINER THICKNESS = $4''$ TO $5/2''$
 COURSE HEIGHT = $\pm 2''$
 MAX. RELIEF = $3''$ TO $4/2''$

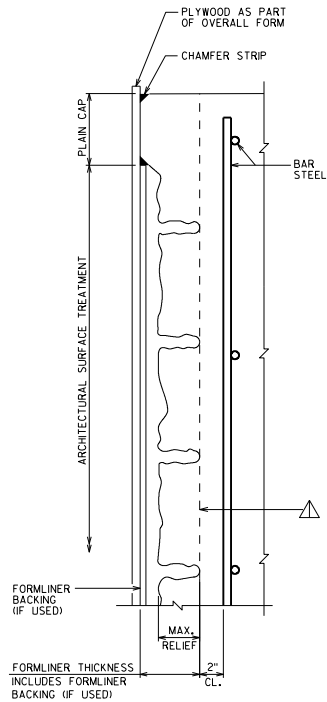

SECTION THRU FORMLINER

▲ STRUCTURAL CONCRETE CAN ONLY BE ASSUMED TO THIS LINE. PROVIDE ADDITIONAL STRUCTURE SIZE AS NECESSARY TO MAINTAIN MINIMUM FULL STRUCTURAL CONCRETE DIMENSIONS AS INDICATED ON THE STANDARDS.

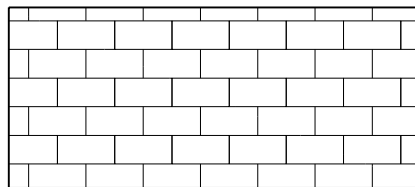

RECTANGULAR BRICK
 FORMLINER THICKNESS = $2''$
 SIZE = VARIES
 MAX. RELIEF = $1''$

RETAINING WALL NOTES

FORMLINER COURSING ON RETAINING WALLS SHALL BE LEVEL.

ABUTMENT NOTES

FORMLINER COURSING ON ABUTMENTS AND WINGS SHALL BE LEVEL.

THE FORMLINER COURSING ON THE WINGS SHALL BE VERTICALLY ALIGNED WITH THE FORMLINER COURSING ON THE FRONT OF THE ABUTMENT.

THE FORMLINER PATTERN SHALL BE CONTINUOUS ACROSS CONSTRUCTION JOINTS.

WRAPAROUND/MATCH FORMLINER PATTERN AT CORNERS.

PIER NOTES

FORMLINER COURSING ON PIERS SHALL BE LEVEL.

THE FORMLINER COURSING ON ALL FACES OF EACH COLUMN SHALL BE VERTICALLY ALIGNED.

SPACE ADJACENT PORTIONS OF FORMLINER ON SLOPED FACE SO THAT COURSING IS ALIGNED VERTICALLY WITH COURSING ON VERTICAL FACE.

THE FORMLINER PATTERN SHALL BE CONTINUOUS ACROSS CONSTRUCTION JOINTS.

WRAPAROUND/MATCH FORMLINER PATTERN AT CORNERS.

PARAPET NOTES




FORMLINER COURSING ON PARAPETS SHALL BE PARALLEL TO TOP OF PARAPET.

FORMLINER DETAILS

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
 7-16

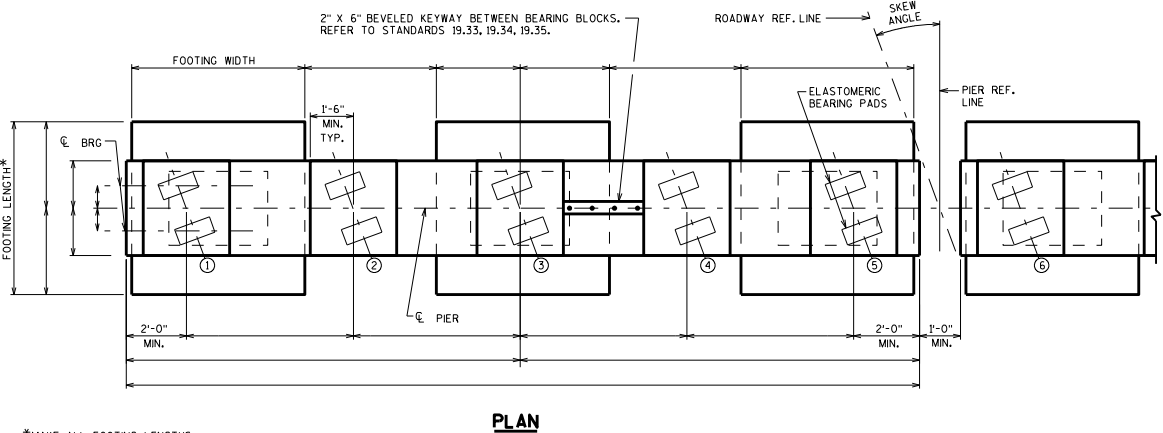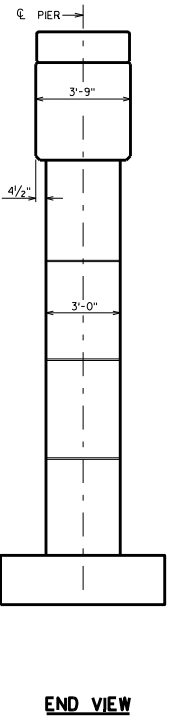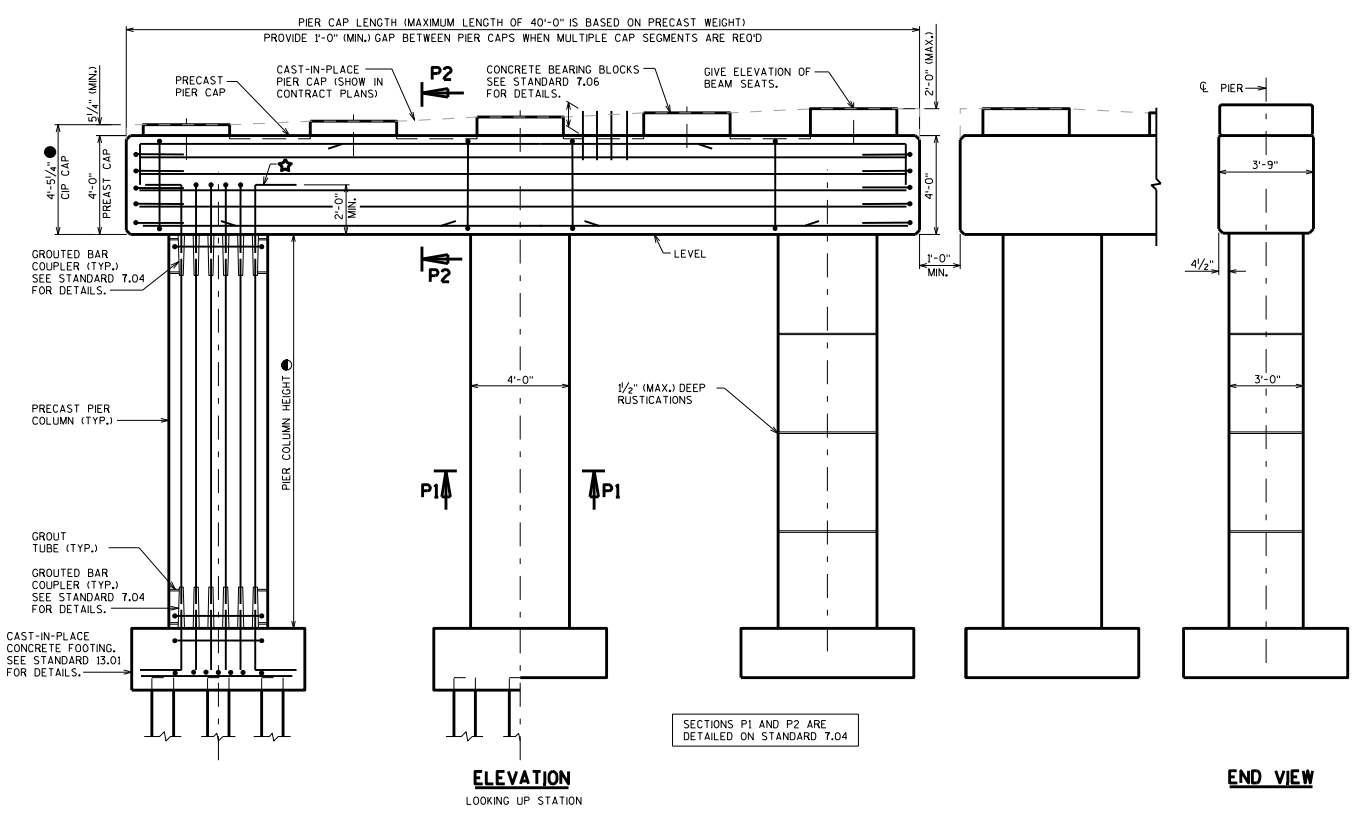

CONTRACTOR NOTES

- THE CONTRACTOR SHALL FOLLOW THIS STANDARD WHEN PRECAST PIERS ARE USED IN LIEU OF THE CAST-IN-PLACE PIER. THE USE OF OPTIONAL PRECAST PIER DETAILS SHALL ONLY BE USED WHEN PLANS INDICATE ALLOWANCE OR WITH APPROVAL BY THE BUREAU OF STRUCTURES.
- PROVIDE A SUITABLE LIFTING DEVICE FOR THE PRECAST CAP, COLUMN AND BEARING BLOCK UNITS).
- STIRRUPS AT THE GROUTED COUPLERS ARE SIZED BASED ON A XX" OUTER DIAMETER COUPLER SLEEVE. ADJUST STIRRUP DIMENSIONS AS REQUIRED IF THE ACTUAL COUPLER SLEEVE DIAMETER DIFFERS.
- MANUFACTURER TO DETERMINE THE PRECAST PIER COLUMN LENGTHS ASSUMING 1/2" STEEL SHIMS AT THE TOP AND BOTTOM OF THE COLUMN.
- GROUTED COUPLER SLEEVES MAY BE OVERSIZED TO ALLOW FOR ADDITIONAL LATERAL TOLERANCE IN THE FIELD. STANDARD WISDOT PRACTICE IS TO OVERSIZE COUPLER SLEEVES BY 1 BAR SIZE. ADJUST SHEAR STIRRUPS AS NECESSARY TO ACCOUNT FOR LARGER DIAMETER COUPLER SLEEVES.
- ALL PRECAST ELEMENTS AND DIAPHRAGM ITEMS PAID PER C.J.P BID ITEMS. NO ADDITIONAL PAYMENT WILL BE PROVIDED FOR THE PRECAST PIER OPTION.
- THE FOLLOWING SPECIAL PROVISIONS SHALL BE USED:
 - GROUTED BAR COUPLERS(SPV.0060.XXX)
 - PRECAST PIER COLUMNS(SPV.0090.XXX)
 - PRECAST PIER CAPS(SPV.0090.XXX)
- THE FOLLOWING ADDITIONAL STANDARDS SHALL BE USED:
 - STANDARD 7.04 - PRECAST PIER CAP AND COLUMN DETAILS
 - STANDARD 7.06 - PRECAST BEARING BLOCKS DETAILS
- THE CONTRACTOR MAY USE PRECAST SEGMENTS AT THEIR DISCRETION (E.G. PRECAST CAP ONLY) WITH APPROVAL BY THE BUREAU OF STRUCTURES. SEE STANDARD 7.07 FOR CAST-IN-PLACE BEARING BLOCK DETAILS AND ADDITIONAL NOTES.

DESIGNER NOTES

- INCLUDE THE FOLLOWING NOTE ON AT LEAST ONE PIER SHEET FOR EACH PIER:

THE CONTRACTOR MAY FURNISH A PRECAST CONCRETE PIER (INSERT ALLOWABLE PRECAST ELEMENTS) IN LIEU OF THE CAST-IN-PLACE PIER WITH THE ACCEPTANCE OF THE SHOP DRAWINGS BY THE STRUCTURES DESIGN SECTION. THE PRECAST CONCRETE PIER SHALL CONFORM TO PRECAST DETAILS IN CHAPTER 7 STANDARDS OF THE CURRENT WISCONSIN DOT BRIDGE MANUAL AND SPECIAL PROVISIONS RELATED TO PRECAST ELEMENTS WITH THE EXCEPTION OF METHOD OF PAYMENT. PAYMENT FOR THE PRECAST PIER SHALL BE BASED ON THE QUANTITIES AND PRICES BID FOR THE ITEMS LISTED IN THE "TOTAL ESTIMATED QUANTITIES" FOR THE CAST-IN-PLACE PIER.
- ALLOWABLE PRECAST ELEMENTS INCLUDE COLUMNS, CAPS, AND BEARING BLOCKS THAT HAVE BEEN DETERMINED TO BE INTERCHANGEABLE BETWEEN C.J.P. AND PRECAST OPTIONS. WHEN A PIER CAP HAS BEEN DETERMINED NON-INTERCHANGEABLE "COLUMNS ONLY" MAY BE USED.
- PROVIDE CAST-IN-PLACE DETAILS ONLY. PRECAST PIER REFERENCES ARE FOR DESIGNER INFORMATIONAL PURPOSES ONLY AND SHALL NOT BE PLACED ON THE PLANS. PRECAST PIER CONFIGURATION SHALL BE INTERCHANGEABLE BETWEEN C.J.P. AND PRECAST OPTIONS.
- ONLY THE PIER CAP LENGTH AND COLUMN LENGTHS SHALL BE MODIFIED. ALL NOTED DIMENSIONS SHALL BE FOLLOWED.
- PIERS SHALL BE SUPPORTED BY A MINIMUM OF 3 COLUMNS. WHEN MULTIPLE PIER CAPS ARE USED, EACH SEGMENT SHALL BE SUPPORTED BY A MINIMUM OF 2 COLUMNS.
- PROVIDE A CONCRETE DIAPHRAGM BETWEEN PIER CAP SEGMENTS.
- MULTIPLE PIER CAP SEGMENTS MAY BE SET AT DIFFERENT ELEVATIONS TO ACCOMMODATE BEARING ELEVATIONS BEYOND CONCRETE BEARING BLOCK LIMITS.
- THE MAXIMUM WEIGHT OF EACH PRECAST ELEMENT SHALL BE 90 KIP.
- SEE STANDARDS 7.03, 7.04, 7.06, 13.01 AND 13.07 FOR ADDITIONAL PIER NOTES AND DETAILS.

LEGEND


- ★ STD. HOOK (TYP.) ROTATE AND STAGGER AS NEEDED.
- DIMENSION IS FROM BOTTOM OF PIER CAP TO LOW BEAM SEAT.

POLICY AND DETAILS REGARDING THE USE OF PRECAST PIER CAPS AND COLUMNS IS BEING DEVELOPED BY THE BUREAU OF STRUCTURES IN CONJUNCTION WITH THE I-39/90 PROJECT. SEE 7.1.4.1.2 FOR ADDITIONAL GUIDANCE.


*MAKE ALL FOOTING LENGTHS THE SAME WITHIN A GIVEN PIER

MATERIAL PROPERTIES:
 CONCRETE MASONRY $f'_c = 3,500$ P.S.I.
 BAR REINFORCEMENT, GRADE 60 $f_y = 60,000$ P.S.I.


PRECAST PIER (OPTIONAL) CAP AND COLUMNS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

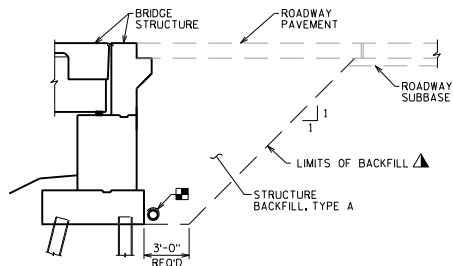


TYPICAL SECTION THRU ABUTMENT
(A3 ABUTMENT WITHOUT STRUCTURAL APPROACH)

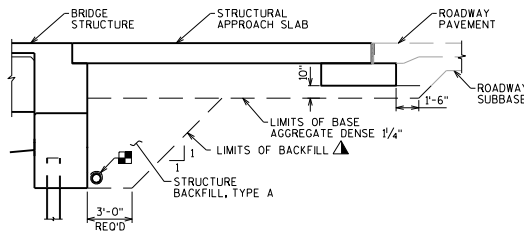


TYPICAL SECTION THRU ABUTMENT
(A1 ABUTMENT WITH STRUCTURAL APPROACH)

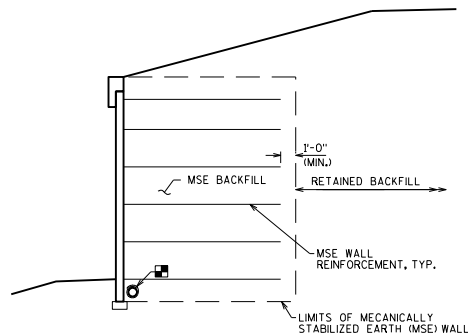


TYPICAL SECTION THRU MSE RETAINING WALL

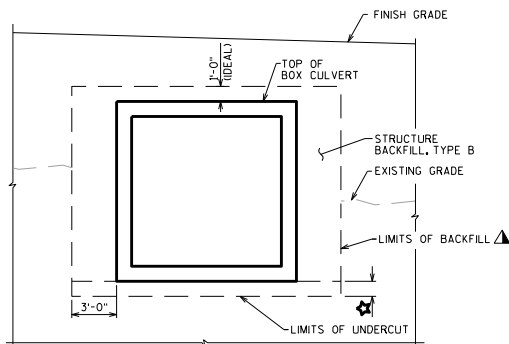


TYPICAL SECTION THRU BOX CULVERT

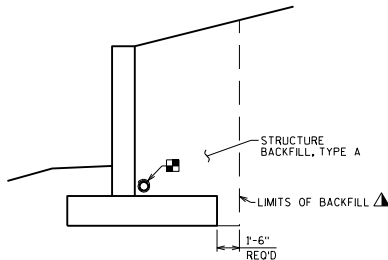

TYPICAL SECTION THRU RETAINING WALL



RODENT SHIELD DETAIL



SECTION B-B

NOTES (ABUTMENTS)

THE UPPER LIMITS OF "EXCAVATION FOR STRUCTURES BRIDGES B--" SHALL BE THE EXISTING GROUNDLINE.

▲ BACKFILL PAY LIMITS, BACKFILL BEYOND BACKFILL PAY LIMITS SHALL BE INCIDENTAL TO EXCAVATION FOR STRUCTURES. LIMITS OF EXCAVATION SHALL BE DETERMINED BY THE CONTRACTOR.

AT THE BACKFACE OF ABUTMENT ALL VOLUME WHICH CANNOT BE PLACED BEFORE ABUTMENT CONSTRUCTION AND IS NOT OCCUPIED BY THE NEW STRUCTURE SHALL BE BACKFILLED WITH STRUCTURE BACKFILL.

NOTES (BOX CULVERTS)

THE UPPER LIMITS OF "EXCAVATION FOR STRUCTURES CULVERTS C--" SHALL BE THE EXISTING GROUNDLINE.

▲ BACKFILL PAY LIMITS, BACKFILL BEYOND BACKFILL PAY LIMITS SHALL BE INCIDENTAL TO EXCAVATION FOR STRUCTURES. LIMITS OF EXCAVATION SHALL BE DETERMINED BY THE CONTRACTOR.

ALL VOLUME WHICH CANNOT BE PLACED BEFORE CULVERT CONSTRUCTION AND NOT OCCUPIED BY THE NEW STRUCTURE SHALL BE BACKFILLED WITH STRUCTURE BACKFILL WITHIN THE LENGTH OF THE CULVERT INCLUDING THE APRON WING WALLS.

NOTE AND DIMENSION NOT REQUIRED, (UNDERCUT NOT REQUIRED PER GEOTECHNICAL ENGINEER OR WHEN CONSTRUCTED ON FILLS)

UNDER CUT "X"-X". EXCAVATION FOR UNDER CUT TO BE INCLUDED IN EXCAVATION FOR STRUCTURES. BACKFILL WITH "STRUCTURE BACKFILL TYPE B".

UNDER CUT "X"-X". EXCAVATION FOR UNDER CUT TO BE INCLUDED IN EXCAVATION FOR STRUCTURES. PLACE "GEOTEXTILE TYPE C" AND BACKFILL WITH "BREAKER RUN".

IN LIEU OF USING BREAKER RUN FOR THE BOX CONSTRUCTION PLATFORM, THE CONTRACTOR MAY ELECT TO SUBSTITUTE #1 OR #2 CONCRETE COARSE AGGREGATE, SELECT CRUSHED MATERIAL OR OTHER GRANULAR MATERIAL AS APPROVED BY THE ENGINEER. THE CONTRACTOR IS RESPONSIBLE FOR BASE STABILITY WITH ANY SUBSTITUTED MATERIAL. THE REGION GEOTECHNICAL ENGINEER MAY BE CONTACTED TO DETERMINE IF "OTHER GRANULAR MATERIAL" IS ACCEPTABLE.

ALL PRECAST BOX SECTIONS SHALL BE PLACED ON A BEDDING OF "STRUCTURE BACKFILL TYPE B" OF 6" MINIMUM DEPTH. (NOTE APPLICABLE WHEN PRECAST NOTE IS SHOWN ON THE PLANS)

NOTES (RETAINING WALLS)

THE UPPER LIMITS OF "EXCAVATION FOR STRUCTURES RETAINING WALLS R--" SHALL BE THE EXISTING GROUNDLINE.

▲ BACKFILL PAY LIMITS, BACKFILL BEYOND BACKFILL PAY LIMITS SHALL BE INCIDENTAL TO EXCAVATION FOR STRUCTURES. LIMITS OF EXCAVATION SHALL BE DETERMINED BY THE CONTRACTOR.

AT THE BACKFACE OF WALL ALL VOLUME WHICH CANNOT BE PLACED BEFORE WALL CONSTRUCTION AND NOT OCCUPIED BY THE NEW STRUCTURE SHALL BE BACKFILLED WITH STRUCTURE BACKFILL. (NOTE APPLICABLE FOR CAST-IN-PLACE CONCRETE CANTILEVER WALLS AND SIMILAR STRUCTURES)

DESIGNER NOTES

THE DESIGN ENGINEER SHOULD PROVIDE BACKFILL LIMIT DETAILS AND NOTES AS NEEDED. SEE BRIDGE MANUAL SECTIONS 6.4.2 AND 9.10 FOR ADDITIONAL INFORMATION.

FOR CULVERTS, THE ABOVE NOTE REGARDING POTENTIAL SUBSTITUTION OF BREAKER RUN SHOULD ONLY BE INCLUDED ON THE PLANS IF ALLOWED BY THE REGION GEOTECHNICAL ENGINEER.


FOR ABUTMENTS, USE THE FULL WIDTH OF THE ABUTMENT (INCLUDING THE WING THICKNESS) FOR CALCULATING BACKFILL QUANTITIES.

▲ PIPE UNDERDRAIN WRAPPED (6-INCH), SLOPE 0.5% MIN. TO SUITABLE DRAINAGE. ATTACH RODENT SHIELD AT ENDS OF PIPE UNDERDRAIN. (SHOW DETAIL ON PLANS)


* DIMENSIONS ARE APPROXIMATE. THE GRATE IS SIZED TO FIT INTO A PIPE COUPLING. ORIENT SO SLOTS ARE VERTICAL.

THE RODENT SHIELD, PIPE COUPLING AND SCREWS SHALL BE CONSIDERED INCIDENTAL TO THE BID ITEM "PIPE UNDERDRAIN WRAPPED 6-INCH". THE RODENT SHIELD SHALL BE A PVC GRATE SIMILAR TO THIS DETAIL. THE GRATE IS COMMERCIALY AVAILABLE AS A FLOOR STRAINER. A PIPE COUPLING IS REQUIRED FOR THE ATTACHMENT OF THIS SHIELD TO THE EXPOSED END OF THE PIPE UNDERDRAIN. THE SHIELD SHALL BE FASTENED TO THE PIPE COUPLING WITH TWO OR MORE NO. 10 X 1-INCH STAINLESS STEEL SHEET METAL SCREWS.

STRUCTURE BACKFILL LIMITS AND NOTES	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

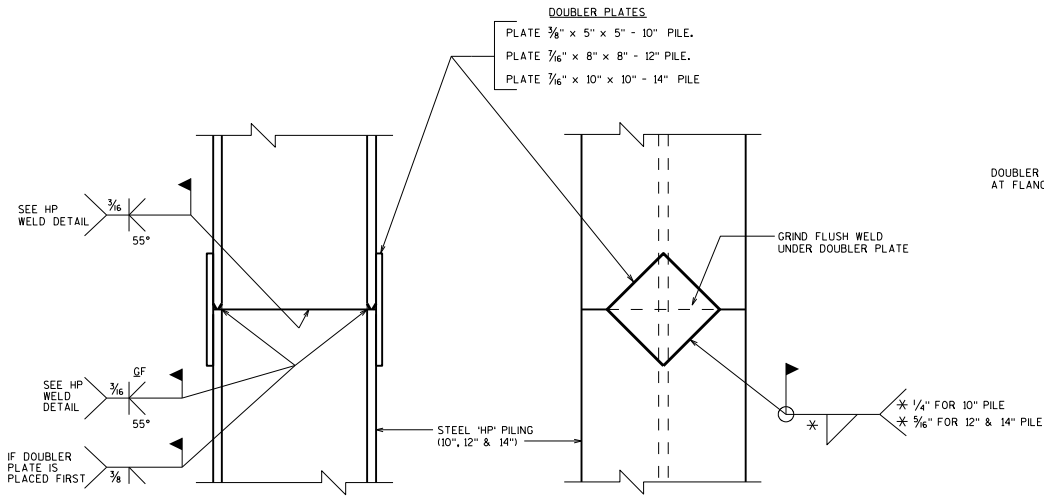

STEEL 'HP' SHAPES

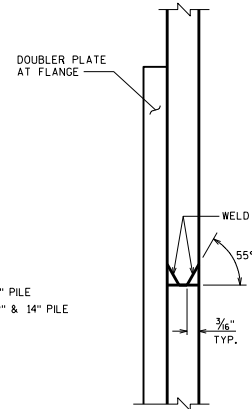

HP WELD DETAIL
FLANGE SHOWN, WEB SIMILAR

DESIGNER NOTES

FULL DESIGN LOADING CAN BE USED IF PREBORED HOLE IS LARGE ENOUGH TO AVOID PILE HANGUPS AND ALLOW FILLING WITH SAND.

SEE WISDOT POLICY ITEM IN BRIDGE MANUAL 11.3.1.12.3 FOR GUIDANCE ON "HP" PILES.

NOTES


CAST-IN-PLACE PILE SHELL MATERIAL SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATION.

IF LESS THAN THE MAXIMUM AXIAL RESISTANCE IS REQUIRED BY DESIGN, STATE ONLY THE REQUIRED CORRESPONDING DRIVING RESISTANCE ON THE PLANS (IF AT LEAST 20 TONS LESS THAN THE TABLE VALUES BELOW). CONSULT WITH THE GEOTECHNICAL ENGINEER REGARDING POSSIBLE ESTIMATED PILE LENGTH ADJUSTMENT.


IF APPLICABLE, PLACE THE FOLLOWING NOTE ON THE PLANS:
PILES PLACED IN PREBORED HOLES CORED INTO ROCK DO NOT REQUIRE DRIVING.

PILE RESISTANCE


PILE SIZE	SHELL THICKNESSES (INCHES)	FACTORED AXIAL COMPRESSION RESISTANCE (P _r) (TONS)	REQUIRED DRIVING RESISTANCE (R _{DR} _{95%}) (TONS)
CAST-IN-PLACE PILES			
10 3/4"	0.219	55	110
10 3/4"	0.250	65	130
10 3/4"	0.365	75	150
10 3/4"	0.500	75	150
12 3/4"	0.250	80	160
12 3/4"	0.375	105	210
12 3/4"	0.500	105	210
14"	0.250	85	170
14"	0.375	120	240
14"	0.500	120	240
H PILES			
10x42	NA	90	180
12x53	NA	110	220
14x73	NA	125	250

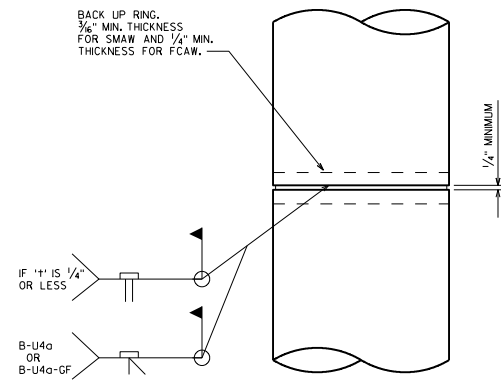


CAST-IN-PLACE 'PIPE PILE'

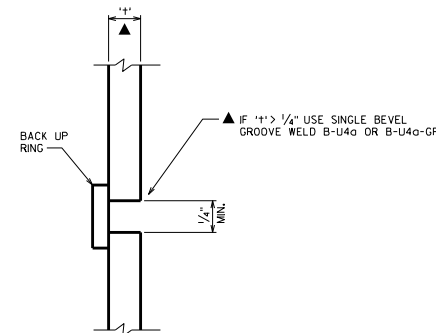

CIP PILE WELD DETAIL

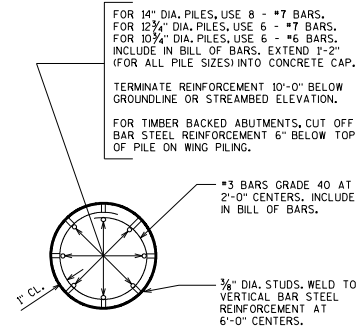

SECTION THRU CONCRETE CAST-IN-PLACE PILING
USED WHEN PILES ARE EXPOSED
(OPEN PILE BENTS OR TIMBER BACKED ABUTMENTS)

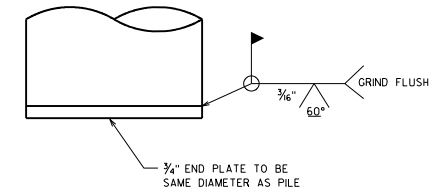

END PLATE DETAIL FOR CIP PILING IN ARTESIAN CONDITIONS
(ONLY USE FOR ARTESIAN CONDITIONS)

PILE DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

LEGEND


- ◆ #5 BARS (COATED) AT 1'-0" (2'-0" LONG). THESE BARS MAY BE PLACED AFTER CONCRETE IS POURED BUT BEFORE INITIAL SET HAS TAKEN PLACE.
- ◇ WHEN THIS DIMENSION ≥ 4" THIS ADDITIONAL REINFORCEMENT SHALL BE ADDED. MAX. SPA. OF HORIZ. #4 BARS = 1'-0".
- USE 1'-3" FOR SLAB SPANS AND FOR GIRDER SPANS WITH NO PAVING NOTCH. USE 1'-6" FOR GIRDER SPANS WITH NO PAVING NOTCH, BUT WHERE 36W, 45W, 54", 54W, 70", 72W OR 82W GIRDERS ARE USED, AND SKEW > 25°. USE 1'-3" FOR SLAB SPANS WITH A PAVING NOTCH, BUT NO STRUCTURAL APPROACH SLAB. USE 1'-11" FOR GIRDER SPANS WITH A PAVING NOTCH, BUT NO STRUCTURAL APPROACH SLAB. USE 1'-7" FOR SLAB SPANS WITH A STRUCTURAL APPROACH SLAB. (STD. 12.10) USE 2'-3" FOR GIRDER SPANS WITH A STRUCTURAL APPROACH SLAB. (STD. 12.10)
- DIMENSION IS FROM BOTTOM OF ABUTMENT TO LOW BEAM SEAT OR LOW SIDE OF SLAB TYPE SUPERSTRUCTURE.
- ▽ 18" RUBBERIZED MEMBRANE WATERPROOFING. SEAL ALL HORIZONTAL AND VERTICAL JOINTS ON BACKFACE.
- ▲ KEYPED CONST. JOINT FORMED BY BEVELED 2" x 6".
- ** WINGWALL WIDTH SHALL BE 1'-6" WHEN TYPE "M" RAILING, VERTICAL FACE PARAPET "TX", OR SINGLE RODENT PARAPET "56SS" IS USED. WINGWALL WIDTH SHALL BE 1'-9" WHEN TYPE "NY3" OR "NY4" RAILING IS USED.
- USE #5 BARS AT 6" SPA. IN OUTSIDE THIRDS OF BODY LENGTH WHEN THE WING LENGTH > 20'-0" AND WING HEIGHT > 10'-0".
- ☆ WHEN BODY SECTION IS > 50'-0" LONG PROVIDE VERTICAL CONSTRUCTION JOINT. RUN BAR STEEL THRU JOINT AND SEAL JOINT WITH 18" RUBBERIZED MEMBRANE WATERPROOFING. SEE STD. 12.09 FOR ALTERNATE CONSTRUCTION JOINT.
- ⊙ SHOW ALL BARS FOR CLARITY.

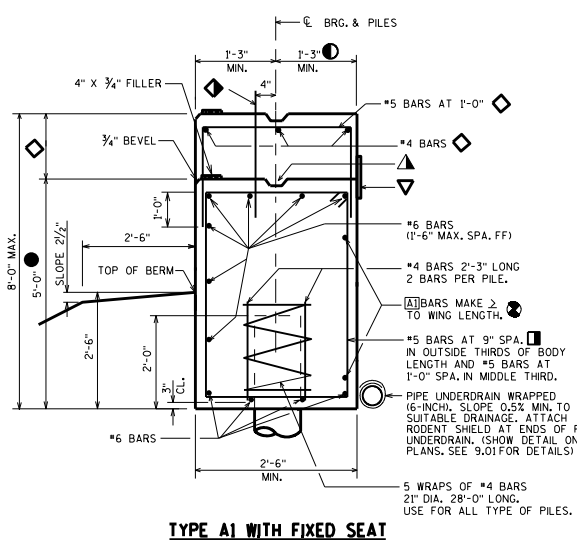

TYPE A1 WITH FIXED SEAT

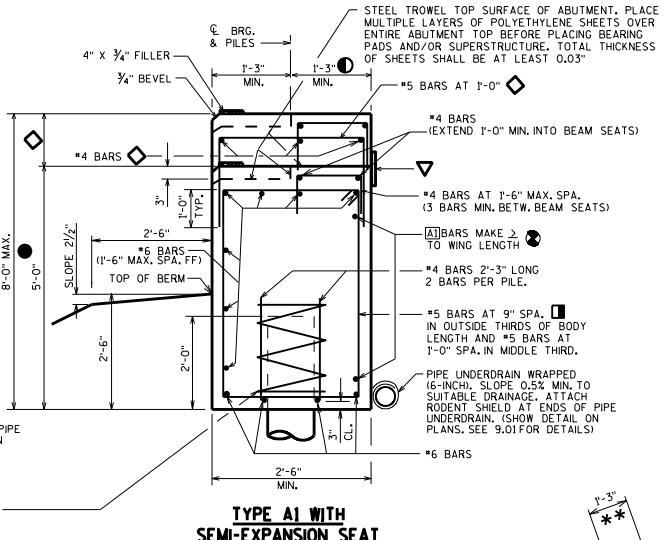


TYPE A1 WITH SEMI-EXPANSION SEAT

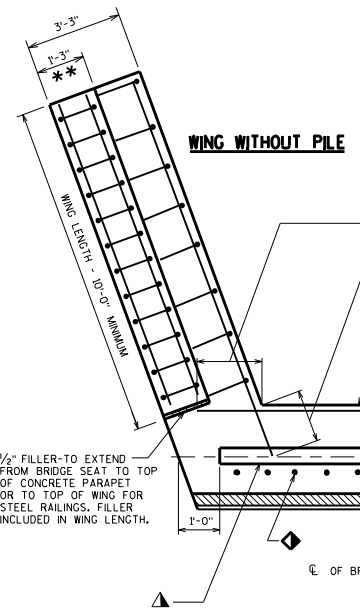

WING WITHOUT PILE

DISTANCE OR EQUIVALENT STD. HOOK)	BAR SIZE
1'-9"	5
2'-1"	6
2'-9"	7
3'-8"	8
4'-7"	9
5'-10"	10

▲ BARS - SEE TABLE (≥ TO WING LENGTH)

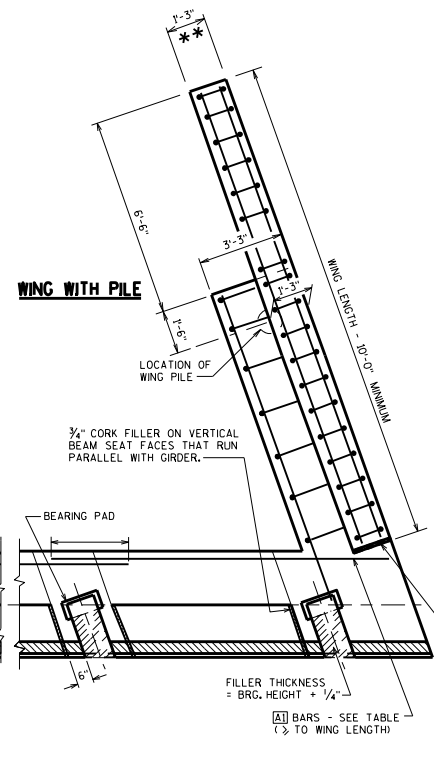

WING WITH PILE

SLAB SPAN WITH FIXED SEAT

GIRDER SPAN WITH FIXED SEAT

SLAB SPAN WITH SEMI-EXPANSION SEAT

GIRDER SPAN WITH SEMI-EXPANSION SEAT

DESIGNER NOTES


- LAP LENGTHS FOR HORIZONTAL BARS SHALL BE BASED ON A "CLASS C" TOP TENSION LAP SPLICE.
- PILING SPACING IN ABUTMENT BODY SHALL BE 8'-0" MAX. FOR ALL TYPES OF PILING. THE MAX. PILE SPACING FROM THE END OF THE ABUT. BODY TO THE FIRST PILE SHALL BE THE MINIMUM OF ONE-HALF PILE SPACE OR 2'-6".
- CONCRETE POURED UNDER WATER WILL BE ALLOWED AND SHALL BE DONE IN ACCORDANCE WITH SECTION 502.3.5.3 STANDARD SPECIFICATIONS.
- THE SEMI-EXPANSION SEAT SHALL BE USED WHEN REQUIRED AS STATED IN CHAPTER 12, FIGURE 12.7-1 OF THE BRIDGE MANUAL OR WHENEVER A WING PILE IS REQUIRED.
- THE FIXED SEAT CANNOT BE USED WHEN A WING PILE IS REQUIRED (SEE STD 12.02 FOR CRITERIA)

ABUTMENT TYPE A1 (INTEGRAL ABUTMENT)

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

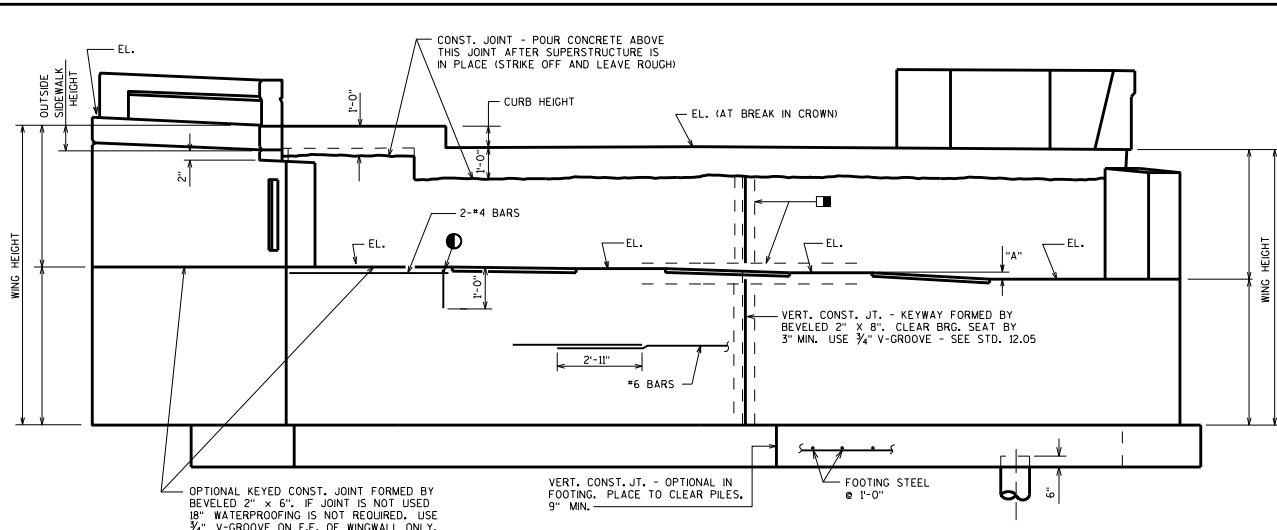


FRONT ELEVATION

DESIGNER NOTES

- PILING SPACING IN ABUTMENT FOOTING SHALL BE 8'-0" MAXIMUM.
- WHEN BODY SECTION IS MORE THAN 50'-0" LONG, PROVIDE VERTICAL CONSTRUCTION JOINT. RUN BAR STEEL THRU JOINT. SEAL JOINT WITH 18" RUBBERIZED MEMBRANE WATERPROOFING. SEE STD. 12.09 FOR ALTERNATE CONSTRUCTION JOINT.
- IN "FRONT ELEVATION" VIEW, GIVE ELEVATION OF ALL BEARING AREAS AND ELEVATION AT BOTTOM OF PARAPETS AT EACH END OF WINGS. ALL ELEVATIONS ARE TAKEN AT FRONT FACE OF BACKWALL.
- LAP LENGTHS FOR HORIZONTAL BARS SHALL BE BASED ON A "CLASS C" TOP TENSION LAP SPLICE.
- PARAPET NOT SHOWN IN PLAN VIEW FOR CLARITY.
- ABUTMENT DETAILED WITHOUT STRUCTURAL APPROACH SLAB. SEE STD. 12.10 THRU 12.13 FOR STRUCTURAL APPROACH DETAILS.

LEGEND

- 18" RUBBERIZED MEMBRANE WATERPROOFING. SEAL ALL HORIZ. AND VERT. JOINTS ON BACKFACE ABOVE FOOTING.
- ▲ KEYED CONSTRUCTION JOINT FORMED BY BEVELED 2" X 6".
- #4 AT 9" BEAM SEAT, SPACE AT 1'-0" BETWEEN SEATS. THIS STEEL IS REQUIRED ONLY IF DIMENSION "A" EXCEEDS 4".
- † 1'-5" WHEN VERTICAL FACE PARAPET TYPE "TX" IS USED.
- * 4" WHEN VERTICAL FACE PARAPET TYPE "TX" IS USED.
- ** WINGWALL WIDTH SHALL BE 1'-6" WHEN TYPE "M" RAILING, VERTICAL FACE PARAPET "TX", OR SINGLE SLOPE PARAPET "56SS" IS USED. "56SS" SHOULD NOT BE USED ON A SIDEWALK. WINGWALL WIDTH SHALL BE 1'-9" WHEN TYPE "NY3" OR "NY4" RAILING IS USED.
- ☒ 3'-3" (SLOPE PAVING), 4'-6" (HEAVY RIPRAP)
- ☒ PAVING NOTCH IS 1'-0" WIDE BY 1'-4" DEEP IF STRUCTURAL APPROACH SLAB (STD. 12.10) IS USED.
- ☆ SIDEWALL IS 1'-3" WIDE IF STRUCTURAL APPROACH SLAB (STD. 12.10) IS USED.
- SHOW ALL BARS FOR CLARITY.

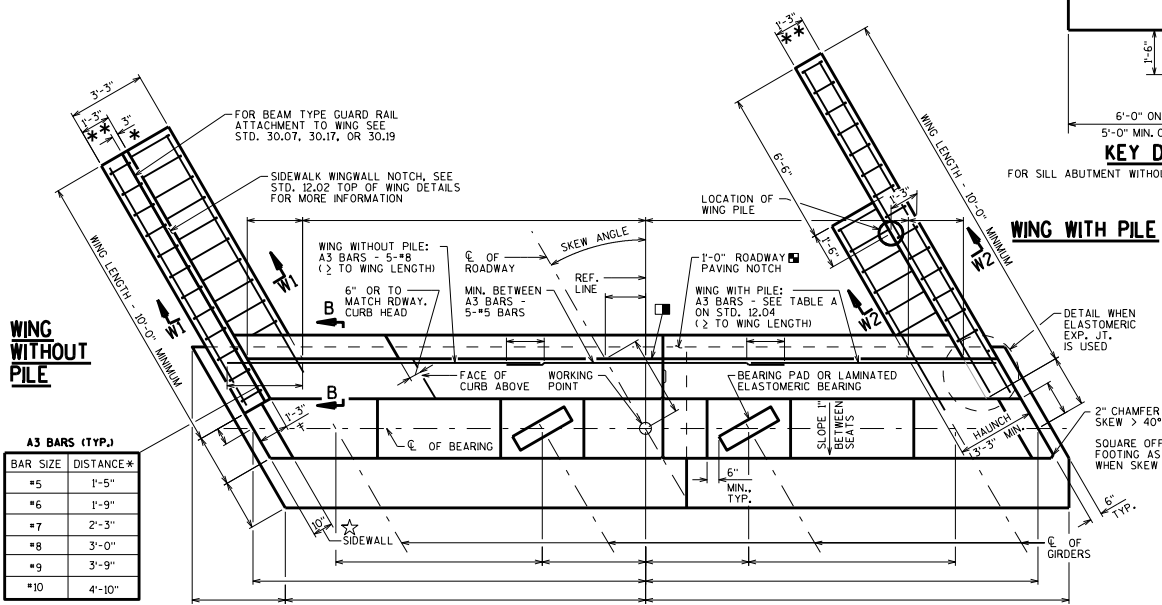

A3 BARS (TYP.)


BAR SIZE	DISTANCE*
#5	1'-5"
#6	1'-9"
#7	2'-3"
#8	3'-0"
#9	3'-9"
#10	4'-10"

* OR EQUIVALENT STANDARD HOOK


WING WITH SIDEWALK

PLAN


WING WITH SLOPED FACE PARAPET

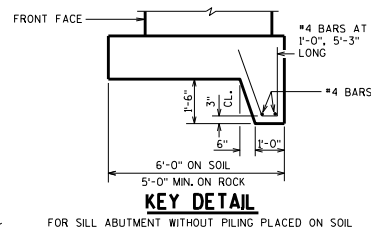

KEY DETAIL

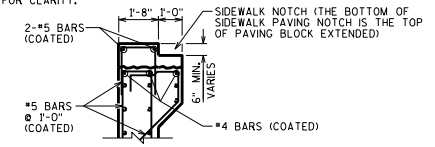

SECTION B-B

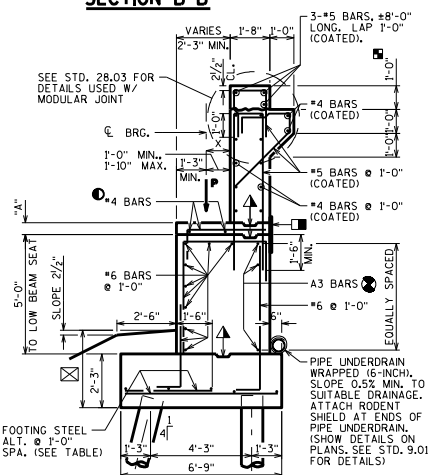

SECTION THRU BODY

ALL FOOTING BARS NOT IDENTIFIED ARE #5 BARS

h = WING HEIGHT (FT.)
 $P = \gamma D C (P D C)^2 \gamma D W (P D W)^2 \gamma L L (L L) (k/FT.)$

PILE REACTIONS PER FOOT IN KIPS

FRONT ROW = $P [(0.22 + X/4.25)] + [(h + 2.25)^2 / 310] + 4.6$

BACK ROW = $P [(0.78 - X/4.25)] - [(h + 2.25)^2 / 705] + 16.8$

(PILES MUST ALSO BE DESIGNED TO ACCOUNT FOR LATERAL LOADS)

P k/FT.	FOOTING STEEL SIZE
20	#6
40	#7
62	#8
75	#9

ABUTMENT TYPE A3

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

DESIGNER NOTES

THIS TYPE OF WING SHOULD BE USED WHEN POSSIBLE IN LIEU OF WINGS PARALLEL TO THE ROADWAY. DO NOT USE FOR STREAM CROSSINGS WHERE HIGH WATER MAY BE A PROBLEM.

*USE 2½:1 FOR THE UNSTABLE CLAYS WHICH ARE SOMETIMES ENCOUNTERED IN NORTHWEST WISC. (SUPERIOR AREA)

1 WHEN TIMBER RAILING IS USED AS PER STANDARD 30.24, AND THE SKEW IS > 0°, THIS CONSTRUCTION JOINT SHALL BE MANDATORY. THE WING CONCRETE SHALL BE PLACED ABOVE CONSTR. JT. AFTER THE TIMBER END POSTS ARE IN PLACE.

ALL WING BARS SHALL BE EPOXY COATED.

2 SHOW ALL LONGITUDINAL BARS FOR CLARITY.

LRFD DESIGN LOADS (WINGS)

LIVE LOAD = 1'-0" SURCHARGE

LOAD FACTORS:

γ_{DC} = 1.25

γ_{SM} = 1.50

γ_L = 1.75

EXPOSURE CLASS 2, X₁ = 0.75

HORIZ. EARTH LOAD BASED ON: 35 P.C.F. EQUIV. FLUID UNIT

WT OF SOIL


F_y = 60,000 P.S.I.

F_c = 3,500 P.S.I.

TABLE A


WING LENGTH	WING HEIGHT				BARS
	8'-6"	10'-0"	11'-6"	13'-0"	
10'-0"	5-#5's	5-#5's	6-#5's		W
	4-#6's	2-#5's	2-#5's		WT
12'-0"		5-#6's	5-#7's	6-#7's	W
		2-#7's	2-#7's	2-#8's	WT
		5-#6's	6-#6's	6-#7's	AI
16'-0"		5-#8's	6-#8's	5-#9's	W
		2-#8's	2-#8's	2-#9's	WT
20'-0"		5-#8's	6-#8's	7-#8's	AI
			8-#8's	8-#9's	W
			2-#8's	2-#9's	WT
			7-#9's	8-#9's	AI

▲ WING PILE REQUIRED

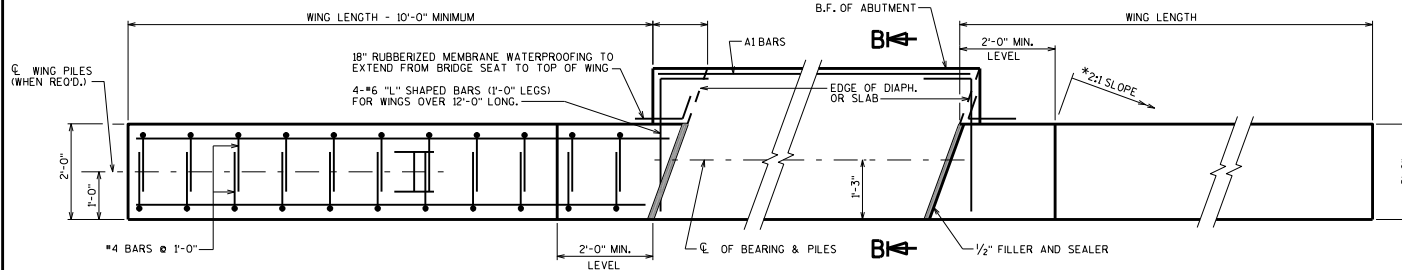

PLAN FOR TYPE A1 ABUTMENT


(SEE STD. 12.01 FOR ABUTMENT BODY DETAILS)

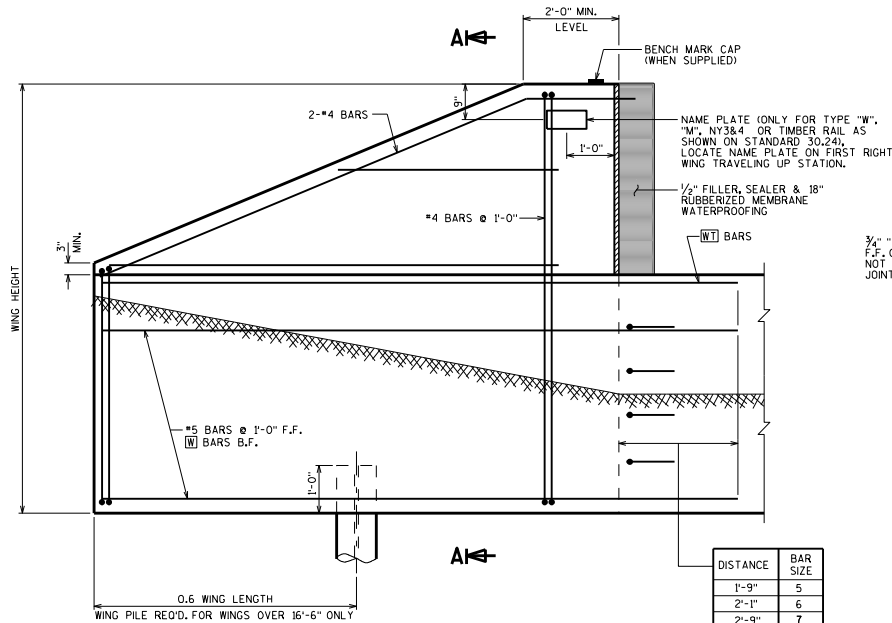

WING ELEVATION

(A1 ABUTMENT)

DISTANCE	BAR SIZE
1'-9"	5
2'-1"	6
2'-9"	7
3'-8"	8
4'-7"	9

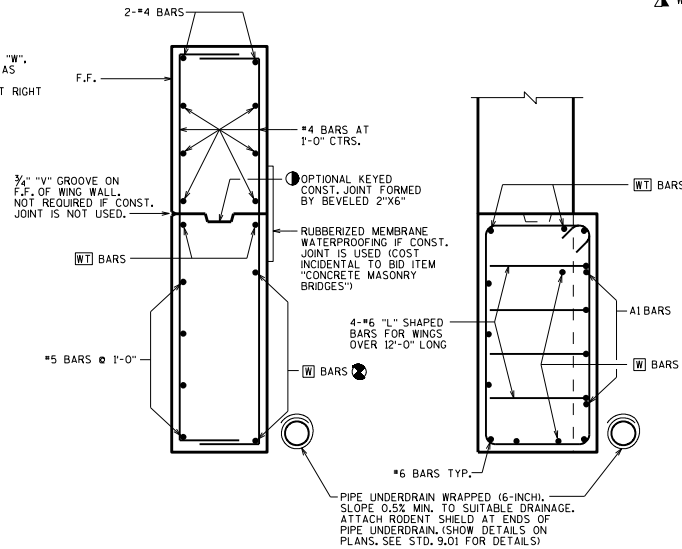

SECTION A-A

SECTION B-B


SEE STD. 12.01 & 12.02 FOR NOTES & DETAILS

DETAILS FOR WINGS PARALLEL TO A1 ABUTMENT CENTERLINE

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

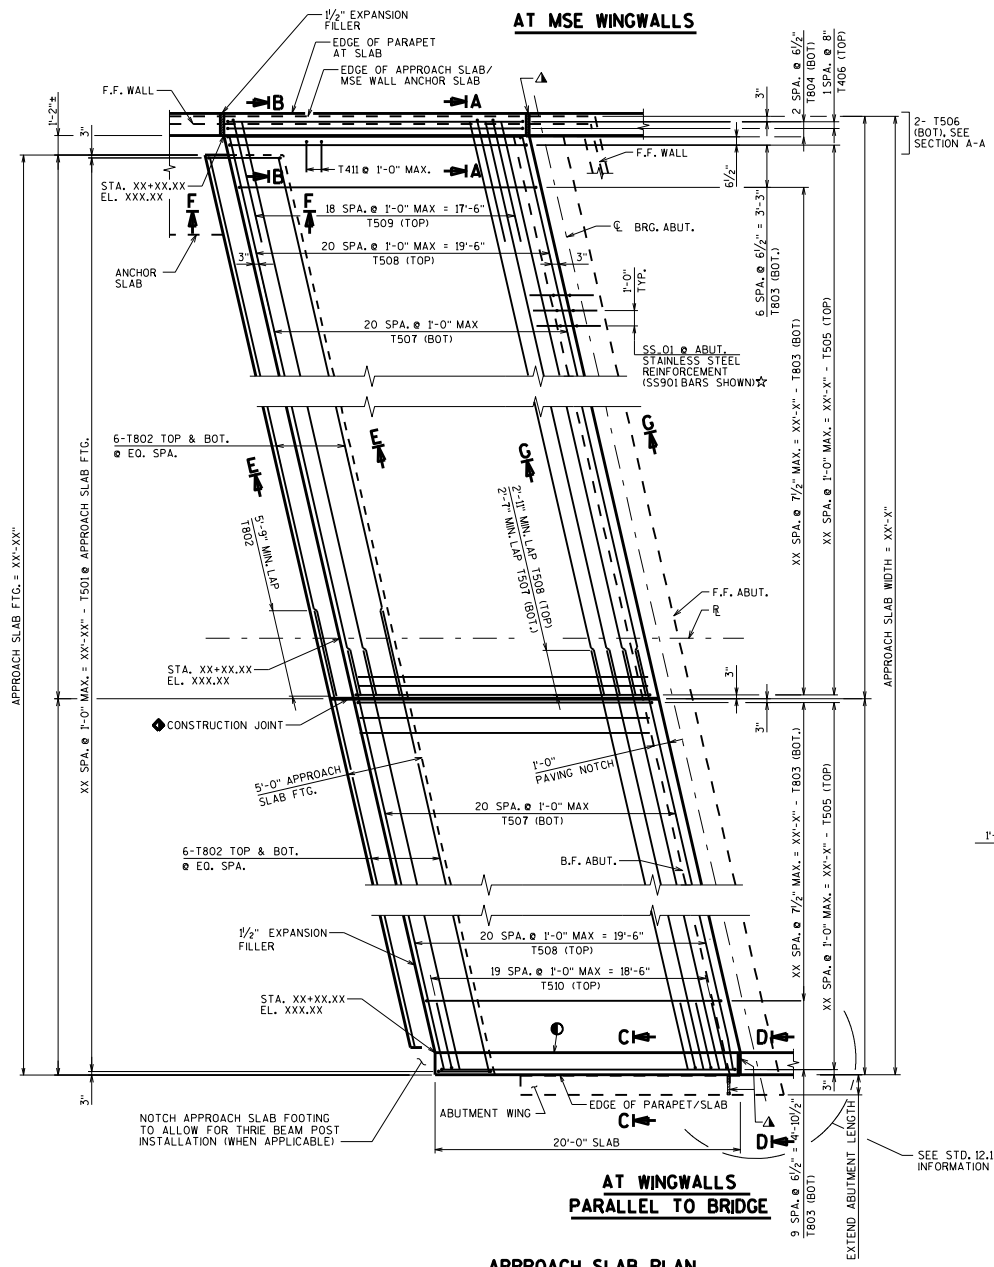

DESIGNER NOTES

STRUCTURAL APPROACH SLABS AND PARAPETS SHALL BE USED ON ALL BRIDGES CARRYING TRAFFIC VOLUMES GREATER THAN 3500 AADT (FUTURE DESIGN YEAR). OTHER LOCATIONS CAN BE CONSIDERED WITH THE APPROVAL OF THE CHIEF STRUCTURAL DESIGN ENGINEER.

STRUCTURE APPROACH SLABS TO BE PART OF THE BRIDGE PLAN. BID ITEMS ARE CONCRETE MASONRY BRIDGES, BAR STEEL REINFORCEMENT HS COATED STRUCTURES, ETC. POLYETHYLENE SHEETS SHALL BE INCIDENTAL TO CONCRETE MASONRY BRIDGES.

QUANTITIES FOR APPROACH SLABS SHALL BE SHOWN IN A SEPARATE COLUMN WITHIN THE TOTAL ESTIMATED QUANTITIES TABLE IN THE FINAL PLANS.

◆ CONSTRUCTION JOINT REQUIRED WHEN WIDTH OF SUPERSTRUCTURE EXCEEDS 90'. RUN REINFORCEMENT THROUGH THE JOINT.

LONGITUDINAL APPROACH SLAB REINFORCEMENT SHALL BE PLACED PARALLEL TO THE APPROACH (I.E., NOT NORMAL TO THE ABUTMENT WITH SKEWED STRUCTURES).

STRUCTURE APPROACH SLABS TO BE DETAILED TO MATCH THE BRIDGE DECK (I.E., PROTECTIVE SURFACE TREATMENT, STAINLESS STEEL REINFORCEMENT, LONGITUDINAL GROOVING, ETC.). WHERE HIGH PERFORMANCE CONCRETE IS USED AT THE BRIDGE DECK, HPC SHALL BE USED FOR THE APPROACH SLAB ONLY (I.E., HPC IS NOT REQUIRED FOR APPROACH SLAB FOOTING).

☆ THE BID ITEM FOR SS901 AND SS601 BARS SHALL BE STANDARD SPECIAL PROVISION "BAR STEEL REINFORCEMENT HS STAINLESS STRUCTURES".

DESIGNER TO COORDINATE LOCATION OF SURFACE DRAINS, INLETS, AND/OR FLUMES WITH ROADWAY DESIGNER AND FDM SDD B02 OR B03.

LEGEND

△ SEAL ALL EXPOSED HORIZONTAL AND VERTICAL SURFACES OF 1/2" FILLER WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER. (1" DEEP AND HOLD 1/4" BELOW SURFACE OF CONCRETE).

● SEE PARAPET STANDARD DETAILS FOR LOCATION OF NAME PLATE AND BENCH MARK WITH RESPECT TO THE END OF PARAPET.

DESIGN DATA

CONCRETE STRENGTH, f'c: 4,000 P.S.I.
BAR STEEL REINFORCEMENT, GRADE 60, fy: 60,000 P.S.I.
ALLOWABLE SOIL BEARING PRESSURE: 2,000 P.S.F.


NOTE:
FOR NEW STRUCTURES ON NEW ALIGNMENTS, BASE AGGREGATE DENSE 1-1/4 INCH AS PER FDM 14-5 AND BRIDGE MANUAL FIGURE 12.6-2 SHALL BE UTILIZED. FOR REPLACEMENT STRUCTURES ON EXISTING ALIGNMENTS, THE EXISTING SOIL MAY REMAIN IN PLACE IF THE REGION SOILS ENGINEER DETERMINES THAT THE EXISTING SOIL BEARING PRESSURE MEETS THE REQUIREMENT ABOVE.

BILL OF BARS

NOTE: THE FIRST OR FIRST TWO DIGITS OF THE BAR MARK SIGNIFIES THE BAR SIZE.

BAR MARK	COAT	NO. REQ'D.	LENGTH	BEV	BAR SERIES	LOCATION
SS901			5'-0"	X		CONC. ABUT. DIAPH. TO APPROACH SLAB
SS901			5'-0"	X		CONC. BACKWALL TO APPROACH SLAB
SS601			3'-0"			STRUCTURE SLAB TO APPROACH SLAB

BAR MARK	COAT	NO. REQ'D.	LENGTH	BEV	BAR SERIES	LOCATION
T501	X			X		APPROACH SLAB FTG. - STIRRUP
T802	X					APPROACH SLAB FTG. - TRANS.
T803	X			X		APPROACH SLAB - LONG. - BOT.
T804	X					APPROACH SLAB - LONG. - BOT. - WALL
T505	X					APPROACH SLAB - LONG. - TOP.
T506	X					APPROACH SLAB - LONG. - WALL
T507	X					APPROACH SLAB - TRANS. - BOT.
T508	X					APPROACH SLAB - TRANS. - TOP.
T509	X	4'-10"	X			APPROACH SLAB - TRANS. - TOP - WALL
T510	X	4'-1"	X			APPROACH SLAB - TRANS. - TOP - WING
T411	X	3'-0"	X			APPROACH SLAB - TRANS. - WALL

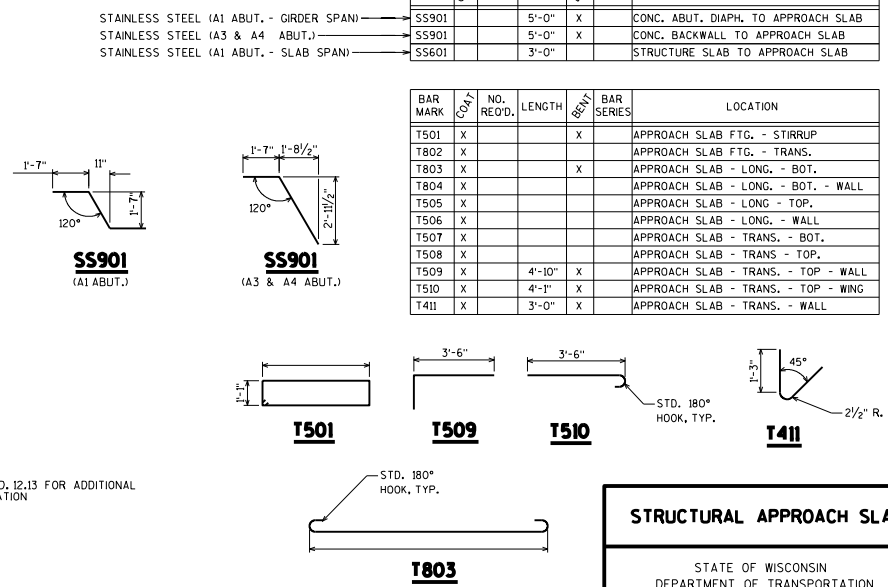


SECTIONS A-A THRU G-G ARE SHOWN ON STANDARD 12.11 & 12.12

STRUCTURAL APPROACH SLAB

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

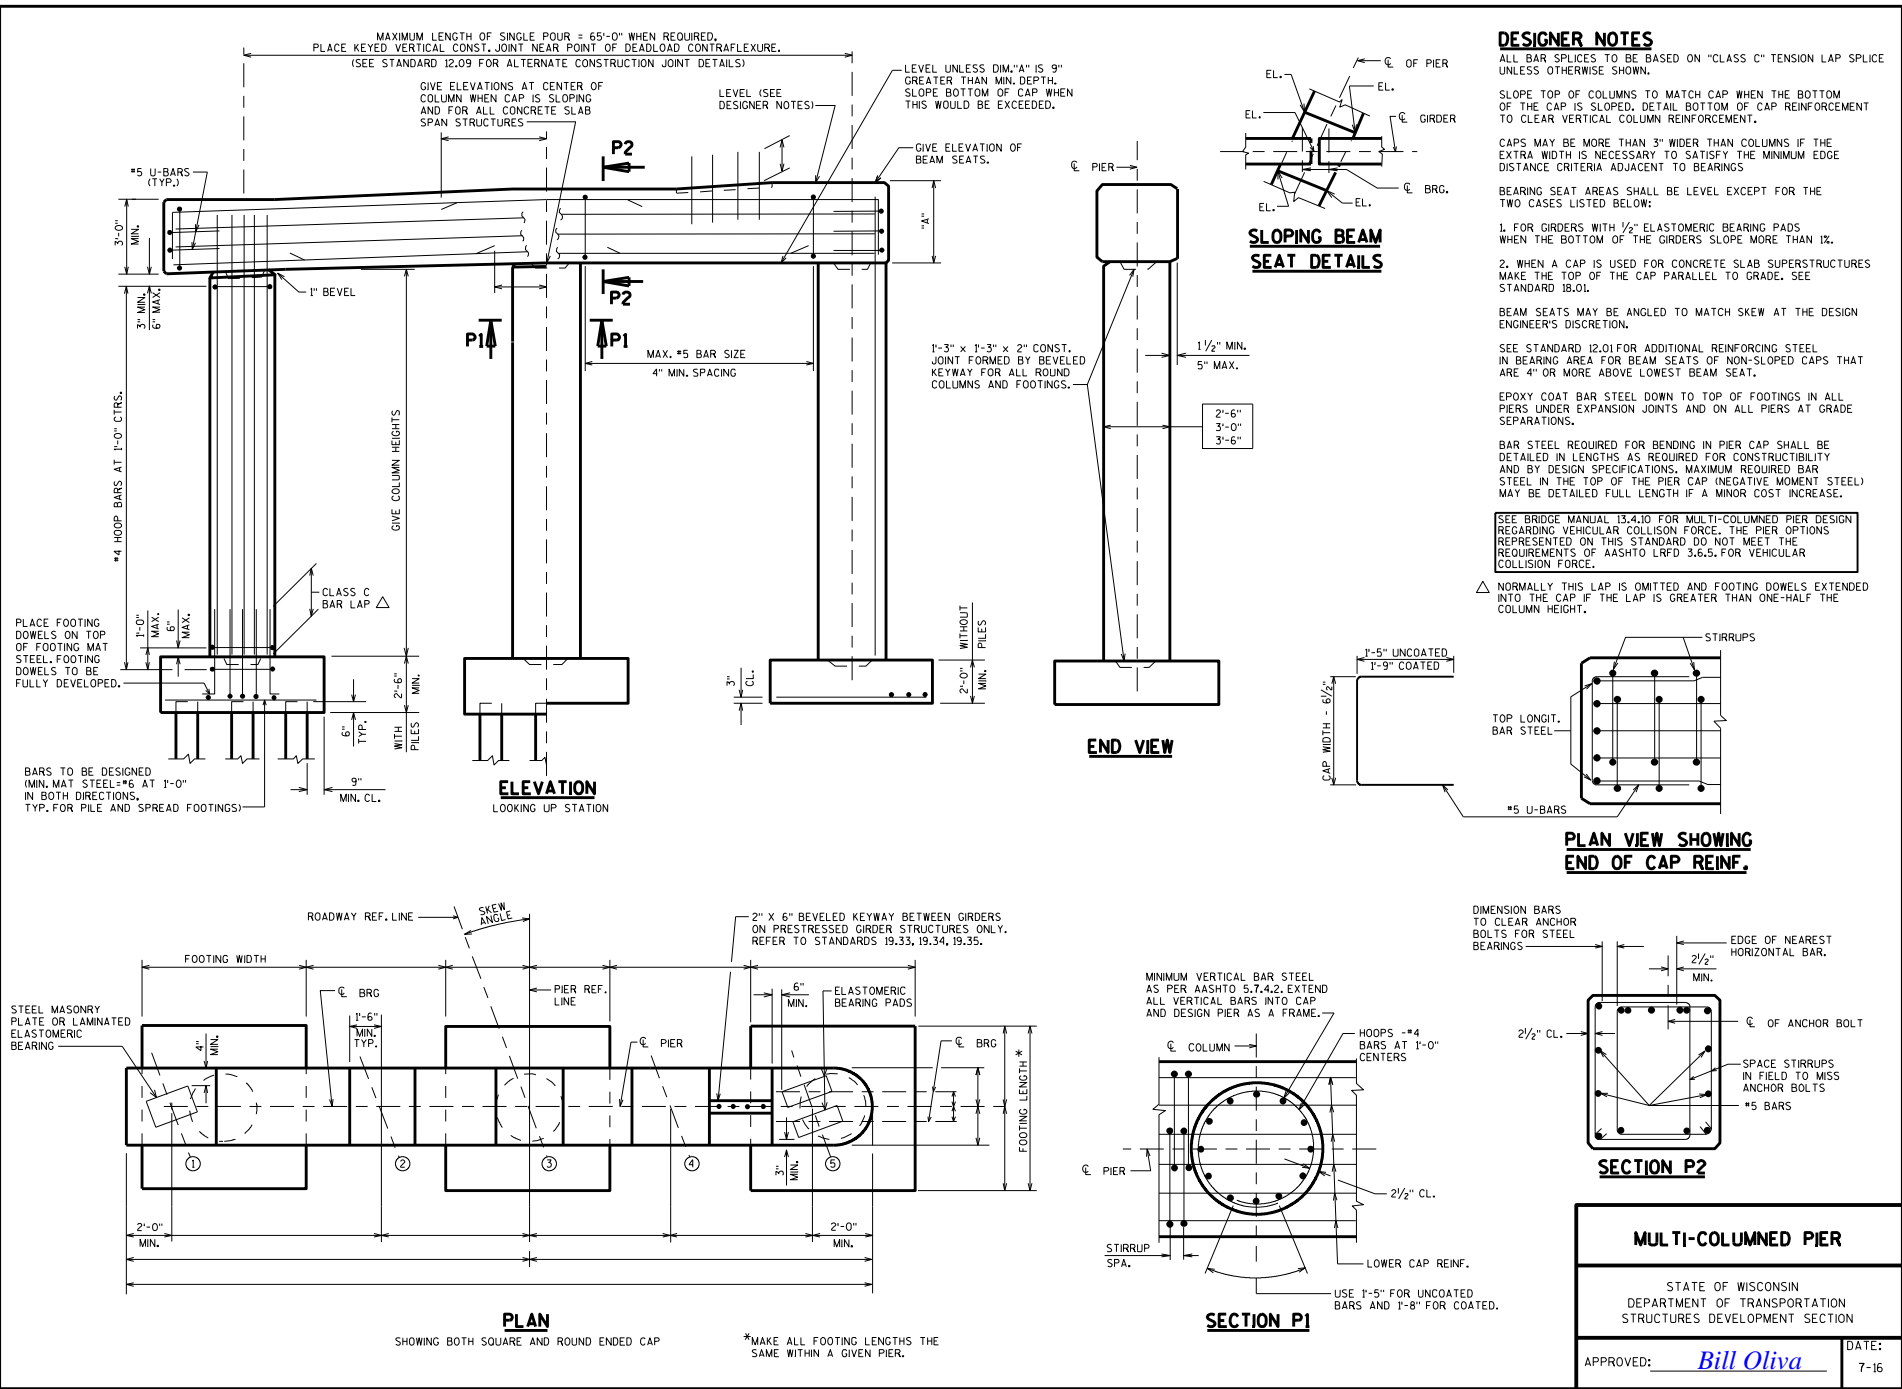

DESIGNER NOTES

ALL BAR SPLICES TO BE BASED ON "CLASS C" TENSION LAP SPLICE UNLESS OTHERWISE SHOWN.

SLOPE TOP OF COLUMNS TO MATCH CAP WHEN THE BOTTOM OF THE CAP IS SLOPED. DETAIL BOTTOM OF CAP REINFORCEMENT TO CLEAR VERTICAL COLUMN REINFORCEMENT.

CAPS MAY BE MORE THAN 3" WIDER THAN COLUMNS IF THE EXTRA WIDTH IS NECESSARY TO SATISFY THE MINIMUM EDGE DISTANCE CRITERIA ADJACENT TO BEARINGS

BEARING SEAT AREAS SHALL BE LEVEL EXCEPT FOR THE TWO CASES LISTED BELOW:

1. FOR GIRDERS WITH 1/2" ELASTOMERIC BEARING PADS WHEN THE BOTTOM OF THE GIRDERS SLOPE MORE THAN 1%.
2. WHEN A CAP IS USED FOR CONCRETE SLAB SUPERSTRUCTURES MAKE THE TOP OF THE CAP PARALLEL TO GRADE. SEE STANDARD 18.01.

BEAM SEATS MAY BE ANGLED TO MATCH SKEW AT THE DESIGN ENGINEER'S DISCRETION.

SEE STANDARD 12.01 FOR ADDITIONAL REINFORCING STEEL IN BEARING AREA FOR BEAM SEATS OF NON-SLOPED CAPS THAT ARE 4" OR MORE ABOVE LOWEST BEAM SEAT.


EPOXY COAT BAR STEEL DOWN TO TOP OF FOOTINGS IN ALL PIERS UNDER EXPANSION JOINTS AND ON ALL PIERS AT GRADE SEPARATIONS.

BAR STEEL REQUIRED FOR BENDING IN PIER CAP SHALL BE DETAILED IN LENGTHS AS REQUIRED FOR CONSTRUCTIBILITY AND BY DESIGN SPECIFICATIONS. MAXIMUM REQUIRED BAR STEEL IN THE TOP OF THE PIER CAP (NEGATIVE MOMENT STEEL) MAY BE DETAILED FULL LENGTH IF A MINOR COST INCREASE.


SEE BRIDGE MANUAL 13.4.10 FOR MULTI-COLUMNED PIER DESIGN REGARDING VEHICULAR COLLISION FORCE. THE PIER OPTIONS REPRESENTED ON THIS STANDARD DO NOT MEET THE REQUIREMENTS OF AASHTO LRFD 3.6.5. FOR VEHICULAR COLLISION FORCE.

Δ NORMALLY THIS LAP IS OMITTED AND FOOTING DOWELS EXTENDED INTO THE CAP IF THE LAP IS GREATER THAN ONE-HALF THE COLUMN HEIGHT.


MULTI-COLUMNED PIER	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

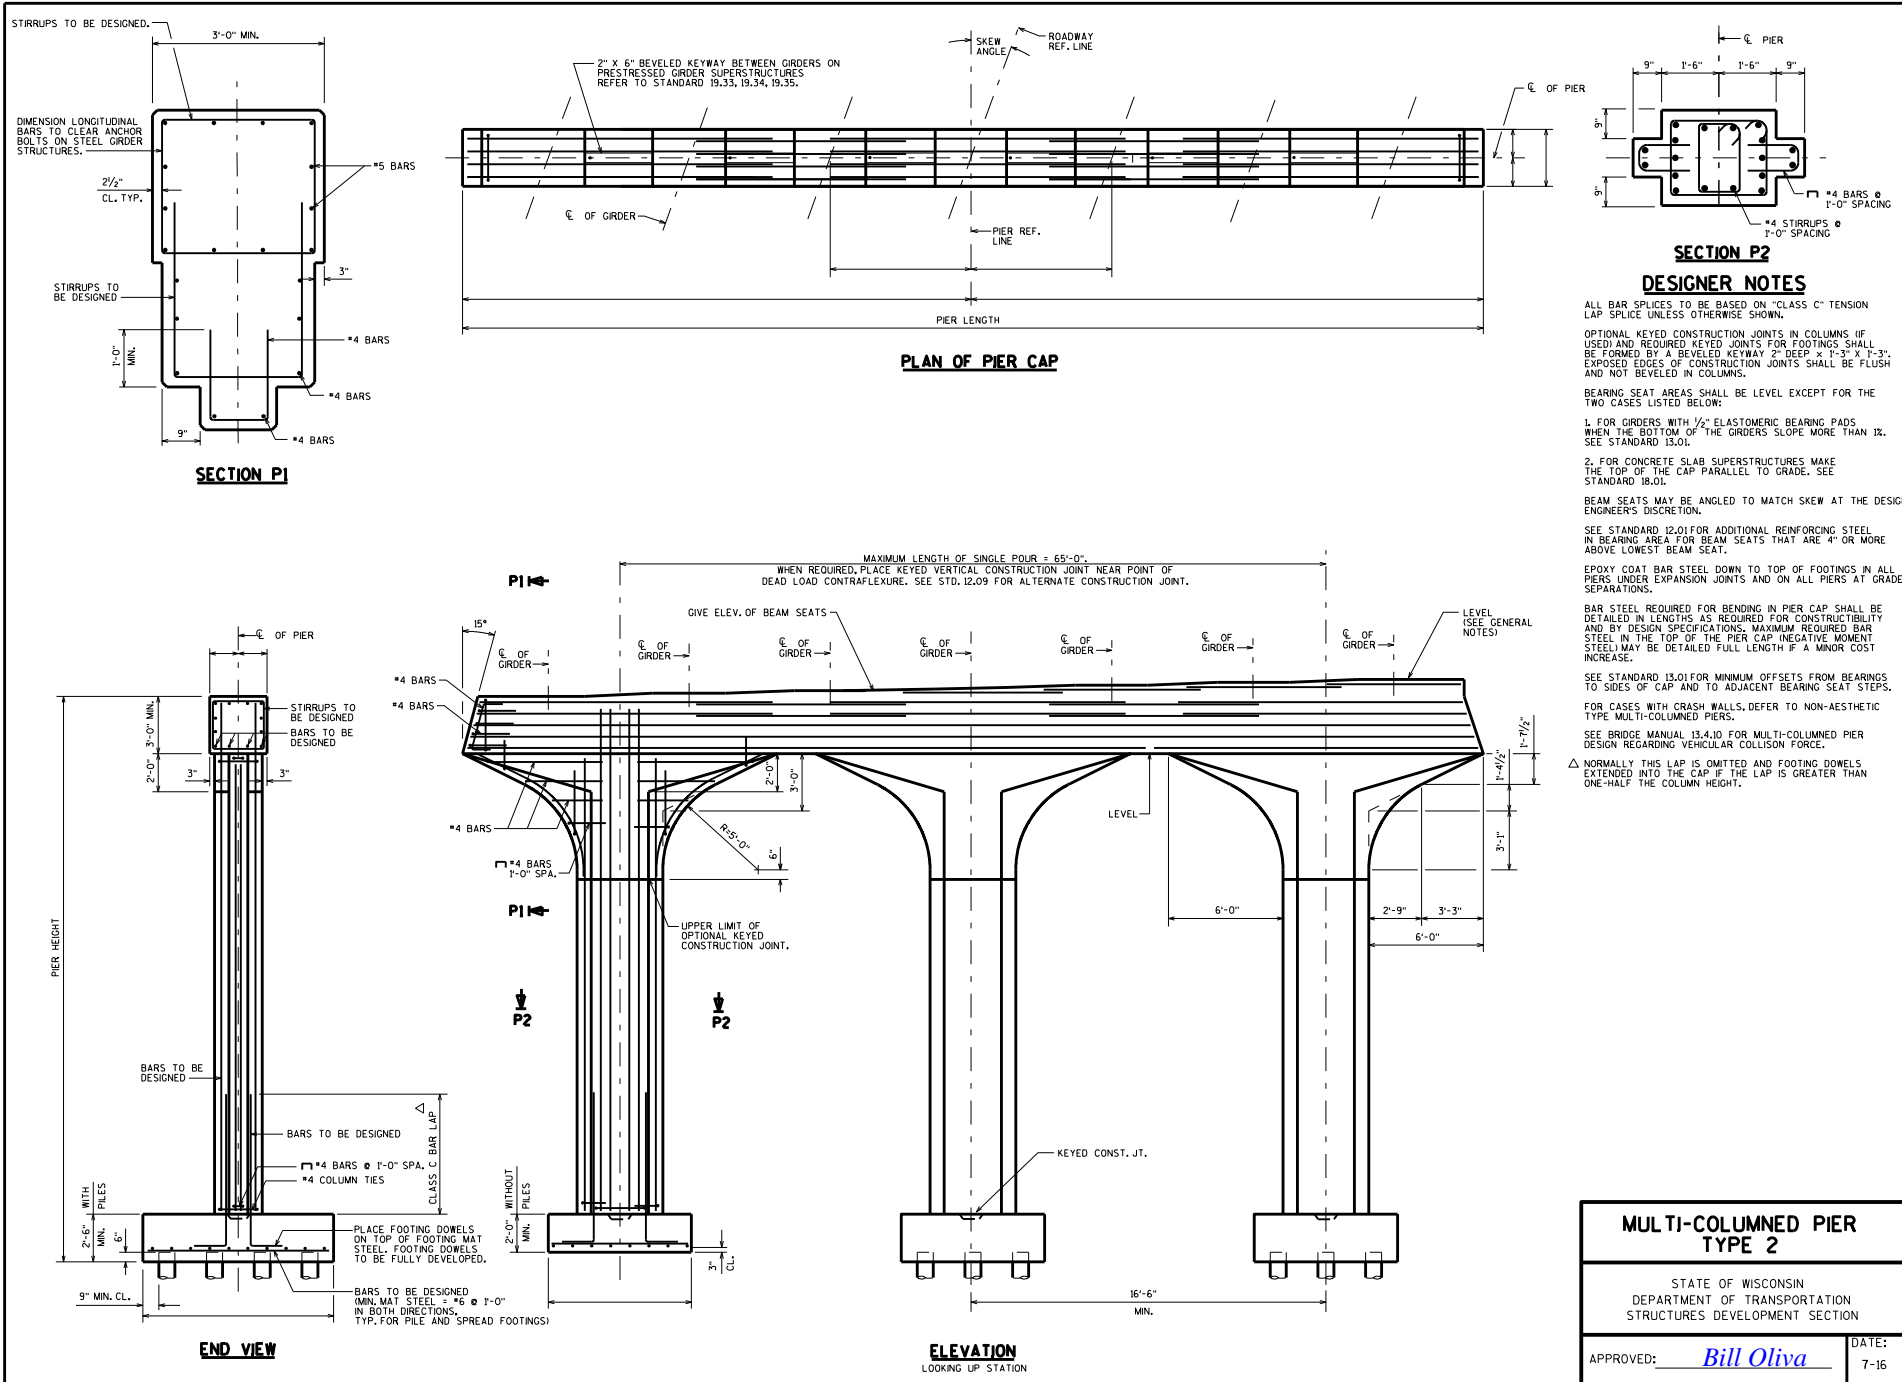


MULTI-COLUMNED PIER TYPE 2	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

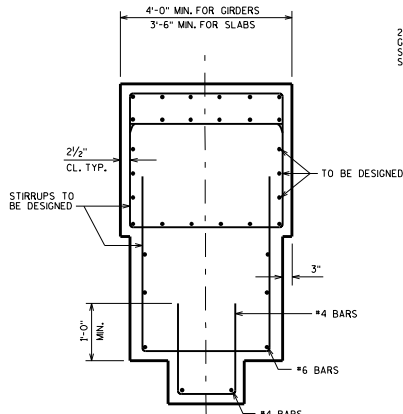

SECTION P1

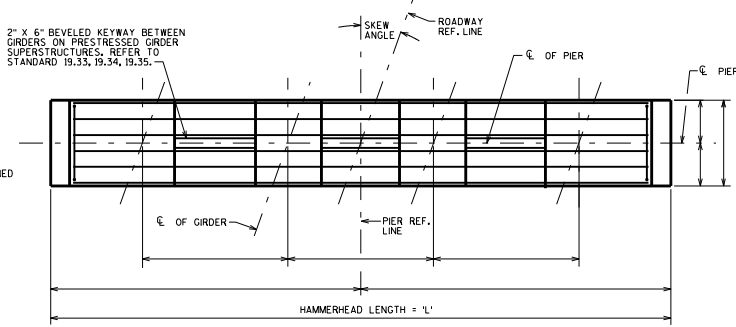

PLAN OF PIER CAP

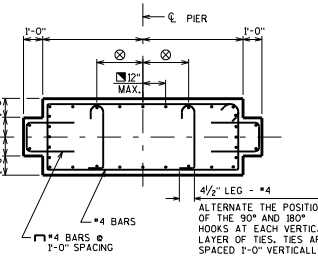

SECTION P2

NOTES

THE BAR SPLICES AT THE OPTIONAL KEYED CONSTRUCTION JOINTS MAY BE ELIMINATED WHETHER OR NOT THE JOINT IS UTILIZED. PAYMENT WILL BE FOR THE ACTUAL BARS INSTALLED.

DESIGNER NOTES (CONT)

- THIS MAXIMUM VERT. BAR SPACING APPLIES ONLY WHEN THE VERTICAL REINFORCEMENT IS 1% OR MORE OF THE GROSS CONCRETE AREA.
- ⊖ MAXIMUM SPACING BETWEEN UNRESTRAINED VERTICAL BAR AND RESTRAINED (TIED ACROSS MEMBER) VERTICAL BAR IS 24 INCHES

DESIGNER NOTES

ALL BAR SPLICES TO BE BASED ON "CLASS C" TENSION LAP SPLICE UNLESS OTHERWISE SHOWN.

OPTIONAL KEYED CONSTRUCTION JOINTS IN SHAFT, IF PROVIDED, SHALL BE PLACED APPROXIMATELY 2'-0" ABOVE NORMAL WATER ELEVATION. OPTIONAL KEYED CONSTRUCTION JOINTS IN SHAFT SHOULD BE PROVIDED SO THAT THE MAXIMUM HEIGHT OF POUR NEED NOT EXCEED 25'-0". DETAIL BAR SPLICES AT OPTIONAL JOINTS IF THE BAR PROJECTION WOULD BE GREATER THAN 20'-0".

KEYED CONSTRUCTION JOINTS SHALL BE FORMED BY BEVELED KEYWAY 4" DEEP X 1/3 THICKNESS OF SHAFT X 4'-0" LESS THAN LENGTH OF SHAFT. EXPOSED EDGES OF CONSTRUCTION JOINT SHALL BE FLUSH AND NOT BEVELED.

BEARING SEAT AREAS SHALL BE LEVEL EXCEPT FOR THE TWO CASES LISTED BELOW:

1. FOR GIRDER WITH 1/2" ELASTOMERIC BEARING PADS 4" DEEP X 1/3 THICKNESS OF SHAFT X 4'-0" LESS THAN LENGTH OF SHAFT. TIES ARE SPACED 1'-0" VERTICALLY. SEE STANDARD 13.01.

2. WHEN A CAP IS USED FOR CONCRETE SLAB SUPERSTRUCTURES MAKE THE TOP OF CAP PARALLEL TO GRADE. SEE STANDARD 18.01.


BEAM SEATS MAY BE ANGLED TO MATCH SKEW AT THE DESIGN ENGINEER'S DISCRETION.

SEE STANDARD 12.01 FOR ADDITIONAL REINFORCING STEEL IN BEARING AREA FOR BEAM SEATS THAT ARE 4" OR MORE ABOVE LOWEST BEAM SEAT.


FOR "HAMMERHEAD LENGTH" GREATER THAN 45'-0", CONSIDER A TWO SHAFT PIER FRAME RESEMBLING TWO HAMMERHEAD PIERS PLACED SIDE BY SIDE.

SEE STANDARD 13.01 FOR MINIMUM OFFSETS FROM BEARINGS TO SIDES OF CAP AND TO ADJACENT BEARING SEAT STEPS.


EPOXY COAT BAR STEEL DOWN TO TOP OF FOOTINGS IN ALL PIERS UNDER EXPANSION JOINTS AND ON ALL PIERS AT GRADE SEPARATIONS.

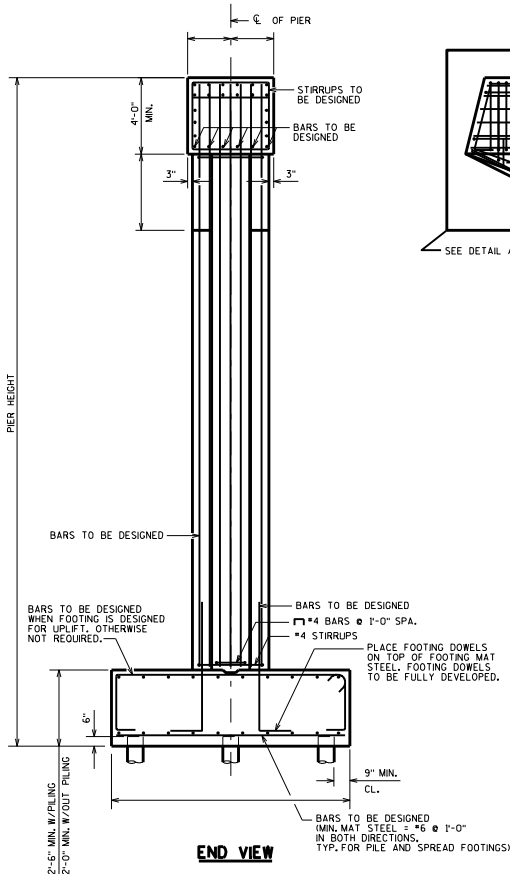


END VIEW

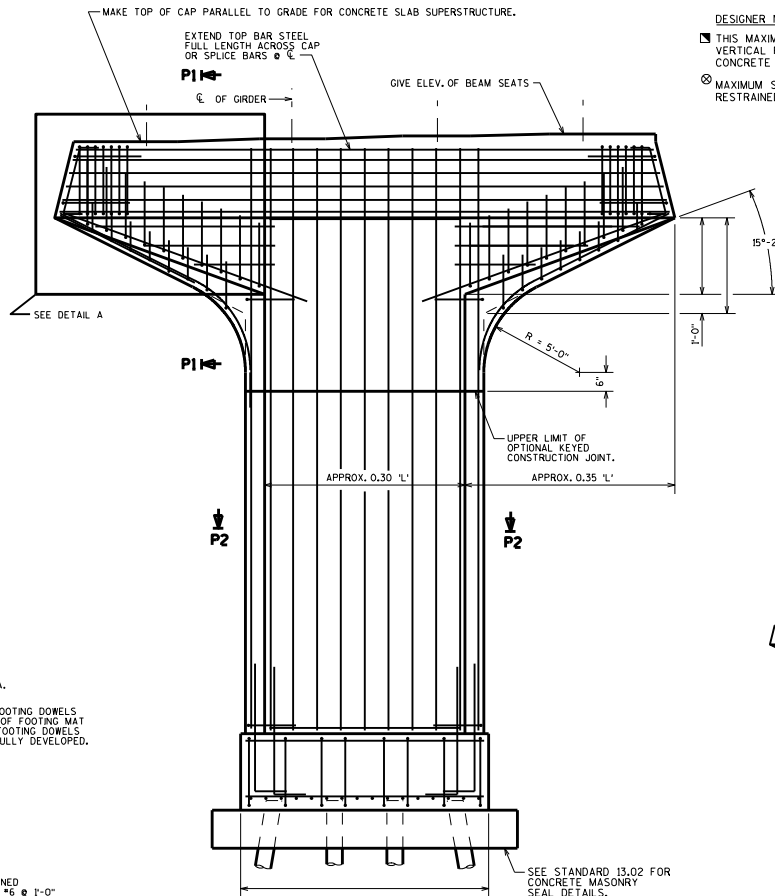

ELEVATION
LOOKING UP STATION

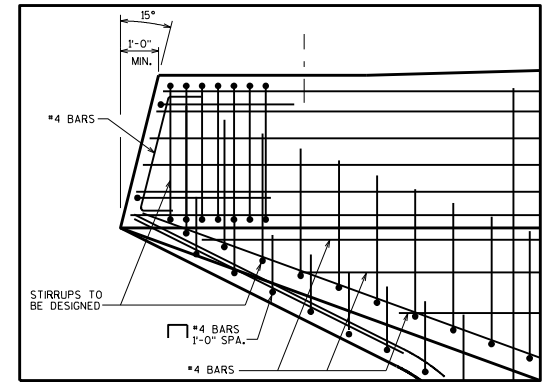

DETAIL A

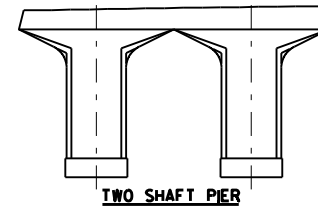


TWO SHAFT PIER

HAMMERHEAD PIER - TYPE 2

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

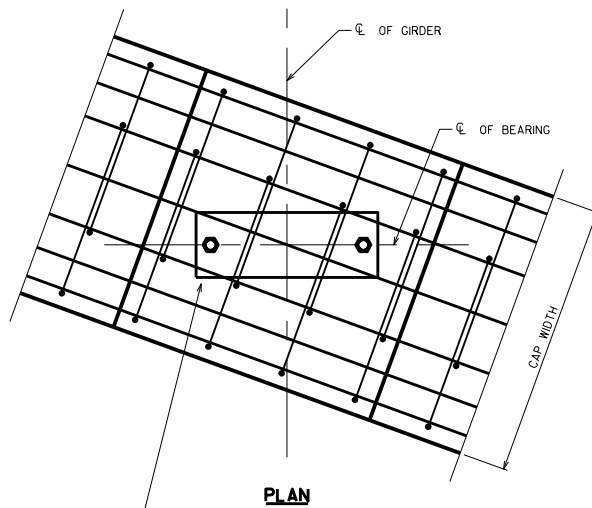

PLAN

PROVIDE ADEQUATE CLEARANCE FOR POST-INSTALLED ANCHORS

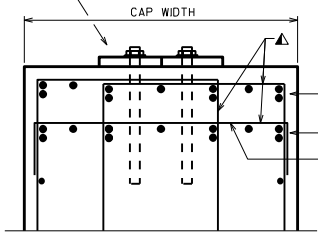

SECTION THRU PIER CAP

DESIGNER NOTES

PROVIDE 4" MIN. CLEAR BETWEEN ANCHOR BOLTS AND REINFORCEMENT.

FOR PIER CAPS UP TO 3'-6" WIDE, PROVIDE AT LEAST ONE 5" MIN. CLEARANCE BETWEEN REINFORCING BARS FOR CONCRETE PLACEMENT BY TREMIE AND FOR VIBRATION. FOR CAPS GREATER THAN 3'-6" WIDE, PROVIDE AT LEAST TWO SUCH GAPS.


SHOW ANCHORS LOCATIONS ON PIER CAP SHEETS.

ABUTMENT REINFORCEMENT LAYOUT SIMILAR TO PIER CAP REINFORCEMENT DETAILING.

NOTE


▲ DISPLACE TRANSVERSE STIRRUP BARS AS NEEDED TO PROVIDE 4" MIN. CLEAR BETWEEN ANCHOR BOLTS AND REINFORCEMENT.

PIER CAP REINFORCEMENT DETAILING	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

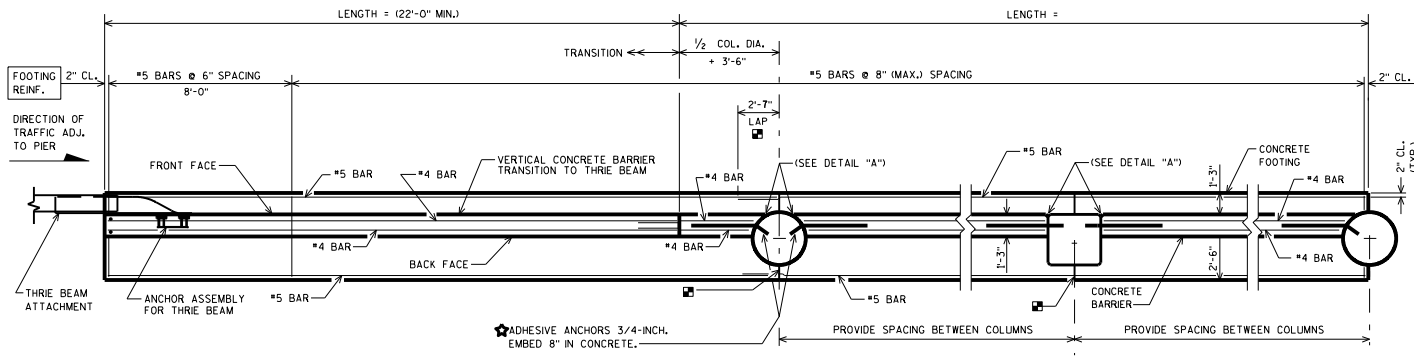

OPTIONAL CONSTRUCTION JOINTS IN FOOTINGS PLACED ALONG C.C. OF COLUMN. IF USED, LAP LONGITUDINAL REINFORCEMENT 2'-7" IN ADJACENT POUR.

PLAN
DETAILS FOR CIRCULAR AND RECTANGULAR COLUMNS

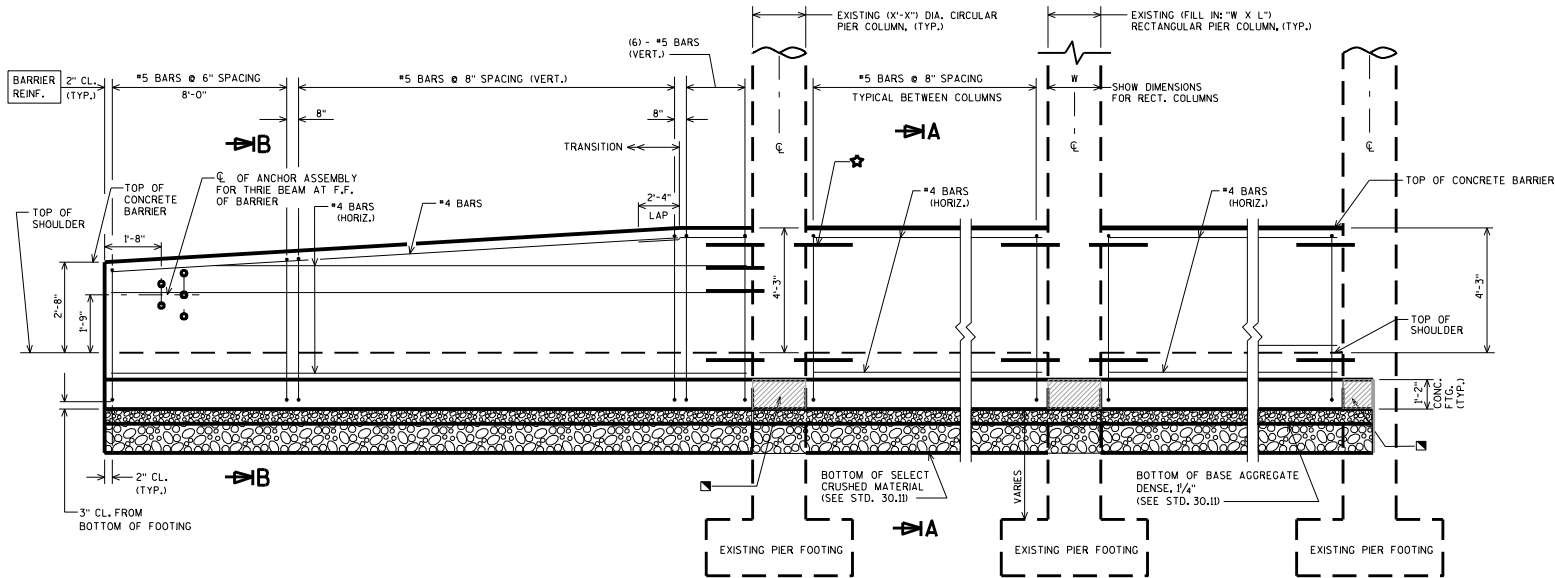


ULTIMATE DESIGN STRESSES:

CONCRETE MASONRY $f'_c = 4,000$ P.S.I.
HIGH-STRENGTH BAR STEEL
REINFORCEMENT, GRADE 60 $f_y = 60,000$ P.S.I.

ELEVATION
LOOKING AT B.F. OF BARRIER

PLACE 1/2" FILLER BETWEEN COLUMN AND CONCRETE FOOTING (TYP.)

NOTE: 51-INCH BARRIER REFERS TO THE DISTANCE FROM THE TOP OF THE SHOULDER TO THE TOP OF THE BARRIER.

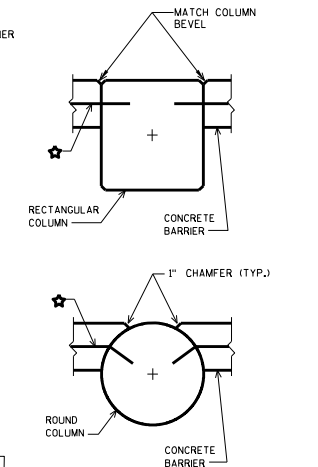

DETAIL A
F.F. OF BARRIER IS FLUSH WITH FACE OF COLUMN

NOTES

DETAILS OF CONSTRUCTION MATERIALS AND WORKMANSHIP NOT SHOWN ON THIS DRAWING SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE STANDARD SPECIFICATION AND THE APPLICABLE SPECIAL PROVISIONS.

BARRIER AND FOOTING SHALL CONSIST OF CAST IN PLACE CONSTRUCTION. NO JOINTS SHALL BE ALLOWED IN THE BARRIER. CONSTRUCTION JOINTS WILL ONLY BE ALLOWED IN THE FOOTING AT LOCATIONS SHOWN IN THE "PLAN VIEW".

DO NOT CUT OR DRILL INTO EXISTING COLUMN BAR STEEL. ALL REINFORCEMENT SHALL BE EPOXY-COATED.

USE 2-INCH MINIMUM BAR CLEARANCE, EXCEPT AT FOOTINGS PROVIDE 3-INCH BAR CLEARANCE FROM BOTTOM OF FOOTING TO BOTTOM TRANSVERSE REINFORCEMENT.

PLACE REINFORCEMENT SUCH THAT IT WILL NOT CONFLICT WITH THE ANCHOR ASSEMBLY FOR THRIE BEAM ATTACHMENT.

PROVIDE 3/4-INCH BEVEL OR 1-INCH RADIUS ON BARRIER EDGES, TOP AND ENDS.

SEE STANDARD 13.11 FOR ADDITIONAL DETAILS.


SEE STANDARD 13.11 FOR DESIGNER NOTES.

51-INCH CONCRETE INTEGRAL BARRIER


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*

DATE:
7-16

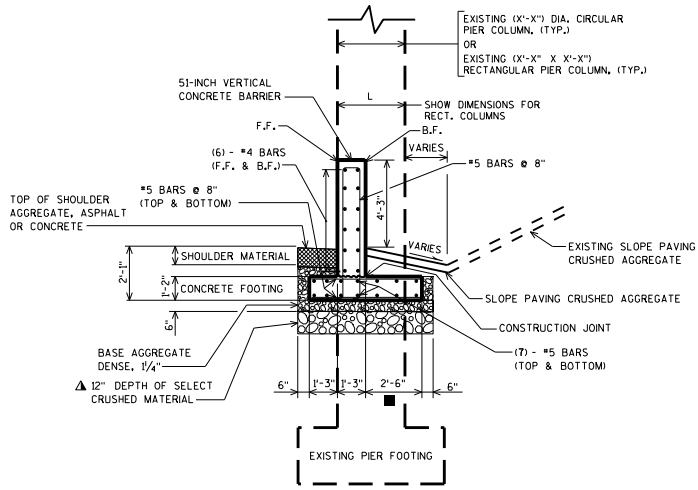


SECTION A-A
BETWEEN COLUMNS

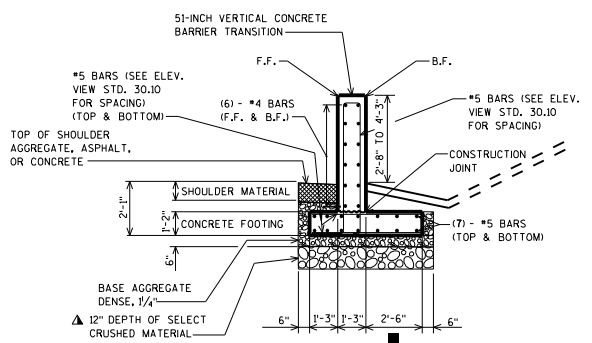


SECTION B-B
TRANSITION REGION

- ▲ 12" SELECT CRUSHED MATERIAL MAY BE ELIMINATED IF IT IS DETERMINED BY THE ENGINEER THAT THE EXISTING MATERIAL IS COMPACTED, GRANULAR MATERIAL.
- FOR COLUMNS WITH "DIA." OR "L" GREATER THAN 3'-0", INCREASE THIS VALUE SO THAT B.F. OF FOOTING EXTENDS 9" BEYOND B.F. OF COLUMN.



#6 BAR
USED WITH CIRCULAR COLUMNS (ADHESIVE ANCHOR)
* FOR RECTANGULAR COLUMN USE STRAIGHT BARS OF THIS LENGTH

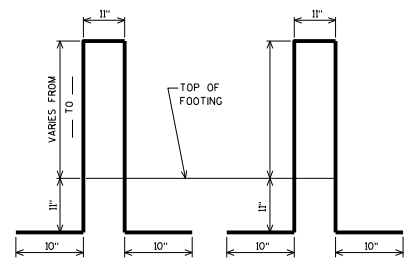


#5 BAR
BARRIER REINF. IN TRANSITION REGION

#5 BAR
BARRIER REINF. BETWEEN COLUMNS

BAR BENDING DIAGRAMS

BAR DIMENSIONS ARE OUT TO OUT OF BAR

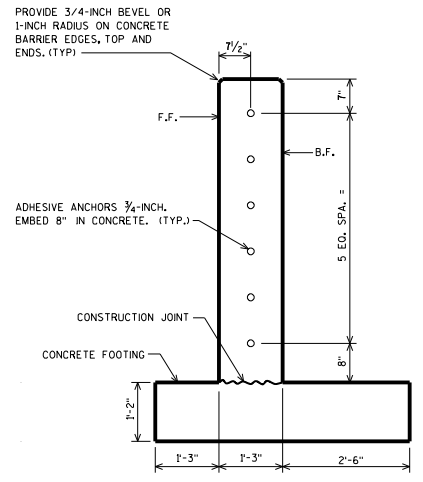

ADHESIVE ANCHOR LAYOUT

DESIGNER NOTES

THE DETAILS SHOWN ON STANDARDS 13.10 AND 13.11 ARE FOR VEHICLE PROTECTION AND ARE USED WITH EXISTING STRUCTURES.

CONSIDER PROVIDING AN ADDITIONAL TRANSITION SECTION ADJACENT TO THE OTHER EXTERIOR PIER COLUMN FOR THE FOLLOWING CONDITIONS:

- TWO-LANE ROAD IS ADJACENT TO BARRIER AND THERE IS A CONCERN FOR TRAFFIC TO CROSS-OVER.
- FUTURE TRAFFIC CONTROL NEEDS MAY CAUSE THE DIRECTION OF TRAFFIC ADJACENT TO BARRIER TO BE REVERSED.
- HAZARDS MAY EXIST IN THIS REGION THAT REQUIRE SHIELDING.

CONTACT THE REGIONAL OFFICE FOR VERIFICATION OF ANY OF THESE CONDITIONS.


THESE DETAILS MEET CRITERIA FOR TEST LEVELS TL-3/TL-4.

FOR VEHICLE PROTECTION, SEE FDM 11-25-1 TO DETERMINE WHEN BEAM GUARD OR CONCRETE BARRIER SHOULD BE PLACED BETWEEN THE TRAFFIC AND THE PIER, OR WHEN AN INTEGRAL BARRIER SHOULD BE USED.

F.F. = FRONT FACE
B.F. = BACK FACE

51-INCH VERTICAL CONCRETE BARRIER AND TRANSITION
SEE STANDARD 13.10 FOR ADDITIONAL DETAILS


INTEGRAL BARRIER DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

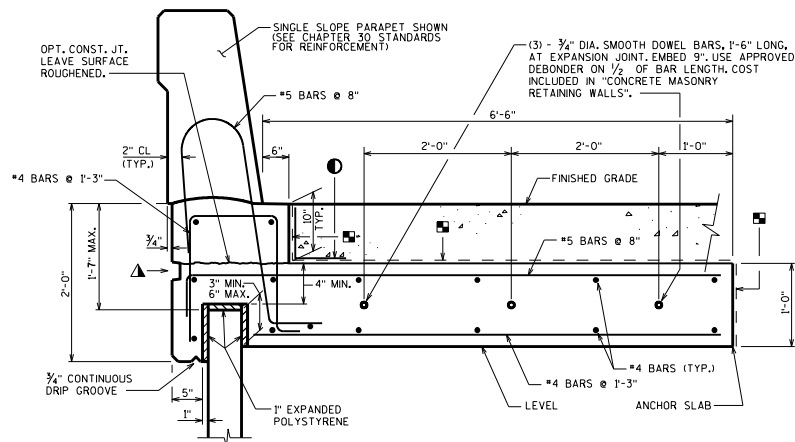

- 18" RUBBERIZED MEMBRANE WATERPROOFING TO BE PLACED ON THESE SURFACES AT EACH JOINT.
- IF THE OPT. CONST. JOINT IS USED, PLACE 18" MEMBRANE WATERPROOFING ALONG THE ENTIRE LONGITUDINAL JOINT. THE MEMBRANE WATERPROOFING SEALING THE OPTIONAL CONST. JOINT IS INCIDENTAL TO THE CONCRETE MASONRY BID ITEM.

RUSTICATION DETAIL
 PROVIDE RUSTICATION IF OPT. CONST. JOINT IS USED.

LIQUID OR OTHER BOND BREAKER BETWEEN CAST-IN-PLACE CONCRETE AND CAST-IN-PLACE WALL PANEL.

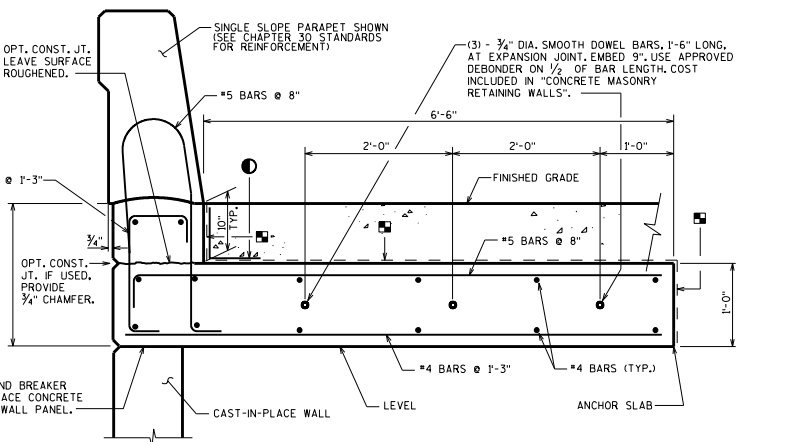

CAST-IN-PLACE CONCRETE TRAFFIC BARRIER DETAIL FOR CAST-IN-PLACE WALL PANELS

OPTIONAL CONSTRUCTION JOINTS IN THE PARAPET AND ANCHOR SLAB BETWEEN EXPANSION JOINTS MAY BE USED. RUN BAR REINFORCEMENT THRU THE JOINT. SEE STANDARDS 30.07, 30.12, 30.13 & 30.30-30.32 FOR MINIMUM LAP LENGTHS IN PARAPET BARS. DEFINE CONSTRUCTION JOINT WITH A 3/4" "V" GROOVE.


LAP LONGITUDINAL #4 BARS A MINIMUM OF 1'-0".
 ALL BAR STEEL SHALL BE EPOXY COATED.

CAST-IN-PLACE CONCRETE TRAFFIC BARRIER DETAIL FOR PRECAST WALL PANELS

OPTIONAL CONSTRUCTION JOINTS IN THE PARAPET AND ANCHOR SLAB BETWEEN EXPANSION JOINTS MAY BE USED. RUN BAR REINFORCEMENT THRU THE JOINT. SEE STANDARDS 30.07, 30.12, 30.13 & 30.30-30.32 FOR MINIMUM LAP LENGTHS IN PARAPET BARS. DEFINE CONSTRUCTION JOINT WITH A 3/4" "V" GROOVE.


LAP LONGITUDINAL #4 BARS A MINIMUM OF 1'-0".
 ALL BAR STEEL SHALL BE EPOXY COATED.

CONCRETE QUANTITY BASED ON 3" PANEL EMBEDMENT.

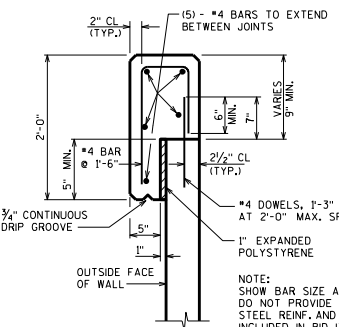

CAST-IN-PLACE CONCRETE COPING DETAIL


NOTE: CONCRETE COPING REINFORCING STEEL SHALL BE DESIGNED AT LOCATIONS WHERE RAILING, FENCING, OR ANY OTHER ATTACHMENTS ARE MADE.

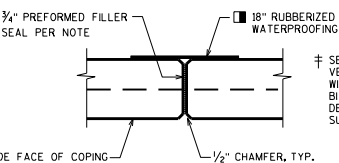


COPING EXPANSION JOINT

DO NOT RUN BAR STEEL THRU JOINT. MAX. SPACING OF JOINT = 50"

MEMBRANE WATERPROOFING TO EXTEND FROM TOP OF COPING TO 6" BELOW TOP OF PANELS.

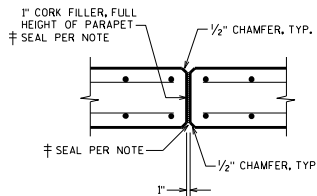


TRAFFIC BARRIER EXPANSION JOINT DETAIL

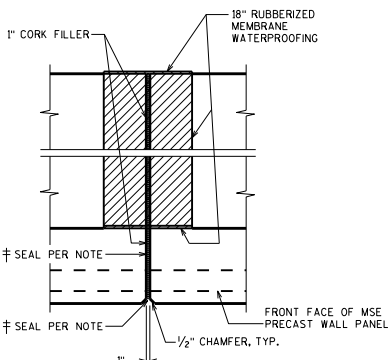


ANCHOR SLAB EXPANSION JOINT DETAIL

EXPANSION JOINTS TO BE SPACED AT A MINIMUM OF 20' AND A MAXIMUM OF 30'. LOCATE EXPANSION JOINTS OVER WALL JOINTS. DO NOT RUN BAR STEEL THRU JOINT, EXCEPT FOR DOWEL BARS. JOINT TO EXTEND FULL DEPTH OF PARAPET AND ANCHOR SLAB. PROVIDE THE NUMBER OF BARS AND OVERALL LENGTH FOR QUANTITY PURPOSES, ONLY. DO NOT DETAIL SPECIFIC BAR LENGTHS BETWEEN EXPANSION JOINTS AS THESE LENGTHS ARE BASED ON UNKNOWN MSE PANEL LENGTH AND CONFIGURATION.

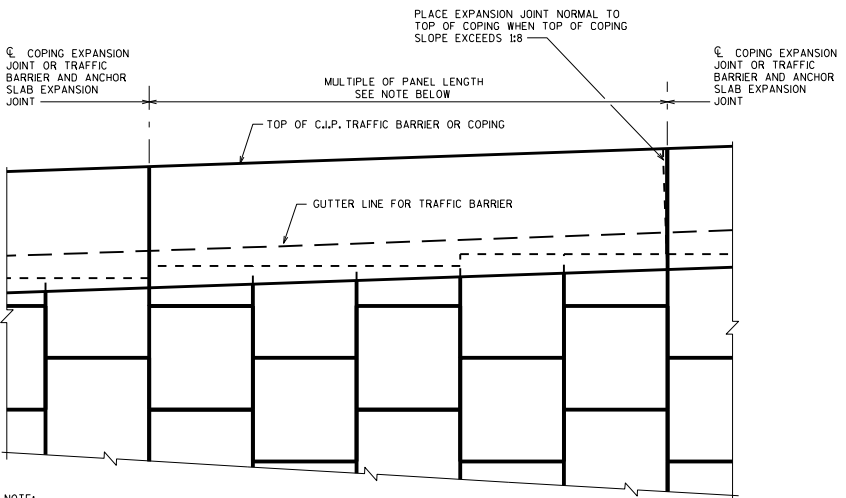

C.I.P. TRAFFIC BARRIER OR COPING PARTIAL ELEVATION

NOTE: ALL JOINTS SHALL BE LOCATED AS SHOWN ON WALL ELEVATIONS AND MUST COINCIDE WITH PANEL JOINT ON FRONT FACE.



COPING CONTRACTION JOINT

DO NOT RUN BAR STEEL THRU JOINT. MAX. SPACING OF JOINT = 12"

DESIGNER NOTES

MODIFIED ANCHOR SLAB DETAILS SHALL SATISFY AASHTO LRFD STRENGTH AND STABILITY REQUIREMENTS.

MSE RETAINING WALL DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

GENERAL NOTES

DRAWINGS SHALL NOT BE SCALED.

THE PLAN QUANTITY FOR THE BID ITEM (INSERT WALL SYSTEM) IS BASED ON A WALL HEIGHT MEASURED FROM THE TOP OF WALL TO A CONSTANT DEPTH OF (INSERT VALUE) BELOW FINISHED GRADE.

DESIGN DATA

THE CONTRACTOR SHALL PROVIDE COMPLETE DESIGN, PLANS, DETAILS, SPECIFICATIONS, AND SHOP DRAWINGS FOR THE RETAINING WALLS IN ACCORDANCE WITH THE SPECIAL PROVISIONS. THE RETAINING WALL MANUFACTURER SHALL PROVIDE TECHNICAL ASSISTANCE TO THE CONTRACTOR DURING CONSTRUCTION. THE COST OF FURNISHING THESE ITEMS SHALL BE INCLUDED IN THE BID ITEM "INSERT WALL SYSTEM OR SYSTEMS".

PLANS, ELEVATIONS AND DETAILS SHOWN ON THESE DRAWINGS ARE INTENDED TO INDICATE WALL LOCATIONS, LENGTHS, HEIGHTS, AND DETAILS COMMON TO THE WALL SYSTEM SELECTED. THE CONTRACTOR SHALL VERIFY THAT THE WALL SYSTEM SELECTED WILL CONFORM TO THE REQUIRED ALIGNMENTS AND DETAILS.

THE RETAINING WALL IS TO BE DESIGNED USING THE ELEVATIONS GIVEN ON THIS SHEET.

DESIGN FOR RETAINING WALL TO PROVIDE FOR FINISHED GRADE SLOPED BEHIND WALL AS SHOWN.

SEE SPECIAL PROVISIONS FOR AESTHETIC TREATMENT TO WALL.

DESIGN RETAINING WALL FOR A LIVE LOAD SURCHARGE OF (INSERT VALUE).

THE MAXIMUM VALUE OF THE ANGLE OF INTERNAL FRICTION OF THE WALL BACKFILL MATERIAL IN THE REINFORCED ZONE SHALL BE ASSUMED TO BE 30° WITHOUT CERTIFIED TEST VALUES.

DESIGNER NOTES

☐ THE LENGTHS PROVIDED IN THE TABLE ARE THE MINIMUM REQUIRED REINFORCEMENT LENGTHS BASED UPON THE MINIMUM DESCRIBED IN THE WALL SYSTEM SPECIAL PROVISIONS OR EXTERNAL AND OVERALL STABILITY AT THE DESIGNATED LOCATIONS. THESE DESIGNATED LOCATIONS REPRESENT TYPICAL AND CRITICAL WALL LOCATIONS, BUT SHALL NOT BE CONSIDERED ALL INCLUSIVE. THE CONTRACTOR DESIGN LENGTHS SHALL MEET OR EXCEED THE MINIMUM VALUES REPRESENTED IN THE TABLE AT THESE DESIGNATED LOCATIONS.

★ THE LENGTHS PROVIDED IN THE TABLE ARE THE MINIMUM REQUIRED REINFORCEMENT LENGTHS BASED ON OVERALL STABILITY PERFORMED BY THE WALL DESIGNER. COMPOUND STABILITY IS THE CONTRACTOR'S RESPONSIBILITY.

▲ MINIMUM EMBEDMENT BASED ON SITE SPECIFIC PARAMETERS (1'-6" MINIMUM FOR ALL WALLS ON LEVEL GROUND). FIELD EMBEDMENTS BELOW MINIMUM EMBEDMENT SHALL NOT BE INCLUDED IN THE PAY LIMITS.

● STRATUM LOCATIONS & SOIL DESCRIPTIONS AT EACH BORING LOCATION.

NOMINAL MSE PANEL DIMENSIONS ARE 5-FOOT HIGH AND 5-10 FOOT WIDE. THE WALL DESIGNER SHALL PROVIDE DETAILS BASED ON NOMINAL PANEL DIMENSIONS AND CONFIGURATION. DETAILS SHALL BE ABLE TO ACCOMMODATE VARIOUS PANEL DIMENSIONS. THE CONTRACTOR AND WALL SUPPLIER SHALL COORDINATE DETAILS BASED ON THE ACTUAL PANEL DIMENSIONS.

R N.E. RAMP

BEGIN WALL
STA. 185+75 N.E. RAMP
39.59' LT. =
STA. 0+00 WALL


PC STA. 1+11.51 WALL
= STA. 184+63.76 N.E. RAMP
31.54' LT.

EXAMPLE PLAN

CC STA. 184+60.53 N.E. RAMP
76.42' LT.

PT STA. 1+63.69 WALL
= STA. 184+21.45 N.E. RAMP
55.56' LT

END WALL
STA. 184+13 N.E. RAMP
74.49' LT. =
STA. 1+84.84 WALL

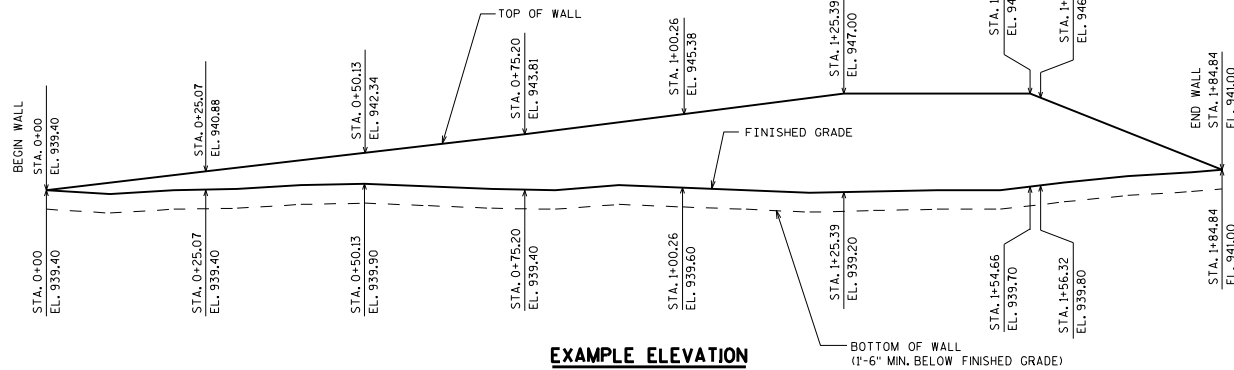

EXAMPLE ELEVATION

(LOOKING @ F.F. OF WALL)

GEOMETRY TABLE

WALL STATION	ROADWAY STATION	OFFSET TO F.F. WALL	TOP OF WALL ELEV.	FINISHED GRADE ELEV.


SOIL PARAMETERS

STRATUM LOCATIONS & SOIL DESCRIPTIONS	TOTAL UNIT WEIGHT (PCF)	FRICTION ANGLE (DEGREES)	COHESION (PCF)
GRANULAR BACKFILL (REINFORCING ZONE OR BACKFILL)			
(INSERT SOIL TYPE) RETAINED SOIL *			
(INSERT SOIL TYPE) FILL			
(INSERT SOIL TYPE)			
(INSERT SOIL TYPE)			

* DESIGN WALL FOR THESE VALUES

WALL EXTERNAL & OVERALL STABILITY EVALUATION

DIMENSIONS	EVALUATED LOCATIONS
WALL HEIGHT (FEET)	
EXPOSED WALL HEIGHT (FEET)	
MINIMUM LENGTH OF REINFORCEMENT (FEET) ☐	
WALL STATION	
BORING USED	
CAPACITY TO DEMAND RATIO (CDR)	
SLIDING (CDR>1.0)	
ECCENTRICITY (CDR>1.0)	
OVERALL STABILITY (CDR>1.0) ★	
BEARING RESISTANCE (CDR>1.0)	
FACTORED BEARING RESISTANCE (PSF)	

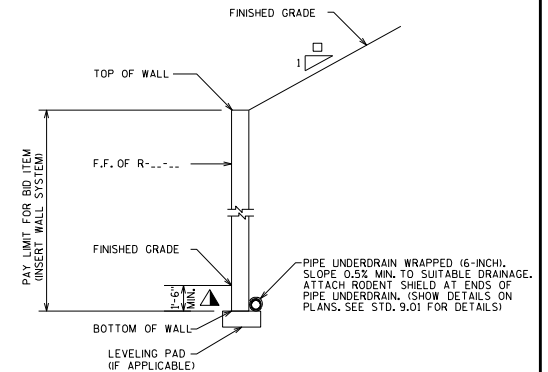

LIST OF DRAWINGS


- (INSERT WALL SYSTEM)
- SUBSURFACE EXPLORATION

LRFD PROPRIETARY RETAINING WALLS (GENERAL PLAN)


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

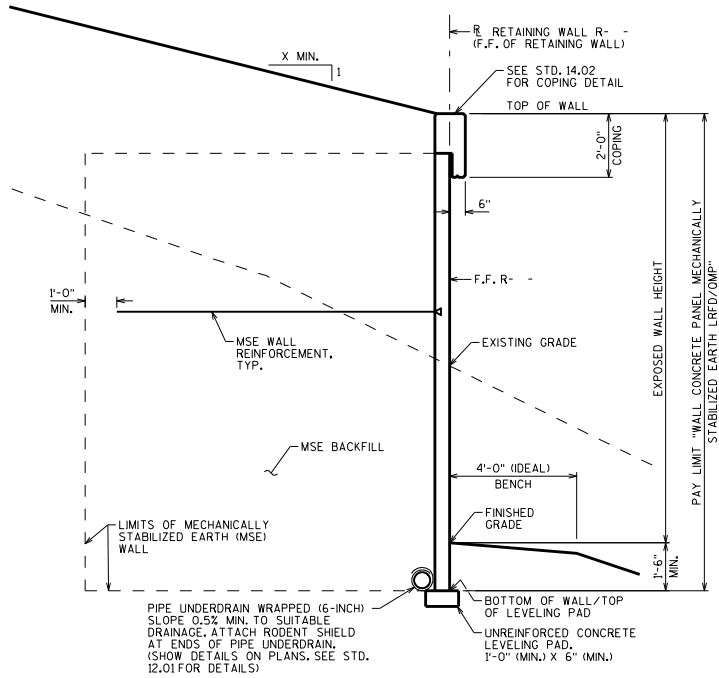

TYPICAL SECTION
(MSE WALL WITH CONCRETE PANEL FACING)

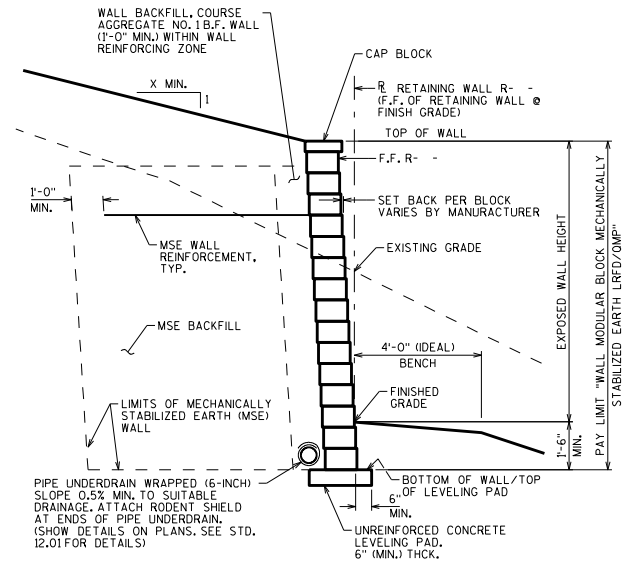


TYPICAL SECTION
(MSE WALL WITH MODULAR BLOCK FACING)


DESIGNER NOTE

SEE STANDARD 14.02 FOR ADDITIONAL INFORMATION

MSE WALL PANEL AND BLOCK FACING	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

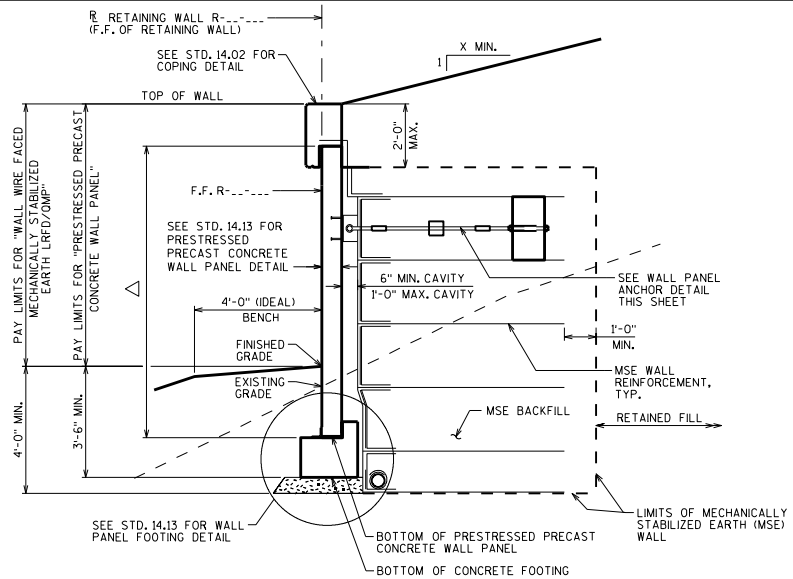

TYPICAL WALL SECTION WITH CAST-IN-PLACE CONCRETE COPING

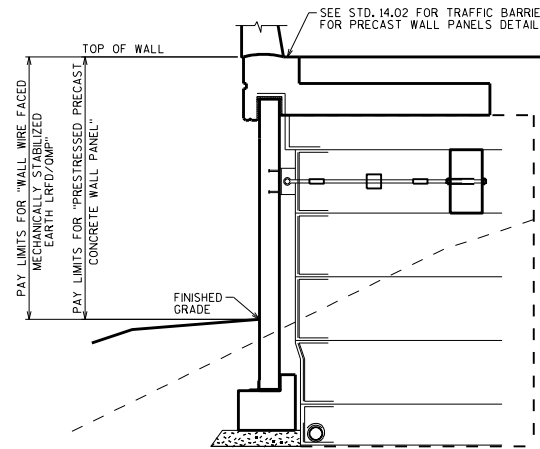

TYPICAL WALL SECTION WITH CAST-IN-PLACE CONCRETE TRAFFIC BARRIER

SEE TYPICAL WALL SECTION WITH CAST-IN-PLACE CONCRETE COPING DETAIL FOR ADDITIONAL INFORMATION

MATERIAL PROPERTIES

CONCRETE MASONRY RETAINING WALLS	$f'_c = 3,500$ PSI
PRESTRESSED PRECAST CONCRETE WALL PANEL	$f'_c = 5,000$ PSI
BAR STEEL REINFORCEMENT GRADE 60	$f_y = 60,000$ PSI
STRUCTURAL CARBON STEEL - ASTM A36	$f_y = 36,000$ PSI

NOTES

CLEVIS, CLEVIS PIN, COUPLER, MULTIDIRECTIONAL CONNECTOR, AND TURNBUCKLE TO BE CORROSION RESISTANT AND DEVELOP 125% OF THE ULTIMATE STRENGTH OF THE 1/4" DIAMETER ROD.

FORCES APPLIED TO THE DEADMAN ANCHOR MUST BE ACCOUNTED FOR IN THE DESIGN OF MSE REINFORCEMENT WHEN SATISFYING FORCE AND MOMENT EQUILIBRIUM.

DESIGNER NOTES

⊗ SHOW BAR SIZE AND SPACING ONLY. DO NOT PROVIDE BILL OF BARS. BAR STEEL REINFORCEMENT AND CONCRETE INCLUDED IN BID ITEM "PRESTRESSED PRECAST CONCRETE WALL PANEL".

△ WALL PANEL HEIGHT IS DEFINED AS THE LENGTH FROM THE TOP OF THE WALL PANEL TO THE TOP OF THE CONCRETE FOOTING. THE MAXIMUM ALLOWABLE WALL PANEL HEIGHT IS 30'.

LEGEND

■ CONTRACTOR TO DESIGN LENGTH TO PROVIDE REQUIRED HORIZONTAL CAPACITY OF ANCHOR ASSEMBLY. MINIMUM OF 3'-0" OF COMPACTED FILL IN FRONT OF DEADMAN ANCHOR PRIOR TO WALL PANEL ERECTION. 1/4" ROD TO BE 2'-0" MIN. BELOW TOP OF REINFORCED SOIL ZONE.

◆ CLEVIS TO BE INSTALLED TOWARDS THE TOP OF THE SLOTTED HOLE. TO ALLOW FOR SETTLEMENT OF THE WIRE FACED MSE WALL.

▲ OPTIONAL MULTIDIRECTIONAL CONNECTOR MAY BE USED TO FACILITATE ALIGNMENT AT THE CONNECTION.

● INCLUDES CONCRETE FOR COPING, FOOTING, AND DEADMAN ANCHOR.


Z SHAPED W.W.F. CLOSURE PANEL. EXTEND OVER PRESTRESSED PRECAST CONCRETE WALL PANEL

TOP OF PRESTRESSED PRECAST CONCRETE WALL PANEL

2'-0" MIN.


SEAL OPENING IN FILTER FABRIC WHERE ANCHOR COMPONENTS PENETRATE, AS DIRECTED BY THE ENGINEER.

F.F. OF PRESTRESSED PRECAST CONCRETE WALL PANEL

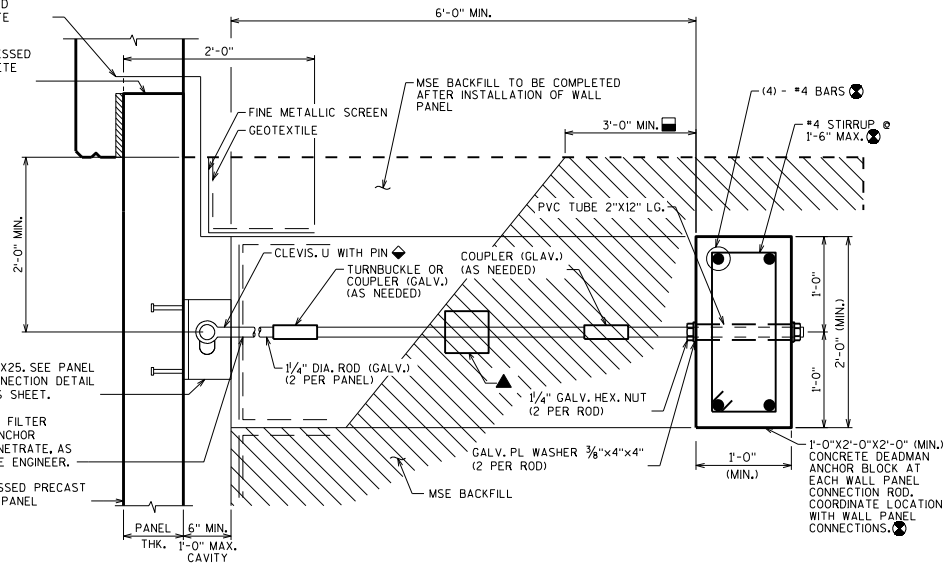

WALL PANEL ANCHOR DETAIL

CAST-IN-PLACE CONCRETE COPING SHOWN
CAST-IN-PLACE CONCRETE TRAFFIC BARRIER SIMILAR

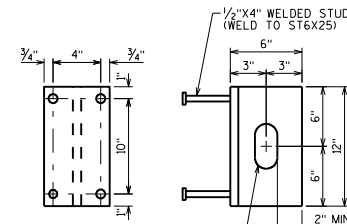

1 7/8" X 4" SLOTTED HOLE MAY BE FIELD DRILLED.

PANEL CONNECTION DETAIL

AS AN ALTERNATIVE, 1/2" (GALV.) ADHESIVE ANCHORS MAY BE USED TO AVOID AN OBSTRUCTION. ALTERNATIVE SHALL BE LIMITED TO ONE PANEL CONNECTION PER PANEL.


ST6X25 MAY BE WELDED TO 3/4" THICK PLATE WITH (4) 1/2" X 4" STUDS ANCHORED IN PRECAST CONCRETE PANEL. RESTORE ZINC COATING AROUND ANY WELDED AREAS. SUBMIT DETAILS FOR APPROVAL BY THE ENGINEER.

MSE WALL WIRE FACING 1

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

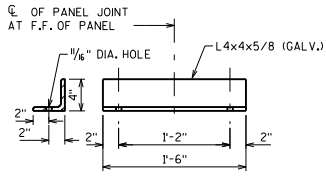


BASE ANGLE DETAIL

CENTERED ON PANEL JOINT OR AT EACH FOOTING END OR STEP ELEVATION.



WALL PANEL JOINT DETAIL

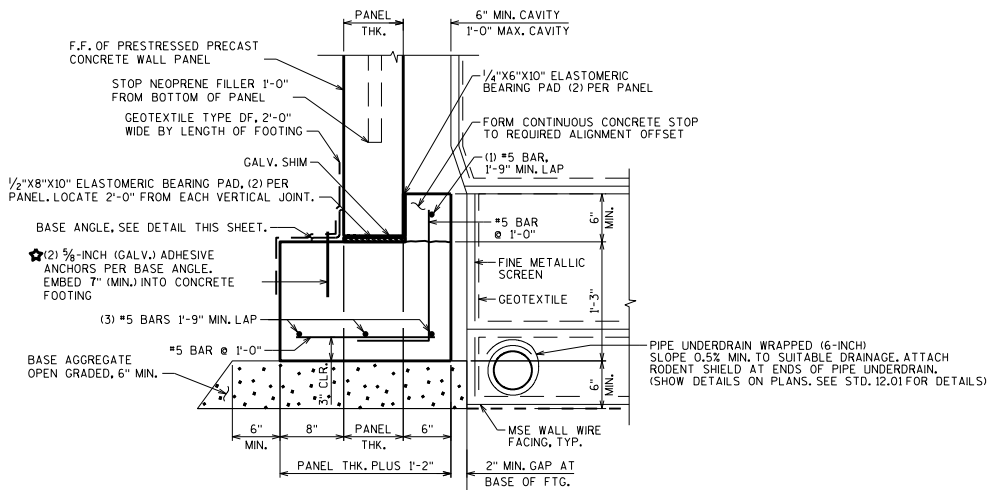


ALL ITEMS SHOWN ARE INCLUDED IN BID ITEM "PRESTRESSED PRECAST CONCRETE WALL PANEL"

ALL ITEMS SHOWN EXCEPT PIPE UNDERDRAIN ARE INCLUDED IN BID ITEM "WALL WIRE FACED MECHANICALLY STABILIZED EARTH LRF/D/OMP"


WALL PANEL FOOTING DETAIL

ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.12 OF THE STANDARD SPECIFICATIONS.

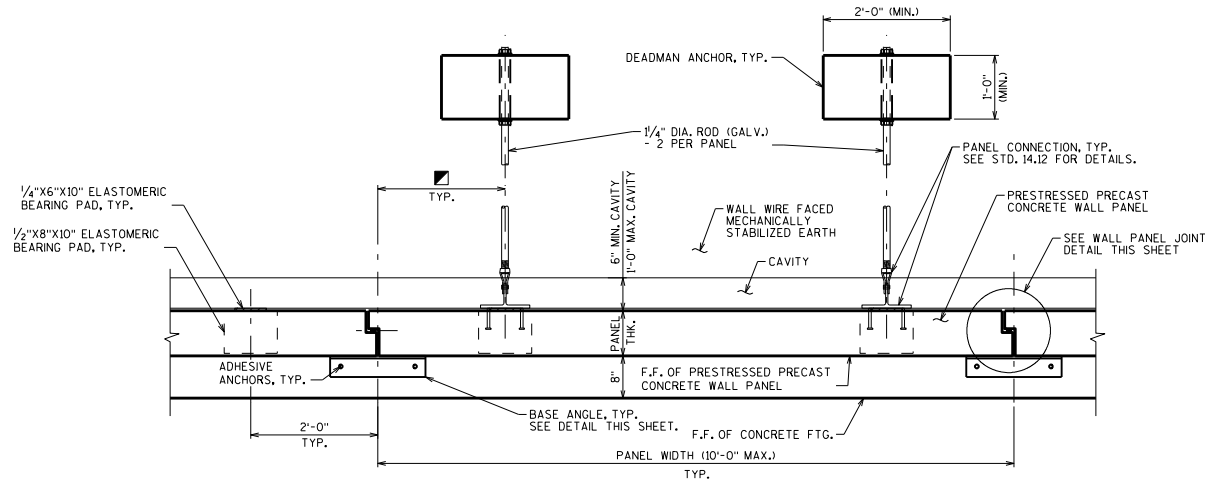

TYPICAL WALL PANEL CONNECTION - PLAN VIEW


ALL ITEMS SHOWN ARE INCLUDED IN BID ITEM "PRESTRESSED PRECAST CONCRETE WALL PANEL".

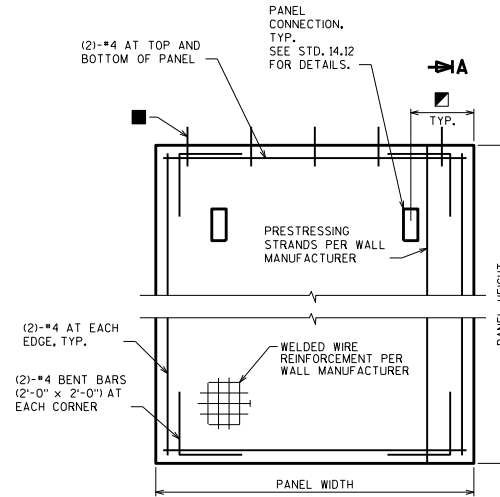

ELEVATION PRESTRESSED PRECAST CONCRETE WALL PANEL

DO NOT PROVIDE BILL OF BARS, BAR STEEL REINF. AND CONCRETE ARE INCLUDED IN BID ITEM "PRESTRESSED PRECAST CONCRETE WALL PANEL".

PRECAST PANELS 6 FEET OR LESS IN HEIGHT DO NOT REQUIRE PRESTRESSING STRANDS.

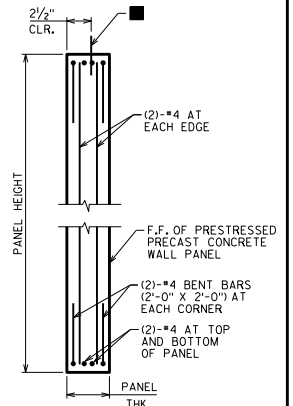

SECTION A-A

PRESTRESSING STRANDS NOT SHOWN FOR CLARITY.

DESIGNER NOTE

DOWELS REQUIRED FOR CAST-IN-PLACE CONCRETE COPING ONLY, IF CAST-IN-PLACE CONCRETE COPING PROPOSED, INCLUDE THE FOLLOWING NOTE:

#4 DOWELS, 1-3" LONG AT 2'-0" MAX. SPACING ALTERNATE ANCHORAGE: 1/2" DIA. ELECTROPLATED FERRULE LOOP INSERT (MEDIUM HIGH CARBON WIRE) OR APPROVED EQUAL.

LEGEND



USE 2'-0" ON 10'-0" PANELS
USE 1'-0" ON PANELS LESS THAN 10'-0".

MSE WALL WIRE FACING 2


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*


DATE:
7-16

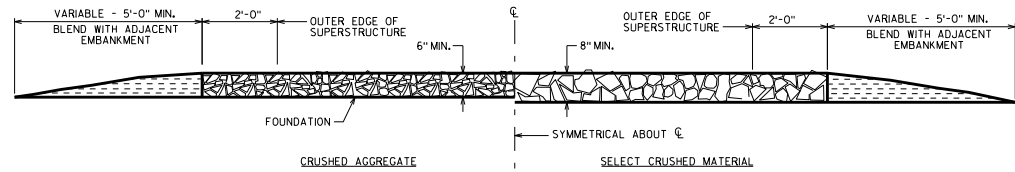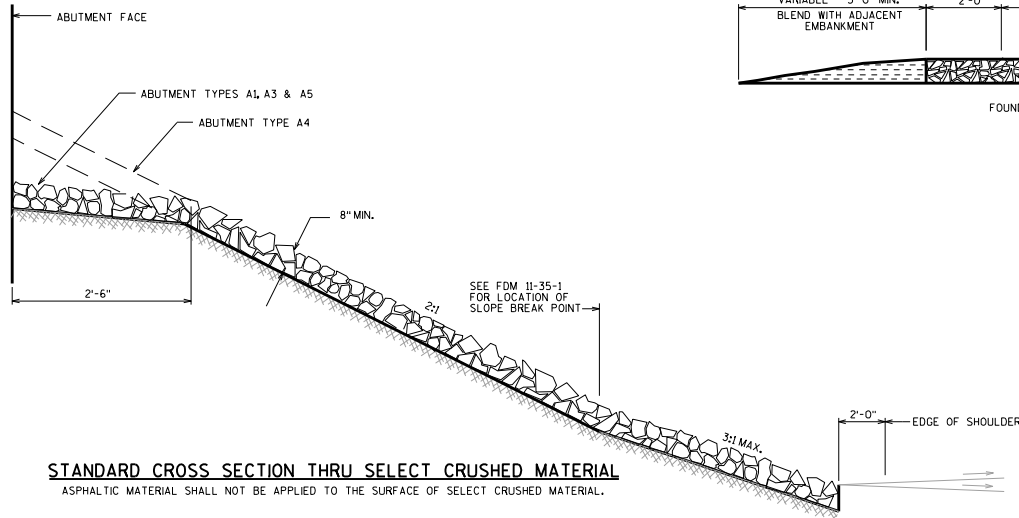

SECTION A-A

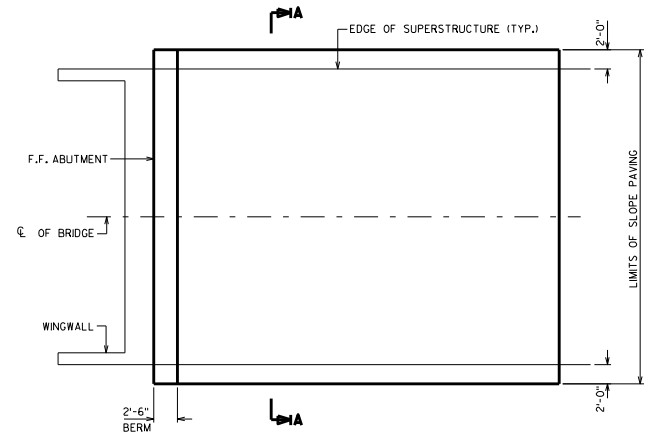

PLAN

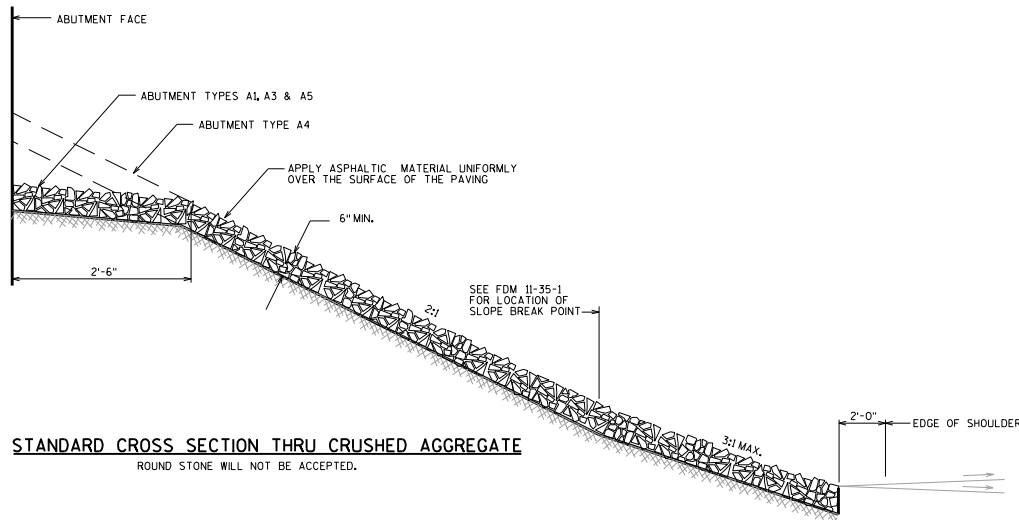

NOTES

DETAILS OF CONSTRUCTION, MATERIALS AND WORKMANSHIP NOT SHOWN ON THIS DRAWING SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE STANDARD SPECIFICATIONS.

WOOD FORMS MAY BE LEFT IN PLACE WHEN OF A QUALITY ACCEPTABLE TO THE ENGINEER.


PREFERRED SECTION SHOWN FOR ALTERNATE SECTION SEE FDM 11-35-1.

SLOPE PAVING - STRUCTURES (CRUSHED AGGREGATE & SELECT CRUSHED MATERIAL)


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*


DATE:
7-16

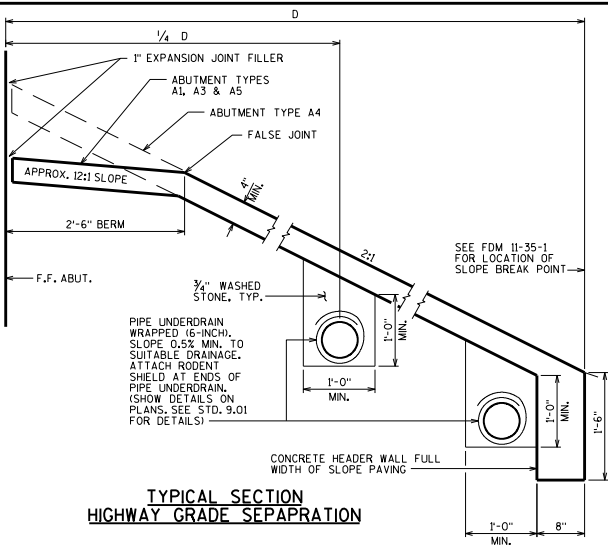


**TYPICAL SECTION
HIGHWAY GRADE SEPARATION**

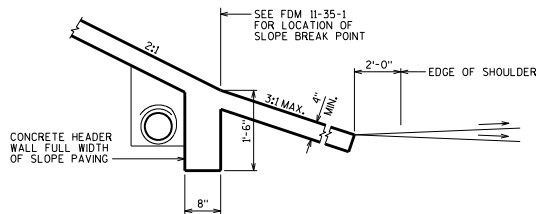


**ALT. SECTION @ SHOULDER
(RURAL ROADWAY)**

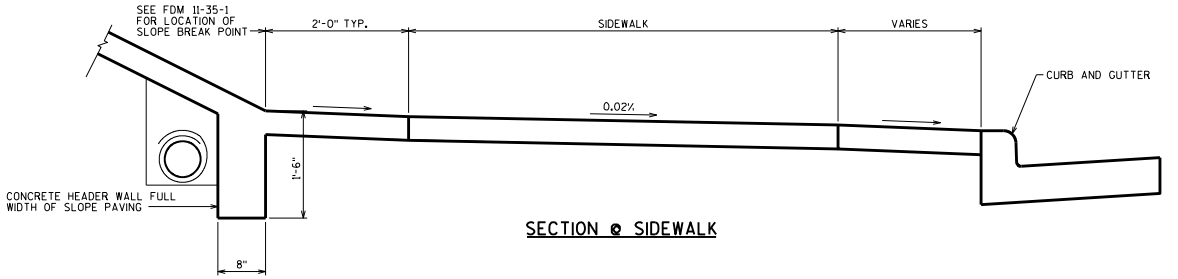


SECTION @ SIDEWALK

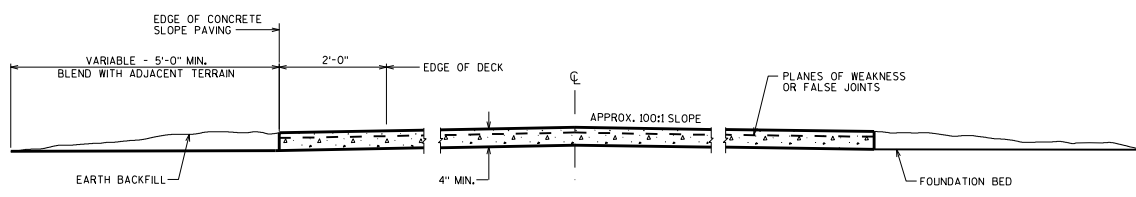

SECTION A-A

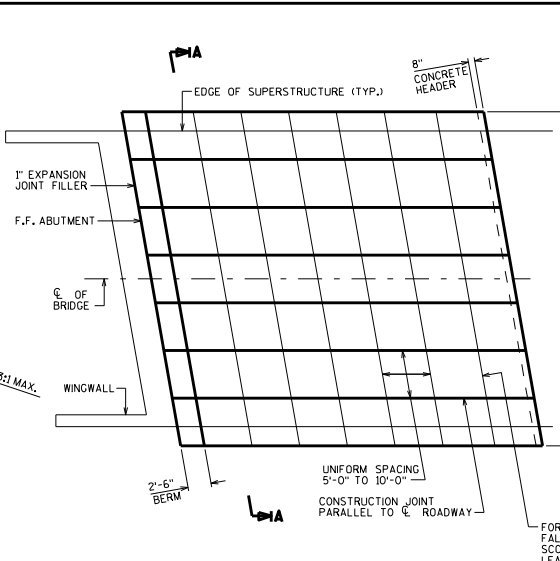


0° - 15° SKEW

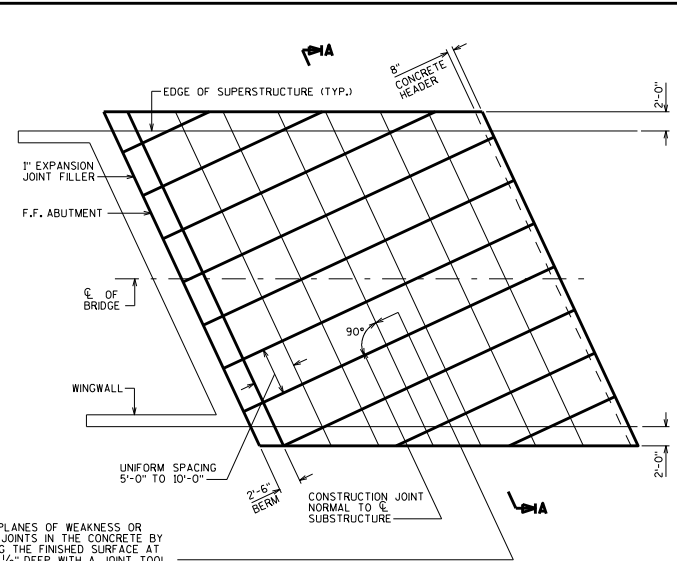

> 15° SKEW

**PLAN
(TYPICAL SECTION SHOWN)**

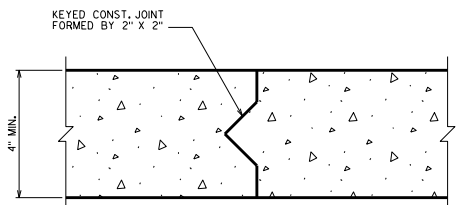

CONSTRUCTION JOINT DETAIL


NOTES
 DETAILS OF CONSTRUCTION NOT SHOWN HEREIN SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE STANDARD SPECIFICATIONS

**SLOPE PAVING - STRUCTURES
(CONCRETE CAST-IN-PLACE)**

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
 7-16

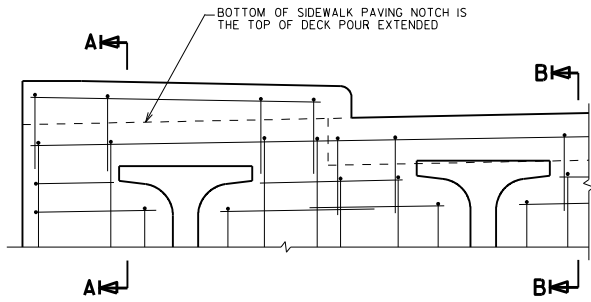

**PART TRANSVERSE SECTION AT ABUTMENT
TYPE A1 DIAPHRAGM WITH A RAISED SIDEWALK**

(HORIZ. BARS SHOWN ARE THE FF BARS.
DECK REINFORCEMENT NOT SHOWN FOR CLARITY.)

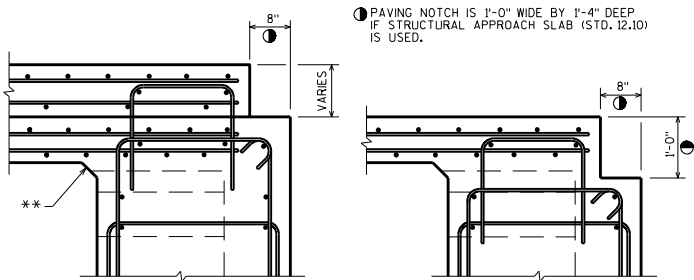


SECTION A-A

** 3" X 3" BEVEL ENDS AT EDGE OF BRIDGE DECK

SECTION B-B


- SEE STANDARDS 19.33, 19.34, 19.35 FOR REINFORCEMENT DETAILS
- DETAILS SHOWN ARE FOR GIRDER STRUCTURES. SIMILAR REINFORCEMENT FOR SLAB STRUCTURES SHALL BE USED WITH A REMINDER THAT THE TRANSVERSE AND LONGITUDINAL REINFORCEMENT LAYERS ARE REVERSED.

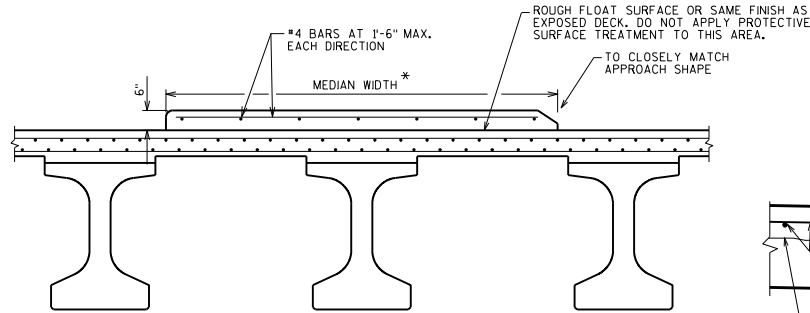

CROSS SECTION THRU UNANCHORED MEDIAN


* (ANCHORAGE TO DECK NOT REQUIRED FOR WIDTHS > 3'-0", EXCEPT ALL MEDIAN SECTIONS ON TOP OF PAVING BLOCK MUST BE ANCHORED)

NOTE: CLEAN ALL LOOSE MATERIAL ON THE DECK AT THE MEDIAN LOCATION PRIOR TO MEDIAN PLACEMENT USING HIGH PRESSURE WATER OR AIR, ENSURING ALL FREE-STANDING WATER IS REMOVED PRIOR TO MEDIAN PLACEMENT. NEAT CEMENT IS REQUIRED AS PER 509.3.9.2 OF THE STANDARD SPECIFICATIONS UNLESS THE MEDIAN IS POURED WITHIN 45 DAYS OF COMPLETING THE DECK POUR.

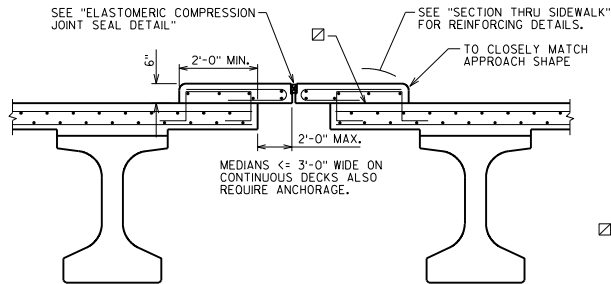


CROSS SECTION THRU MEDIAN WITH A JOINT

MEDIANS <= 3'-0" WIDE ON CONTINUOUS DECKS ALSO REQUIRE ANCHORAGE.

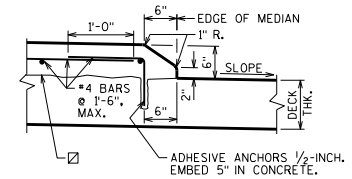


ANCHORED MEDIAN CURB DETAIL

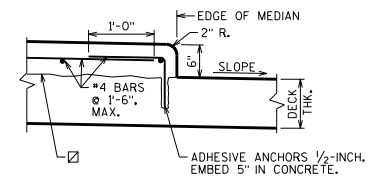


ANCHORED MEDIAN CURB DETAIL

CONST. JOINT-STRIKE OFF AS SHOWN AND LEAVE ROUGH. FOR DECK POUR, MATCH BRIDGE X-SLOPE.

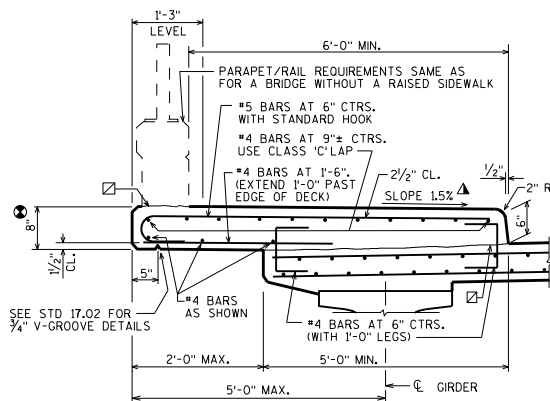

SECTION THRU SIDEWALK

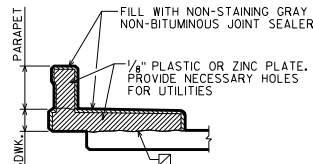

DEFLECTION JOINT DETAIL

SHOW DEFLECTION JOINT IN PARAPET OR SIDEWALK USING THE FOLLOWING CRITERIA:

1. GIRDER STRUCTURES AND SLAB STRUCTURES WITH A RAISED SIDEWALK SHOULD HAVE A DEFLECTION JOINT IN THE SIDEWALK AND PARAPET OVER THE PIER. FOR SKEWS GREATER THAN 20°, DETAIL THE JOINT NORMAL TO THE SIDEWALK AND PARAPET WITH THE JOINT APPROX. CENTERED OVER \bar{C} PIER.
2. GIRDER STRUCTURES AND SLAB STRUCTURES WITHOUT SIDEWALKS SHOULD HAVE NO DEFLECTION JOINTS IN THE PARAPETS.

NOTES


WHEN PARAPETS ARE POURED CONTINUOUSLY FROM END TO END, THEY SHALL BE SEPARATED AT THE DEFLECTION JOINTS BY A PIECE OF 1/4" ZINC OR PLASTIC PLATE CUT AS SHOWN IN THE "DEFLECTION JOINT DETAIL". IF CONSTRUCTION JOINTS IN PARAPETS ARE USED AT THE DEFLECTION JOINTS, ONE SIDE OF JOINT SHALL BE COATED WITH AN APPROVED LIQUID BOND BREAKER AND PLATE SEPARATORS MAY BE OMITTED.

- CONST. JOINT-STRIKE OFF AS SHOWN AND LEAVE ROUGH. FOR DECK POUR, MATCH BRIDGE X-SLOPE.
- 8" MIN. SIDEWALK THICKNESS ALSO REQ'D AT EDGE OF DECK/SLAB.
- ±0.5% CONSTRUCTION TOLERANCE IN SIDEWALK CROSS SLOPE. THE SIDEWALK CROSS SLOPE SHALL NOT EXCEED 2% WITHOUT PRIOR APPROVAL FROM THE ENGINEER.

DESIGNER NOTES

FOR EXTREME SIDEWALK WIDTHS AND/OR SUPERELEVATIONS THE DECK MAY BE LEVEL BENEATH THE SIDEWALK (MAINTAIN CONSTANT DECK THICKNESS) TO REDUCE EXCESSIVE SIDEWALK THICKNESS.

SEE STD. 24.11 FOR DECK JOINT DETAIL FOR LONGITUDINAL AND TRANSVERSE JOINTS.

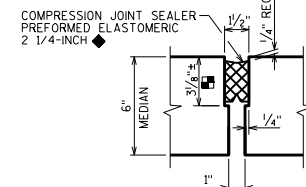

ELASTOMERIC COMPRESSION SEAL DETAIL


- VARIABLES BASED ON JOINT MANUFACTURER
- MANUFACTURER SHALL LABEL TOP OF SEAL

MEDIAN AND RAISED SIDEWALK DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

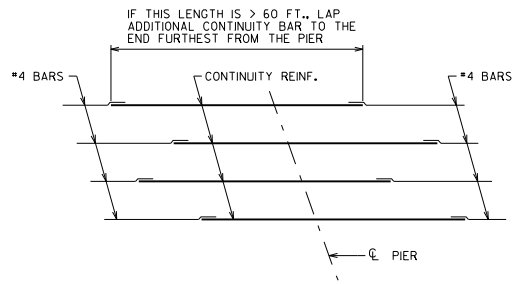


PLAN VIEW OF DECK CONTINUITY REINFORCEMENT FOR PRESTRESSED GIRDER BRIDGES
(SHOWING TYPICAL BAR SPACING FROM CHAPTER 17 TABLES)

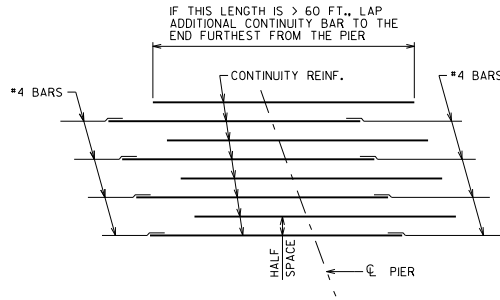


PLAN VIEW OF DECK CONTINUITY REINFORCEMENT FOR PRESTRESSED GIRDER BRIDGES SHOWING HALF-SPACES
(SHOWING TYPICAL BAR SPACING FROM CHAPTER 17 TABLES + HALF-SPACE)

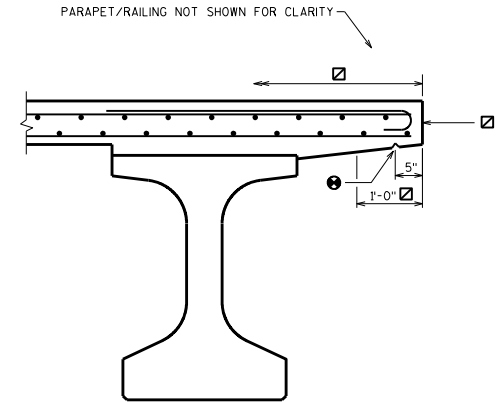

CROSS SECTION THRU EDGE OF DECK
(SHOWING DRIP GROOVE FOR ALL PARAPET AND RAILINGS, AND PROTECTIVE SURFACE TREATMENT FOR OPEN RAILINGS)

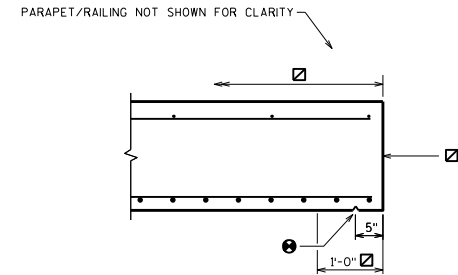

CROSS SECTION THRU EDGE OF SLAB
(SHOWING DRIP GROOVE FOR ALL PARAPET AND RAILINGS, AND PROTECTIVE SURFACE TREATMENT FOR OPEN RAILINGS)

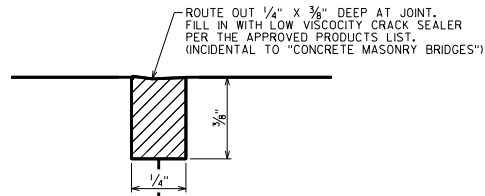


LONGITUDINAL CONSTRUCTION JOINT DETAIL


DESIGNER NOTES

DETAIL REQUIRED WHEN WIDTH OF DECK EXCEEDS 90 FEET FOR GIRDER SUPERSTRUCTURES AND 52 FEET FOR SLAB SUPERSTRUCTURES. DETAIL SHOULD BE USED FOR STAGED CONSTRUCTION AND FOR OTHER COLD JOINT APPLICATIONS WITHIN THE DECK. OPTIONAL (CONTRACTOR) JOINTS ARE TO BE APPROVED BY THE ENGINEER.

JOINTS SHOULD BE PLACED AT LEAST 6 INCHES FROM THE EDGE OF THE TOP FLANGE OF THE GIRDER AND PREFERABLY LOCATED BENEATH THE MEDIAN OR PARAPET. AVOID PLACING NEAR WHEEL PATHS (PLACE AT LANE LINES OR IN THE MIDDLE OF THE LANE).

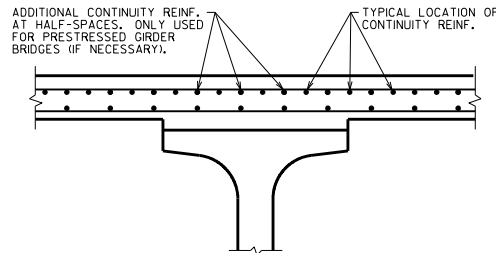


CROSS SECTION THRU DECK
(SHOWING TOP LONGIT. REINF. LOCATION RELATIVE TO BOTTOM LONGIT. REINF.)

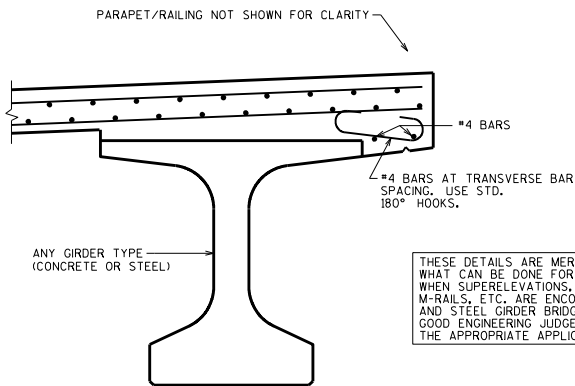

CROSS SECTION THRU EDGE OF DECK
(SHOWING ADDITIONAL OVERHANG REINFORCEMENT)

THESE DETAILS ARE MERELY REPRESENTATIVE OF WHAT CAN BE DONE FOR OVERHANG REINFORCEMENT WHEN SUPERELEVATIONS, EXCESSIVE HAUNCHES, M-RAILS, ETC. ARE ENCOUNTERED ON PRESTRESSED AND STEEL GIRDER BRIDGE DECKS. USE GOOD ENGINEERING JUDGEMENT IN DETERMINING THE APPROPRIATE APPLICATION.

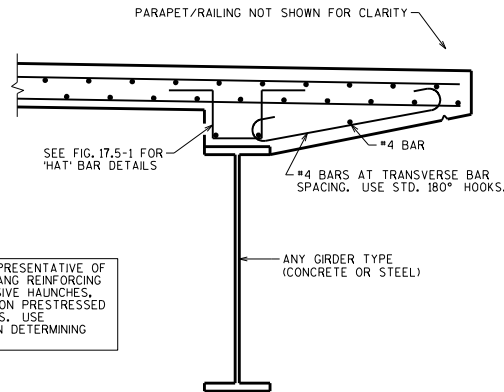

CROSS SECTION THRU EDGE OF DECK
(SHOWING ADDITIONAL OVERHANG REINFORCEMENT)

DESIGNER NOTES

- 3/4" V-GROOVE. TERMINATE 2'-0" FROM FRONT FACE OF EXPANSION ABUTMENTS, OR FIXED ABUTMENTS ON STEEL BEARINGS.
- 3/4" V-GROOVE. EXTEND V-GROOVE TO 6" FROM FRONT FACE OF ABUTMENT DIAPHRAGM FOR TYPE A1 FIXED AND SEMI-EXPANSION ABUTMENTS.
- V-GROOVES ARE REQUIRED.

NOTES

- 3/4" V-GROOVE REO'D. EXTEND TO 2'-0" FROM F.F. OF ABUT.
- 3/4" V-GROOVE REO'D. EXTEND TO 6" FROM F.F. OF ABUT. DIAPH.

- ☑ FOR OPEN RAILINGS, COAT WITH "PROTECTIVE SURFACE TREATMENT" AS PER THE STANDARD SPECIFICATIONS. PROTECTIVE SURFACE TREATMENT TO BE APPLIED TO THE TOP AND EXTERIOR EXPOSED FACE OF WINGS, AND THE END 1'-0" OF THE FRONT FACE OF ABUTMENT.


- ☑ COAT WITH "PROTECTIVE SURFACE TREATMENT" AS PER THE STANDARD SPECIFICATIONS.

DECK AND SLAB DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16




8 STRANDS




10 STRANDS




12 STRANDS



14 STRANDS



*16 STRANDS




*18 STRANDS


* NEEDS BOND BREAKERS AT ENDS. SEE BOND BREAKER DETAIL.

⊙ INDICATES STRAND TO BE DEBONDED


STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.6" DIA. STRANDS
(0.5" DIA. STRANDS MAY ALSO BE USED)




8 STRANDS




10 STRANDS




12 STRANDS



14 STRANDS



16 STRANDS



18 STRANDS

ARRANGEMENT AT $\frac{1}{4}$ SPAN - FOR GIRDERS WITH DRAPED 0.5" DIA. STRANDS

28" GIRDER


A = 312 SQ. IN.
 $r^2 = 91.95 \text{ IN.}^2$
 $y_t = 14.58 \text{ IN.}$
 $y_b = -13.42 \text{ IN.}$
 $I = 28,687 \text{ IN.}^4$
 $S_t = 1,968 \text{ IN.}^3$
 $S_b = -2,138 \text{ IN.}^3$
 WT. = 325 #/FT.

PRE-TENSION

$f_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands
 $P_i \text{ PER } 0.5" \text{ DIA. STRAND} = 0.1531 \times 202,500 = \underline{31.00 \text{ KIPS}}$
 $P_i \text{ PER } 0.6" \text{ DIA. STRAND} = 0.217 \times 202,500 = \underline{43.94 \text{ KIPS}}$
 $\frac{y_b}{r^2} = \frac{-13.42}{91.95} = -0.1459 \text{ IN./IN.}^2$
 $f_b (\text{init.}) = \frac{A_s f_s}{A} (1 + \frac{e_s y_b}{r^2})$

(COMPRESSION IS POSITIVE)

NO. STRANDS	e_s (inches)	$P(\text{init.}) = A_s f_s$ (KIPS)	$f_b (\text{init.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS (0.6" DIA.)			
8	-10.40	352	2.841
10	-9.80	439	3.419
12	-8.73	527	3.841
14	-7.97	615	4.264
*16	-9.4	703	5.345
*18	-9.6	791	6.087
STANDARD STRAND PATTERNS FOR DRAPED STRANDS (0.5" DIA.)			
8	-10.4	248	2.001
10	-10.6	310	2.531
12	-10.4	372	3.002
14	-10.0	434	3.421
16	-9.4	496	3.771
18	-9.6	558	4.294

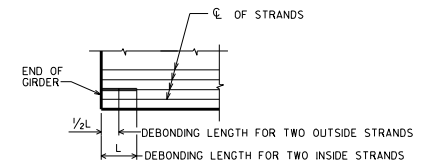

BOND BREAKER DETAIL

SHOWING LENGTHS OF DEBONDING FROM END OF GIRDER. DEBOND LENGTHS TO BE DESIGNED. STRAND TRANSFER LENGTH IS 60 X STRAND DIAMETER.

DESIGNER NOTES


ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

28" PRESTRESSED GIRDER DESIGN DATA


STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

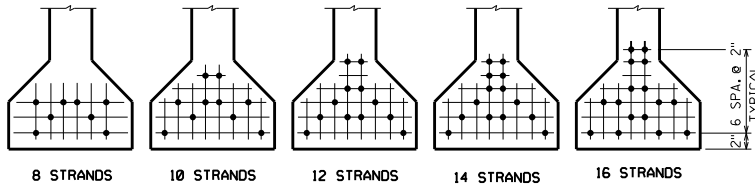

**STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY
TO AVOID DRAPING OF 0.6" DIA. STRANDS**
(0.5" DIA. STRANDS MAY ALSO BE USED)

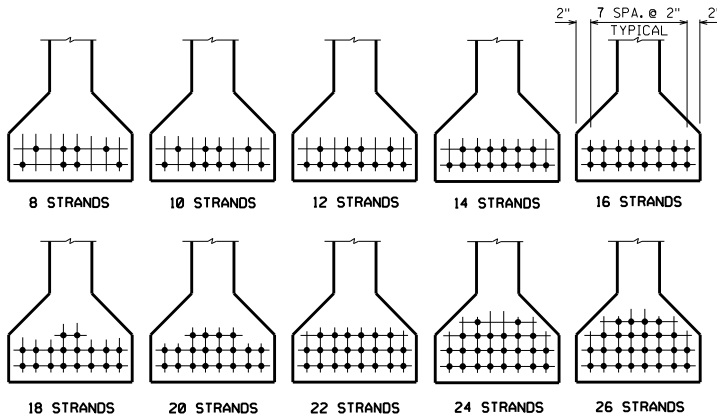

ARRANGEMENT AT $\frac{L}{4}$ SPAN - FOR GIRDERS WITH DRAPED 0.5" DIA. STRANDS

36" GIRDER

A = 369 SQ. IN.
 $r^2 = 138.15 \text{ IN.}^2$
 $y_T = 20.17 \text{ IN.}$
 $y_B = -15.83 \text{ IN.}$
 $I = 50,979 \text{ IN.}^4$
 $S_T = 2,527 \text{ IN.}^3$
 $S_B = -3,220 \text{ IN.}^3$
 WT. = 384 #/FT.

PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands
 PI PER 0.5" DIA. STRAND = $0.1531 \times 202,500 = 31.00 \text{ KIPS}$
 PI PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94 \text{ KIPS}$
 $\frac{y_B}{r^2} = \frac{-15.83}{138.15} = -0.1146 \text{ IN./IN.}^2$
 $f_b (\text{init.}) = \frac{A_s f_s}{A} (1 + \frac{e_s y_B}{r^2})$

(COMPRESSION IS POSITIVE)

NO. STRANDS	e_s (inches)	$P(\text{init.}) = A_s f_s$ (KIPS)	$f_b (\text{init.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS (0.6" DIA.)			
8	-11.33	352	2.192
10	-10.23	439	2.584
12	-9.83	527	3.036
14	-9.26	615	3.435
16	-9.08	703	3.887
STANDARD STRAND PATTERNS FOR DRAPED STRANDS (0.5" DIA.)			
8	-12.83	248	1.660
10	-13.03	310	2.094
12	-13.16	372	2.528
14	-12.97	434	2.924
16	-12.83	496	3.320
18	-12.50	558	3.678
20	-12.23	620	4.034
22	-12.01	682	4.392
24	-11.66	744	4.710
26	-11.37	806	5.030

DESIGNER NOTES

ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

**36" PRESTRESSED GIRDER
DESIGN DATA**

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

36W" GIRDER

A = 632 SQ. IN.
 $r^2 = 158.20 \text{ IN.}^2$
 $y_T = 19.37 \text{ IN.}$
 $y_B = -16.63 \text{ IN.}$
 $I = 99,980 \text{ IN.}^4$
 $S_T = 5,162 \text{ IN.}^3$
 $S_B = -6,012 \text{ IN.}^3$
 WT. = 658 #/FT.


PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands


Pi PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94 \text{ KIPS}$

$$\frac{y_B}{r^2} = \frac{-16.63}{158.20} = -0.10512 \text{ in/in}^2$$

$$f_B (\text{ini.}) = \frac{A_s f_s}{A} (1 + \frac{e_s y_B}{r^2})$$

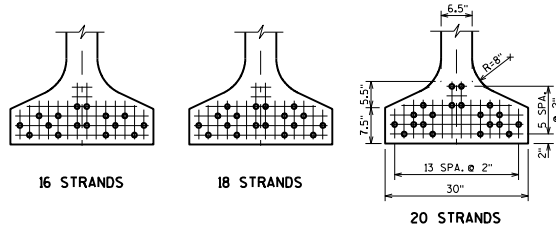

STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.6" DIA. STRANDS

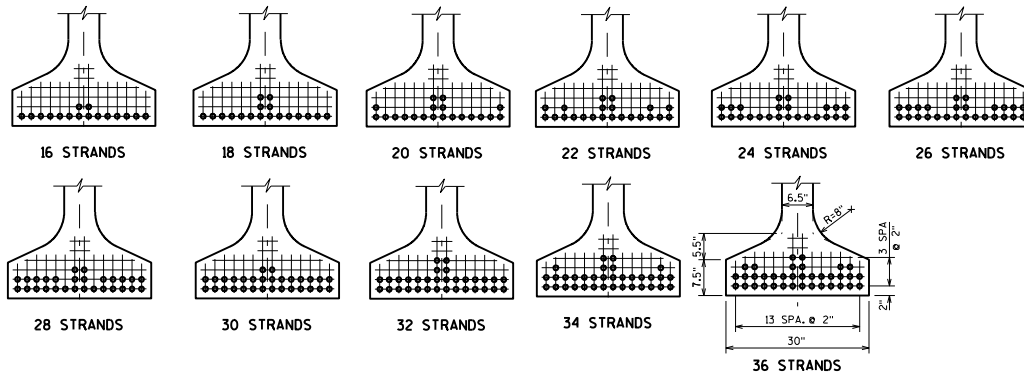

ARRANGEMENT AT C_L SPAN - FOR GIRDERS WITH DRAPED 0.6" DIA. STRANDS

(COMPRESSION IS POSITIVE)

NO. STRANDS	e_s (inches)	$P(\text{ini.}) = A_s f_s$ (KIPS)	$f_B (\text{ini.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS			
16	-12.13	703	2.531
18	-11.74	791	2.796
20	-11.03	879	3.003
STANDARD STRAND PATTERNS FOR DRAPED STRANDS			
16	-14.38	703	2.794
18	-13.96	791	3.088
20	-13.83	879	3.413
22	-13.72	967	3.737
24	-13.63	1055	4.061
26	-13.55	1143	4.385
28	-13.49	1230	4.706
30	-13.43	1318	5.030
32	-13.13	1406	5.295
34	-12.98	1494	5.589
36	-12.85	1582	5.885

DESIGNER NOTES


ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

36W" PRESTRESSED GIRDER DESIGN DATA

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

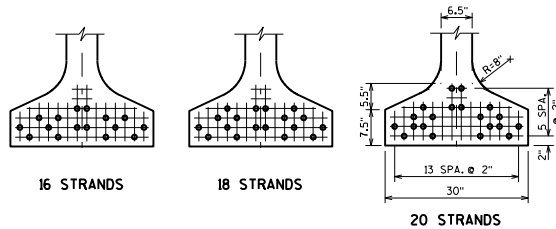

**STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY
TO AVOID DRAPING OF 0.6" DIA. STRANDS**

45W" GIRDER

A = 692 SQ. IN.
 $r^2 = 258.70 \text{ IN.}^2$
 $y_T = 24.26 \text{ IN.}$
 $y_B = -20.74 \text{ IN.}$
 $I = 178,971 \text{ IN.}^4$
 $S_T = 7,377 \text{ IN.}^3$
 $S_B = -8,629 \text{ IN.}^3$
 WT. = 721 #/FT.


PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands

Pi PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94 \text{ KIPS}$

$$\frac{y_B}{r^2} = \frac{-20.74}{258.70} = -0.08017 \text{ in/in}^2$$

$$f_B (\text{ini.}) = \frac{A_s f_s}{A} (1 + e_s \frac{y_B}{r^2})$$

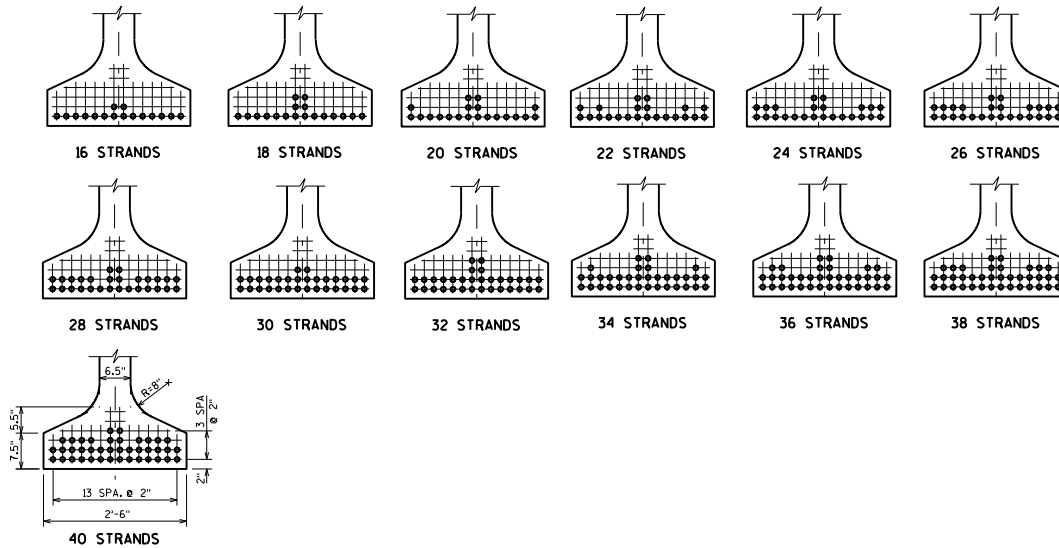

ARRANGEMENT AT C/4 SPAN - FOR GIRDERS WITH DRAPED 0.6" DIA. STRANDS

(COMPRESSION IS POSITIVE)

NO. STRANDS	e_s (inches)	$P(\text{ini.}) = A_s f_s$ (KIPS)	$f_B (\text{ini.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS			
16	-16.24	703	2.339
18	-15.85	791	2.596
20	-15.14	879	2.812
STANDARD STRAND PATTERNS FOR DRAPED STRANDS			
16	-18.49	703	2.521
18	-18.07	791	2.799
20	-17.94	879	3.097
22	-17.83	967	3.394
24	-17.74	1055	3.693
26	-17.66	1143	3.991
28	-17.60	1230	4.285
30	-17.54	1318	4.583
32	-17.24	1406	4.840
34	-17.09	1494	5.117
36	-16.96	1582	5.395
38	-16.85	1670	5.674
40	-16.74	1758	5.950

DESIGNER NOTES

ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

**45W" PRESTRESSED GIRDER
DESIGN DATA**

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

54W GIRDER

A = 798 SQ. IN.
 $r^2 = 402.41 \text{ IN.}^2$
 $y_T = 27.70 \text{ IN.}$
 $y_B = -26.30 \text{ IN.}$
 $I = 321,049 \text{ IN.}^4$
 $S_T = 11,592 \text{ IN.}^3$
 $S_B = -12,205 \text{ IN.}^3$
 WT. = 831 #/FT.


PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands


Pi PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94 \text{ KIPS}$

$$\frac{y_B}{r^2} = \frac{-26.30}{402.41} = -0.06536 \text{ in/in}^2$$

$$f_B (\text{ini.}) = \frac{A_s f_s}{A} (1 + \frac{e_s y_B}{r^2})$$

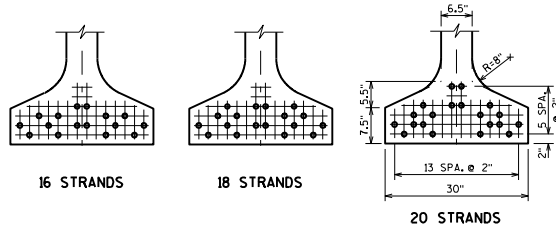

STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.6" DIA. STRANDS

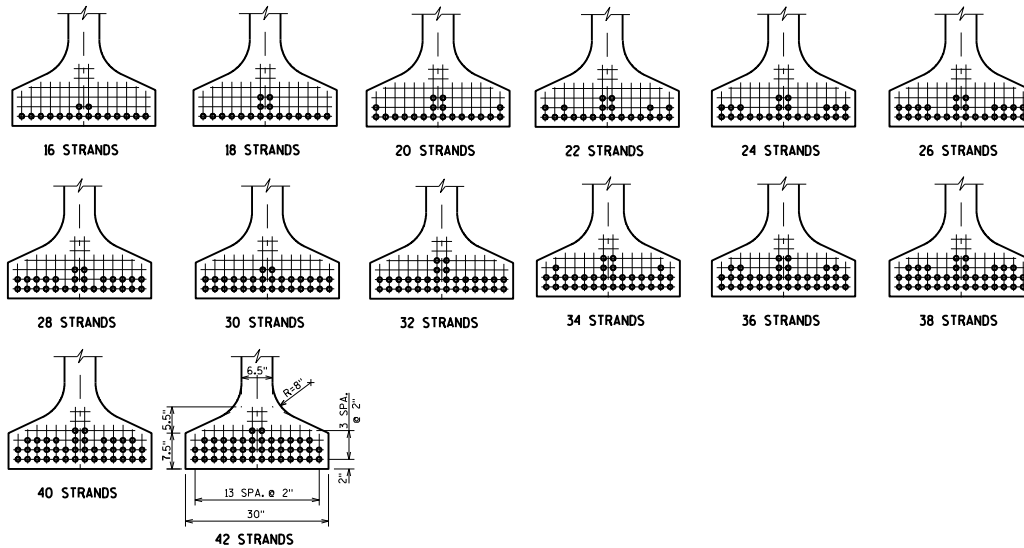

ARRANGEMENT AT C/SPAN - FOR GIRDERS WITH DRAPED 0.6" DIA. STRANDS

DESIGNER NOTES

ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

(COMPRESSION IS POSITIVE)

NO. STRANDS	e_s (inches)	$P(\text{ini.}) = A_s f_s$ (KIPS)	$f_B (\text{ini.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS			
16	-21.80	703	2.136
18	-21.41	791	2.378
20	-20.70	879	2.592
STANDARD STRAND PATTERNS FOR DRAPED STRANDS			
16	-24.05	703	2.266
18	-23.63	791	2.522
20	-23.50	879	2.793
22	-23.39	967	3.065
24	-23.30	1055	3.336
26	-23.22	1143	3.607
28	-23.16	1230	3.875
30	-23.10	1318	4.146
32	-22.80	1406	4.387
34	-22.65	1494	4.643
36	-22.52	1582	4.901
38	-22.41	1670	5.159
40	-22.30	1758	5.413
42	-22.20	1846	5.670

54W PRESTRESSED GIRDER DESIGN DATA

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

72" GIRDER

A = 915 SQ. IN.
 $r^2 = 717.5 \text{ IN.}^2$
 $y_T = 37.13 \text{ IN.}$
 $y_B = -34.87 \text{ IN.}$
 $I = 656,426 \text{ IN.}^4$
 $S_T = 17,680 \text{ IN.}^3$
 $S_B = -18,825 \text{ IN.}^3$
 WT. = 953 #/FT.


PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands


Pi PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94 \text{ KIPS}$

$$\frac{y_B}{r^2} = \frac{-34.87}{717.50} = -0.0486 \text{ in/in}^2$$

$$f_B (\text{init.}) = \frac{A_s f_s}{A} (1 + e_s \frac{y_B}{r^2})$$

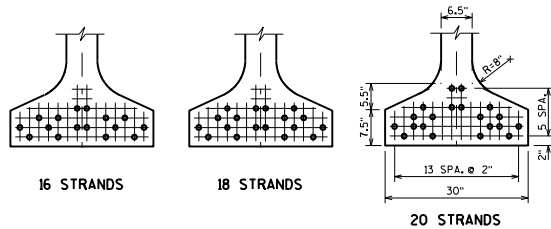

STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.6" DIA. STRANDS

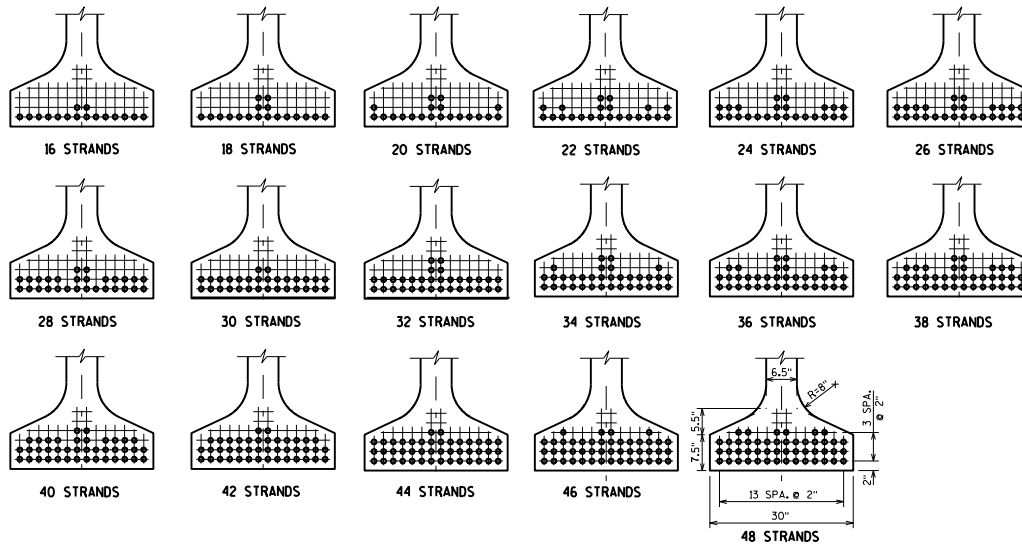

ARRANGEMENT AT $\frac{1}{4}$ SPAN - FOR GIRDERS WITH DRAPED 0.6" DIA. STRANDS

DESIGNER NOTES

ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

(COMPRESSION IS POSITIVE)

NO. STRANDS	e_s (inches)	$P(\text{init.}) = A_s f_s$ (KIPS)	$f_B (\text{init.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS			
16	-30.37	703	1,902
18	-29.98	791	2,124
20	-29.27	879	2,328
STANDARD STRAND PATTERNS FOR DRAPED STRANDS			
16	-32.62	703	1,986
18	-32.20	791	2,217
20	-32.07	879	2,458
22	-31.96	967	2,698
24	-31.87	1055	2,939
26	-31.79	1143	3,179
28	-31.73	1230	3,417
30	-31.67	1318	3,657
32	-31.37	1406	3,880
34	-31.22	1494	4,110
36	-31.09	1582	4,341
38	-30.98	1670	4,574
40	-30.87	1758	4,803
42	-30.77	1846	5,034
44	-30.69	1933	5,265
46	-30.52	2021	5,484
48	-30.37	2109	5,707

72" PRESTRESSED GIRDER DESIGN DATA

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

82W GIRDER

A = 980 SQ. IN.
 $r^2 = 924.1 \text{ IN.}^2$
 $y_T = 42.32 \text{ IN.}$
 $y_B = -39.68 \text{ IN.}$
 $I = 905,453 \text{ IN.}^4$
 $S_T = 21,396 \text{ IN.}^3$
 $S_B = -22,819 \text{ IN.}^3$
 WT. = 1021 #/FT.


PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands


Pi PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94 \text{ KIPS}$

$$\frac{y_B}{r^2} = \frac{-39.68}{924.10} = -0.04294 \text{ in/in}^2$$

$$f_B (\text{ini.}) = \frac{A_s f_s}{A} (1 + \frac{e_s y_B}{r^2})$$

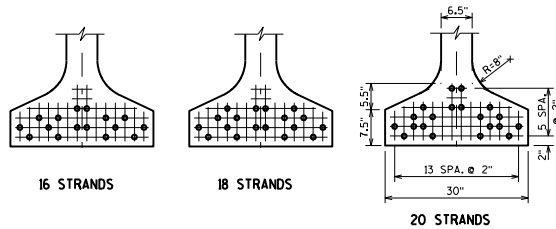

STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.6" DIA. STRANDS

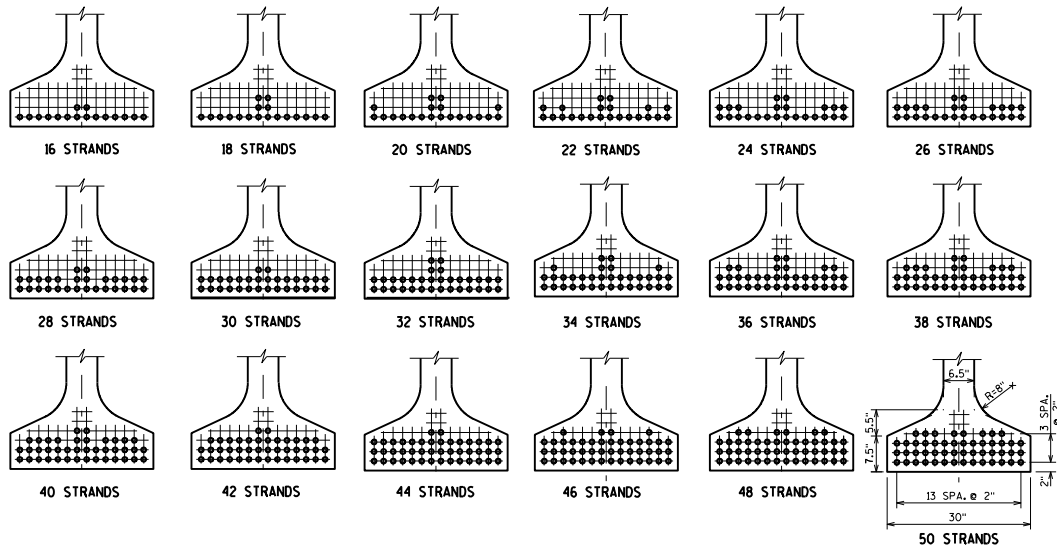

ARRANGEMENT AT $\frac{1}{4}$ SPAN - FOR GIRDERS WITH DRAPED 0.6" DIA. STRANDS

DESIGNER NOTES

ON THE STRAND PATTERN SHEET, PLACE A BOX AROUND EACH STRAND PATTERN THAT APPLIES TO THE DESIGNED STRUCTURE.

(COMPRESSION IS POSITIVE)			
NO. STRANDS	e_s (inches)	$P(\text{ini.}) = A_s f_s$ (KIPS)	$f_B (\text{ini.})$ (K/sq.in.)
STANDARD STRAND PATTERNS FOR UNDRAPED STRANDS			
16	-35.18	703	1.801
18	-34.79	791	2.013
20	-34.08	879	2.209
STANDARD STRAND PATTERNS FOR DRAPED STRANDS			
16	-37.43	703	1.870
18	-37.01	791	2.090
20	-36.88	879	2.318
22	-36.77	967	2.545
24	-36.68	1055	2.772
26	-36.60	1143	3.000
28	-36.54	1230	3.224
30	-36.48	1318	3.451
32	-36.18	1406	3.664
34	-36.03	1494	3.883
36	-35.90	1582	4.104
38	-35.79	1670	4.323
40	-35.68	1758	4.542
42	-35.58	1846	4.762
44	-35.50	1933	4.978
46	-35.33	2021	5.191
48	-35.18	2109	5.404
50	-35.04	2197	5.616


THERE IS CURRENTLY A MORATORIUM ON THE USE OF 82W" PRESTRESSED GIRDERS.

82W" PRESTRESSED GIRDER DESIGN DATA


STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
 7-16

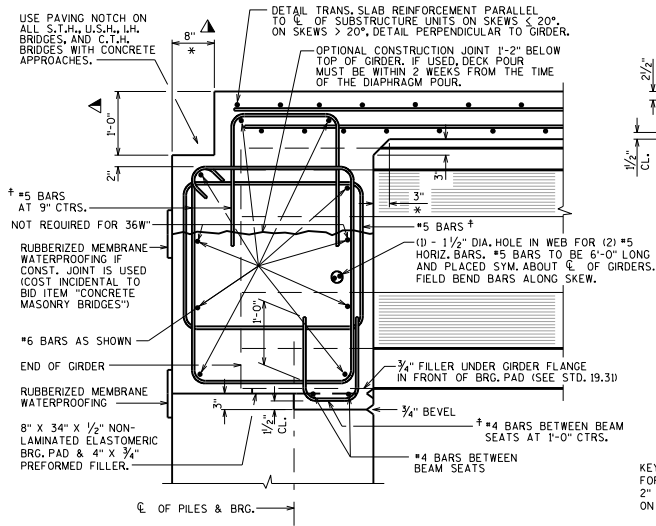



PRESTRESSED GIRDER WITH SEMI-EXPANSION SEAT

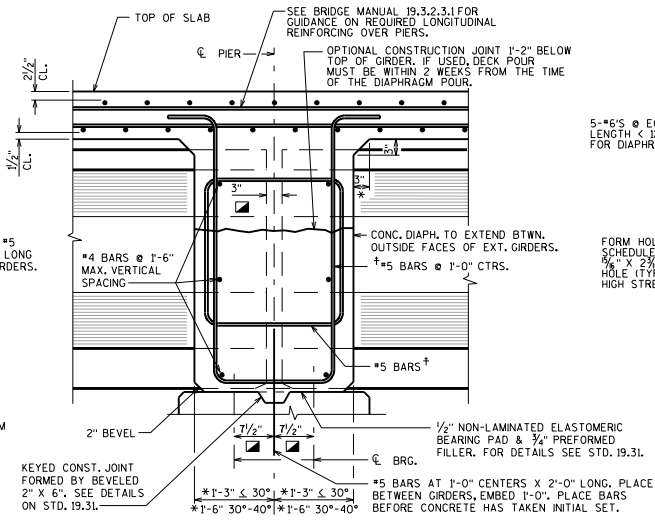


DIAPHRAGM AT 1/2" ELASTOMERIC BEARING

LEGEND


- ▣ DIMENSION IS TAKEN PARALLEL TO \bar{C} GIRDER.
- * DIMENSION IS TAKEN NORMAL TO \bar{C} SUBSTRUCTURE UNITS.
- ▴ PAVING NOTCH IS 1'-0" WIDE BY 1'-4" DEEP IF STRUCTURAL APPROACH SLAB (STD. 12.0015) IS USED.
- † BARS PLACED PARALLEL TO GIRDERS, SPACING PERPENDICULAR TO \bar{C} GIRDERS.

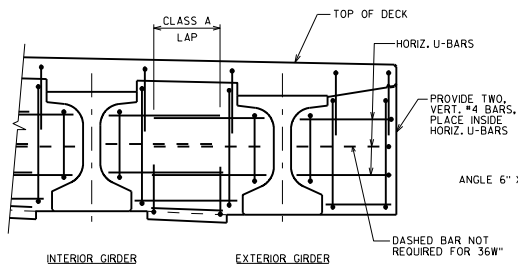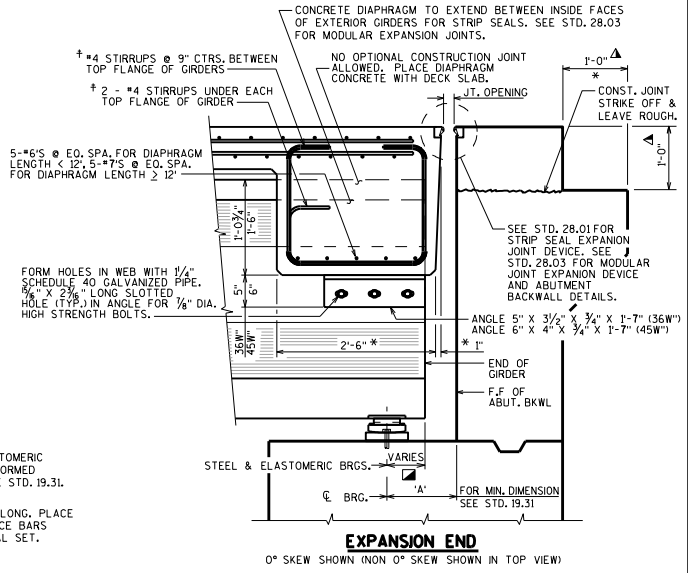


PART TRANSVERSE SECTION AT DIAPHRAGM SEMIEXPANSION END

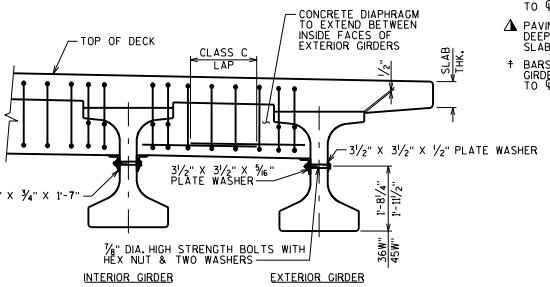


PART TRANSVERSE SECTION AT DIAPHRAGM EXPANSION END

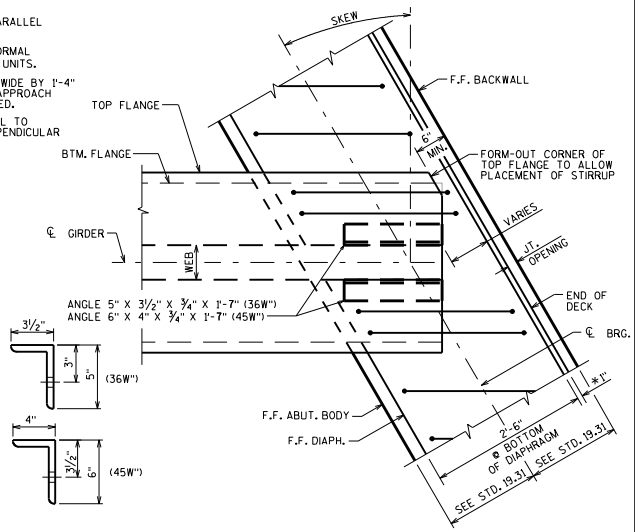

TOP VIEW OF DIAPHRAGM (EXPANSION END)

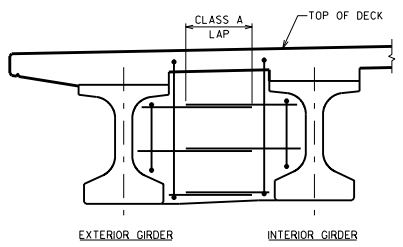

PART TRANSVERSE SECTION AT DIAPHRAGM PIER

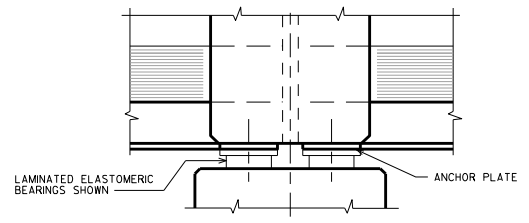

DIAPHRAGM AT STEEL OR ELASTOMERIC BEARINGS SECTION THRU DIAPHRAGM AT PIER

FOR STEEL BEARINGS, FORM DIAPHRAGM APPROXIMATELY 1/2" ABOVE BEARING KEEPER BARS

NOTES

ALL DIAPHRAGM SUPPORT HARDWARE SHALL BE INCIDENTAL TO "CONCRETE MASONRY BRIDGES".

DIAPHRAGM SUPPORT ANGLES SHALL BE ASTM A709 GRADE 36.


ALL DIAPHRAGM SUPPORT HARDWARE INCLUDING BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AFTER FABRICATION.

STEEL DIAPHRAGM SUPPORT ANGLE TO CONCRETE WEB CONNECTION SHALL BE SNUG-TIGHT PLUS 1/4" TURN, HIGH STRENGTH BOLTS FOR WEB CONNECTION SHALL MEET THE REQUIREMENTS FOR ASTM A325 OR ASTM A449.


DESIGNER NOTE

LAP LENGTHS FOR DIAPHRAGM REINFORCEMENT SHALL BE BASED ON A CLASS "CC" TENSION LAP SPLICE, UNLESS OTHERWISE NOTED.


PRESTRESSED 36W" & 45W" GIRDER SLAB & SUPERSTRUCTURE DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

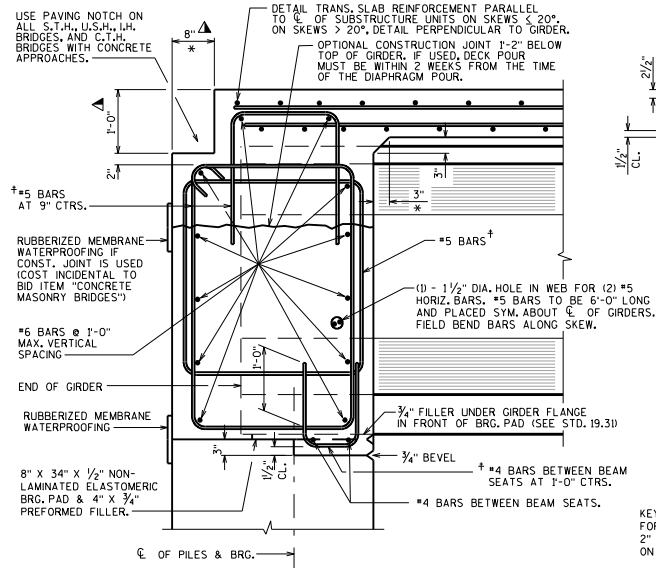


PRESTRESSED GIRDER WITH SEMI-EXPANSION SEAT

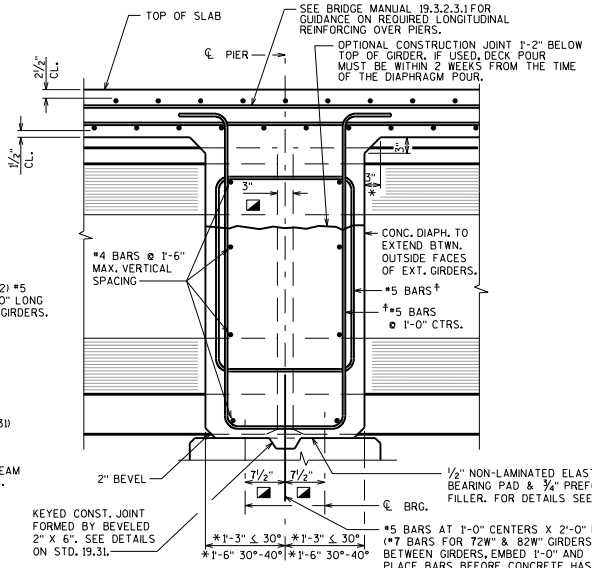


DIAPHRAGM AT 1/2" ELASTOMERIC BEARING

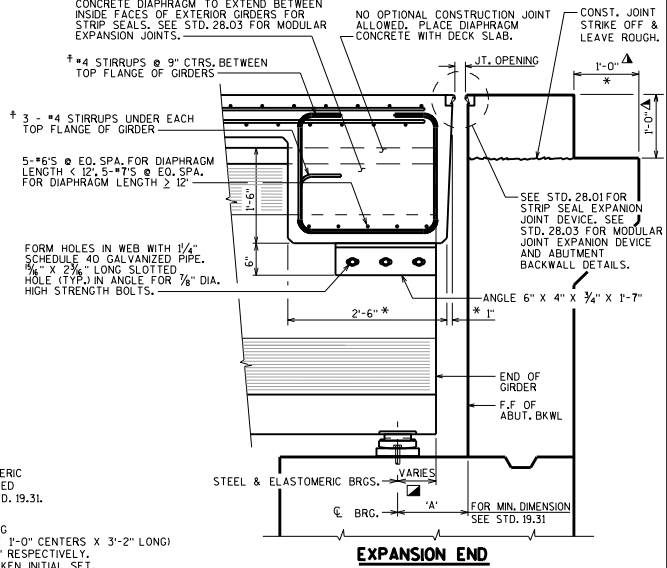


EXPANSION END
0° SKEW SHOWN (NON 0° SKEW SHOWN IN TOP VIEW)

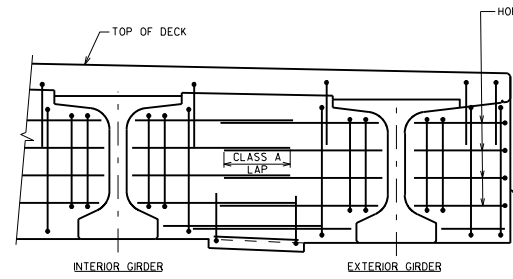


PART TRANSVERSE SECTION AT DIAPHRAGM SEMI-EXPANSION END

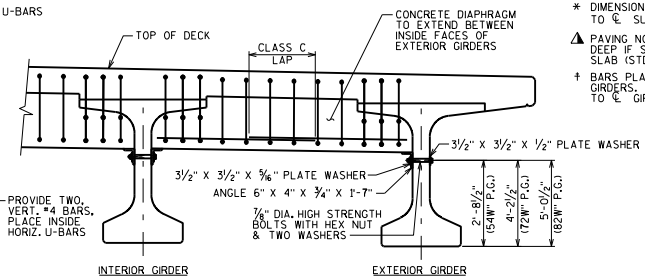

PART TRANSVERSE SECTION AT DIAPHRAGM EXPANSION END

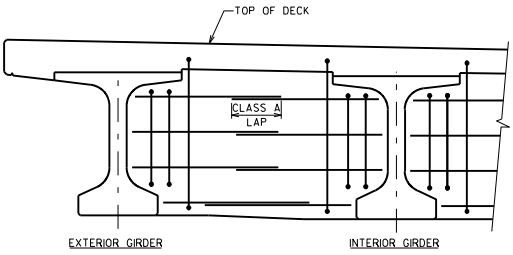

PART TRANSVERSE SECTION AT DIAPHRAGM PIER

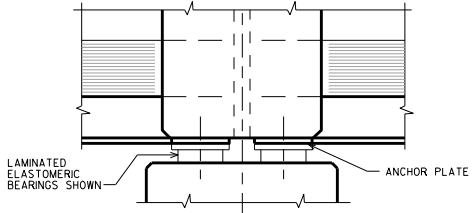


DIAPHRAGM AT STEEL OR ELASTOMERIC BEARINGS SECTION THRU DIAPHRAGM AT PIER


FOR STEEL BEARINGS, FORM DIAPHRAGM APPROXIMATELY 1/2" ABOVE BEARING KEPPER BARS

LEGEND

- DIMENSION IS TAKEN PARALLEL TO ϕ GIRDER.
- * DIMENSION IS TAKEN NORMAL TO ϕ SUBSTRUCTURE UNITS.
- △ PAVING NOTCH IS 1'-0" WIDE BY 1'-4" DEEP IF STRUCTURAL APPROACH SLAB (STD. 12.10) IS USED.
- † BARS PLACED PARALLEL TO ϕ GIRDERS.



ANGLE

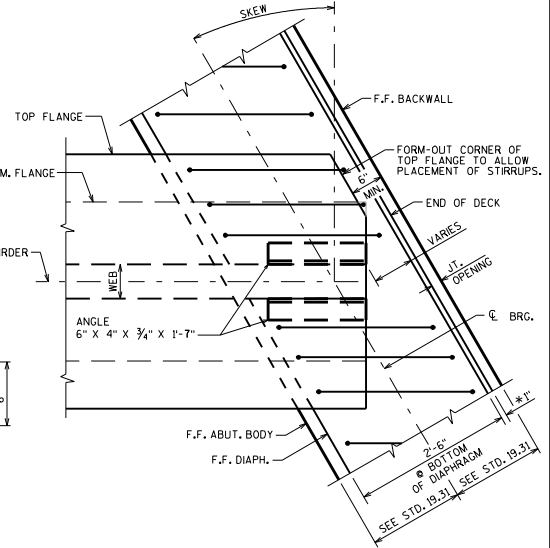

TOP VIEW OF DIAPHRAGM (EXPANSION END)

NOTES

- ALL DIAPHRAGM SUPPORT HARDWARE SHALL BE INCIDENTAL TO "CONCRETE MASONRY BRIDGES".
- DIAPHRAGM SUPPORT ANGLES SHALL BE ASTM A709 GRADE 36.
- ALL DIAPHRAGM SUPPORT HARDWARE INCLUDING BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AFTER FABRICATION.
- STEEL DIAPHRAGM SUPPORT ANGLE TO CONCRETE WEB CONNECTION SHALL BE SNUG-TIGHT PLUS 1/4" TURN, HIGH STRENGTH BOLTS FOR WEB CONNECTION SHALL MEET THE REQUIREMENTS FOR ASTM A325 OR ASTM A449.


DESIGNER NOTES

LAP LENGTHS FOR DIAPHRAGM REINFORCEMENT SHALL BE BASED ON A CLASS "C" TENSION LAP SPLICE, UNLESS OTHERWISE NOTED.

PRESTRESSED 54W", 72W" & 82W" GIRDER SLAB & SUPERSTRUCTURE DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva DATE: 7-16

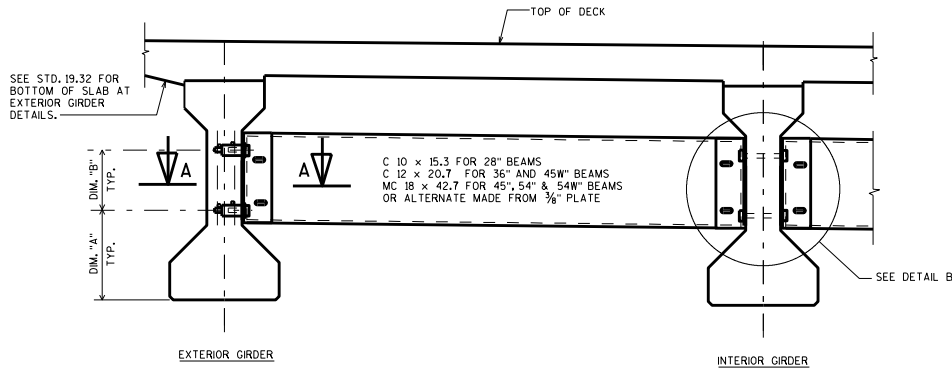

PART TRANSVERSE SECTION AT DIAPHRAGM

TABLE

GIRDER HEIGHT	DIM. "A"	DIM. "B"	DIM. "L"	* DIM. "X"
28"	1'-0 7/8"	5 7/8"	9 1/2"	2 1/4"
36"	1'-2 1/8"	9 7/8"	1'-1 1/2"	3 1/4"
45"	1'-5 1/8"	1'-1 7/8"	1'-5 1/2"	2 1/4"
45W"	1'-9 1/8"	8 7/8"	1'-0 1/2"	2 3/4"
54"	1'-7 7/8"	1'-5 7/8"	1'-9 1/2"	4 1/4"
54W"	1'-9 1/8"	1'-5 7/8"	1'-9 1/2"	4 1/4"



SECTION THRU ALTERNATE DIAPHRAGM

*DIM "X" = 2 1/2" FOR ALTERNATE PLATE DIAPHRAGM

NOTES

ALL DIAPHRAGM MATERIAL NOT EMBEDDED IN THE CONCRETE GIRDER SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "STEEL DIAPHRAGMS B-1-1", EACH.

EACH DIAPHRAGM BETWEEN GIRDERS SHALL CONSTITUTE ONE UNIT. ALL DIAPHRAGM STRUCTURAL STEEL SHALL BE ASTM A709 GRADE 36.


ALL DIAPHRAGM MATERIAL INCLUDING BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AFTER FABRICATION.

STEEL DIAPHRAGM TO CONCRETE WEB CONNECTION SHALL BE SNUG-TIGHT PLUS 1/4 TURN, UNLESS NOTED OTHERWISE. HIGH STRENGTH BOLTS FOR WEB CONNECTION SHALL MEET THE REQUIREMENTS FOR ASTM A325 OR ASTM A449.


DESIGNER NOTES

FOR SPANS EQUAL TO OR LESS THAN 80'-0", PLACE ONE DIAPHRAGM AT MID-LENGTH OF GIRDER. FOR SPANS OVER 80'-0", PLACE AT 1/3 AND 2/3 POINTS.


ON THE PLANS, SHOW LOCATION OF INSERTS/HOLES FOR DIAPHRAGM TO WEB CONNECTION, NOT ONLY FROM THE BOTTOM OF THE GIRDER (DIM "A" AND "B"), BUT ALSO FROM THE ENDS OF EACH GIRDER.

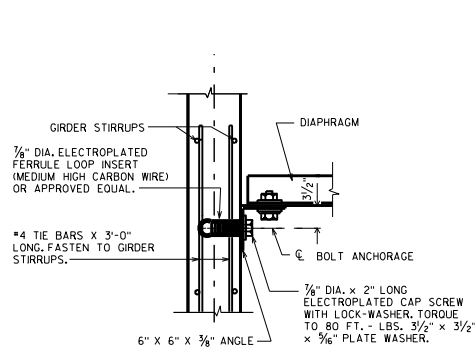


SECT. A-A
(FOR EXTERIOR ATTACHMENT)

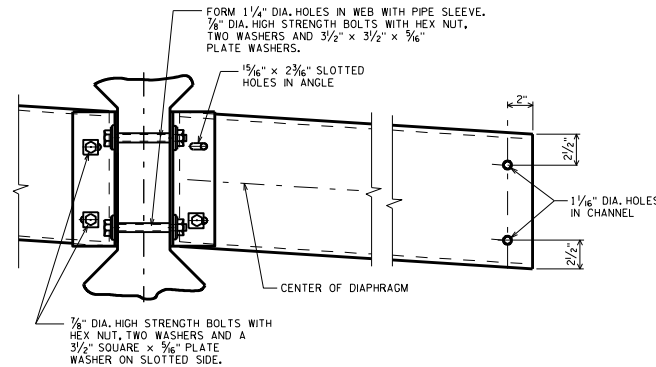


DETAIL B
(FOR CONTINUOUS LINE OF DIAPHRAGMS)

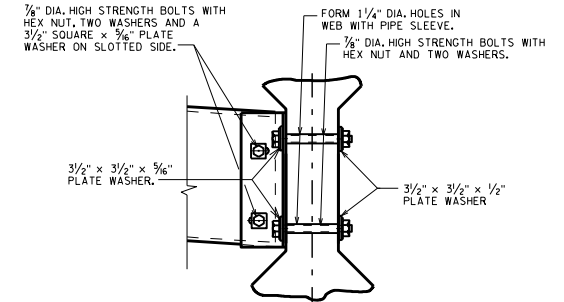


SECTION AT INTERIOR GIRDERS THRU DIAPHRAGM FOR SKEW ANGLES > 10°

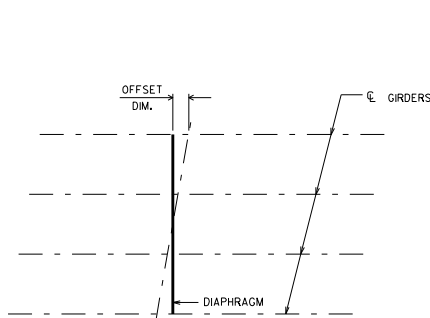

PLAN FOR SKEW ANGLES ≤ 10°

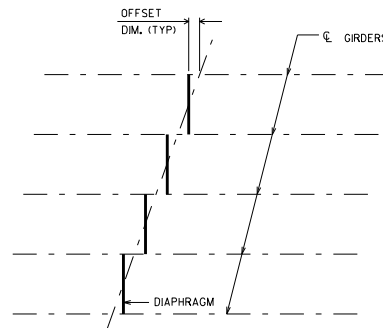

PLAN FOR SKEW ANGLES > 10°

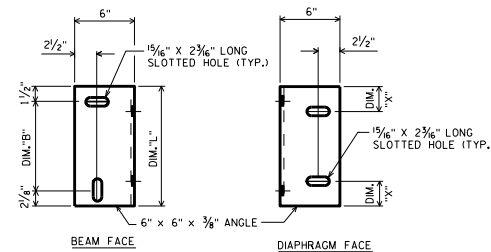


DIAPHRAGM SUPPORT

INTERM. STEEL DIAPHS. FOR 28", 36", 45", 45W" 54" & 54W" PRESTRESSED GIRDERS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

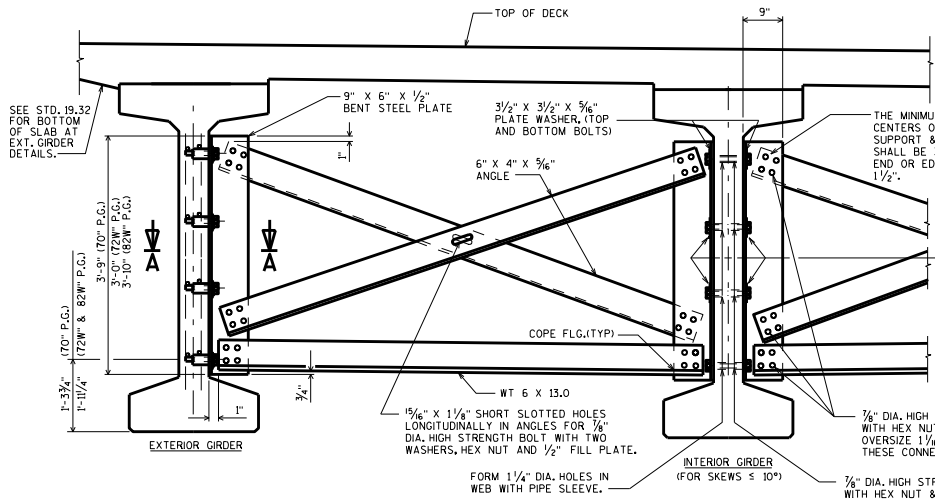


PART TRANSVERSE SECTION AT DIAPHRAGM

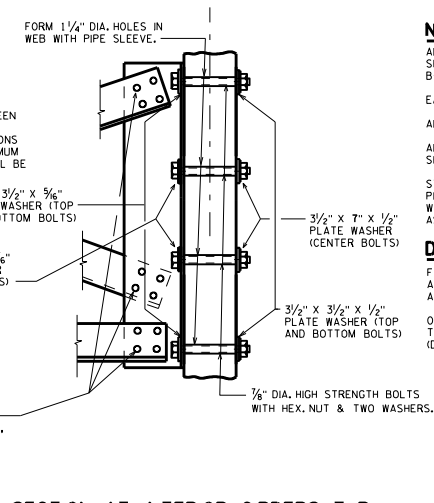


SECTION AT INTERIOR GIRDERS THRU DIAPHRAGM FOR SKEW ANGLES > 10°


NOTES
 ALL DIAPHRAGM MATERIAL NOT EMBEDDED IN THE CONCRETE GIRDER SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "STEEL DIAPHRAGMS B--", EACH.
 EACH DIAPHRAGM BETWEEN GIRDERS SHALL CONSTITUTE ONE UNIT.
 ALL DIAPHRAGM STRUCTURAL STEEL SHALL BE ASTM A709 GRADE 36.
 ALL DIAPHRAGM MATERIAL INCLUDING BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AFTER FABRICATION.
 STEEL DIAPHRAGM TO CONCRETE WEB CONNECTION SHALL BE SNUG-TIGHT PLUS 1/2 TURN, UNLESS NOTED OTHERWISE. HIGH STRENGTH BOLTS FOR WEB CONNECTION SHALL MEET THE REQUIREMENTS FOR ASTM A325 OR ASTM A449.
DESIGNER NOTES
 FOR SPANS EQUAL TO OR LESS THAN 80'-0", PLACE ONE DIAPHRAGM AT MID-LENGTH OF GIRDER. FOR SPANS OVER 80'-0", PLACE AT 1/3 AND 2/3 POINTS.
 ON THE PLANS, SHOW LOCATION OF INSERTS/HOLES FOR DIAPHRAGM TO WEB CONNECTION, NOT ONLY FROM THE BOTTOM OF THE GIRDER (DIM "A" AND "B"), BUT ALSO FROM THE ENDS OF EACH GIRDER.

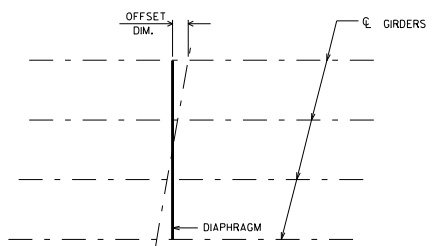


PLAN FOR SKEW ANGLES ≤ 10°

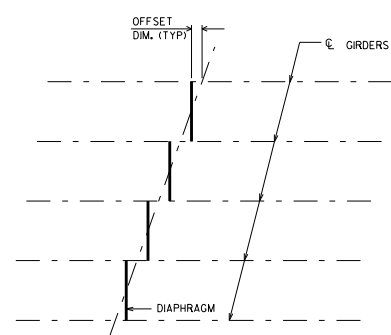

PLAN FOR SKEW ANGLES > 10°

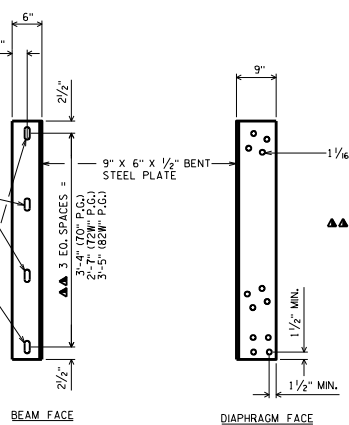

DIAPHRAGM SUPPORT

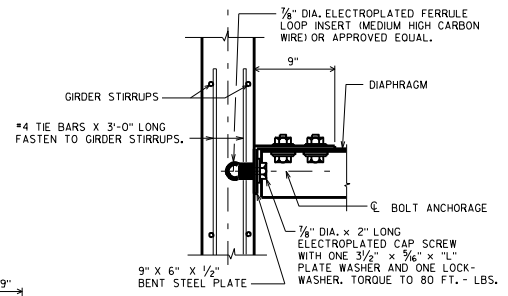

SECT. A-A (FOR EXTERIOR ATTACHMENT)

INTERMEDIATE STEEL DIAPHRAGMS FOR 70", 72W" & 82W" PRESTRESSED GIRDERS

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

NOTES

ALL DIAPHRAGM MATERIAL NOT EMBEDDED IN THE CONCRETE GIRDER SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "STEEL DIAPHRAGMS B-1-1", EACH.

EACH DIAPHRAGM BETWEEN GIRDERS SHALL CONSTITUTE ONE UNIT. ALL DIAPHRAGM STRUCTURAL STEEL SHALL BE ASTM A709 GRADE 36.


ALL DIAPHRAGM MATERIAL INCLUDING BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AFTER FABRICATION.

STEEL DIAPHRAGM TO CONCRETE WEB CONNECTION SHALL BE SNUG-TIGHT PLUS 1/4 TURN, UNLESS NOTED OTHERWISE. HIGH STRENGTH BOLTS FOR WEB CONNECTION SHALL MEET THE REQUIREMENTS FOR ASTM A325 OR ASTM A449.


DESIGNER NOTES

FOR SPANS EQUAL TO OR LESS THAN 80'-0", PLACE ONE DIAPHRAGM AT MID-LENGTH OF GIRDER. FOR SPANS OVER 80'-0", PLACE AT 1/3 AND 2/3 POINTS.

ON THE PLANS, SHOW LOCATION OF INSERTS/HOLES FOR DIAPHRAGM TO WEB CONNECTION, NOT ONLY FROM THE BOTTOM OF THE GIRDER (DIM "A" AND "B"), BUT ALSO FROM THE ENDS OF EACH GIRDER.

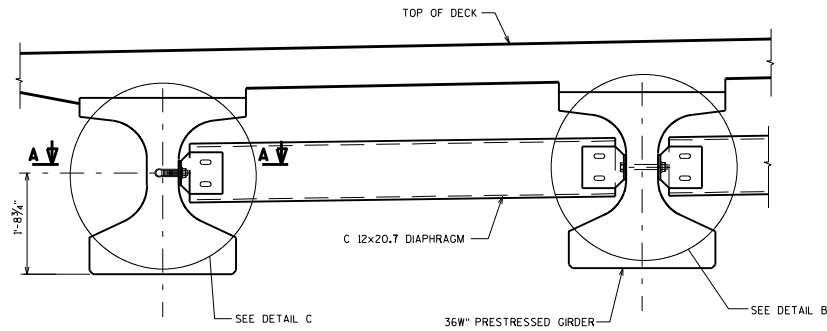


PART TRANSVERSE SECTION AT DIAPHRAGM

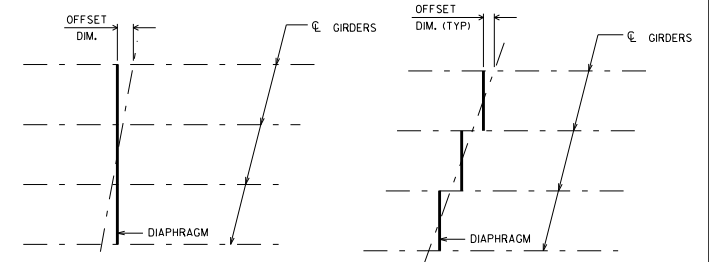

PLAN FOR SKEW ANGLES ≤ 10°


PLAN FOR SKEW ANGLES > 10°

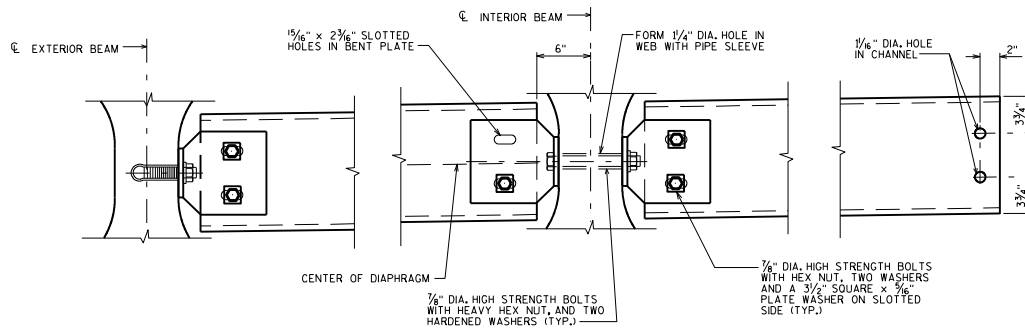


DETAIL C

DETAIL B


7/8" DIA. HIGH STRENGTH BOLTS WITH HEX NUT, TWO WASHERS AND A 3 1/2" SQUARE x 3/16" PLATE WASHER ON SLOTTED SIDE.

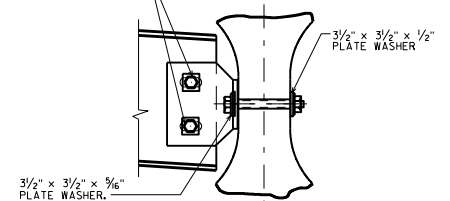

SECTION AT INTERIOR GIRDERS THRU DIAPHRAGM FOR SKEW ANGLES > 10°

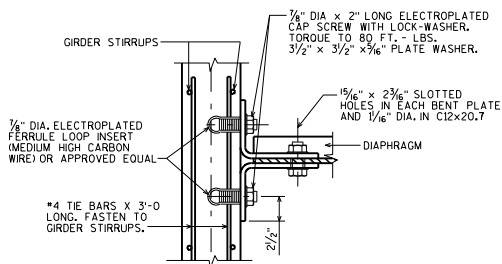


SECTION A-A
(FOR EXTERIOR ATTACHMENT)

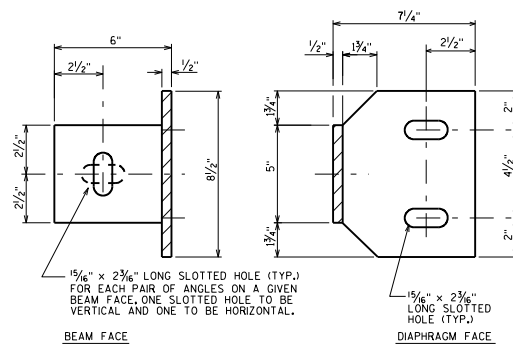


BEAM FACE

DIAPHRAGM FACE

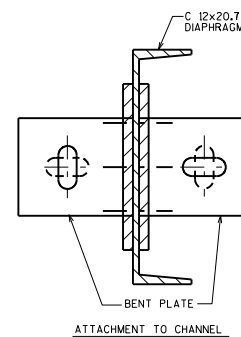

ATTACHMENT TO CHANNEL


INTERM. STEEL DIAPHS. FOR 36W PRESTRESSED GIRDERS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

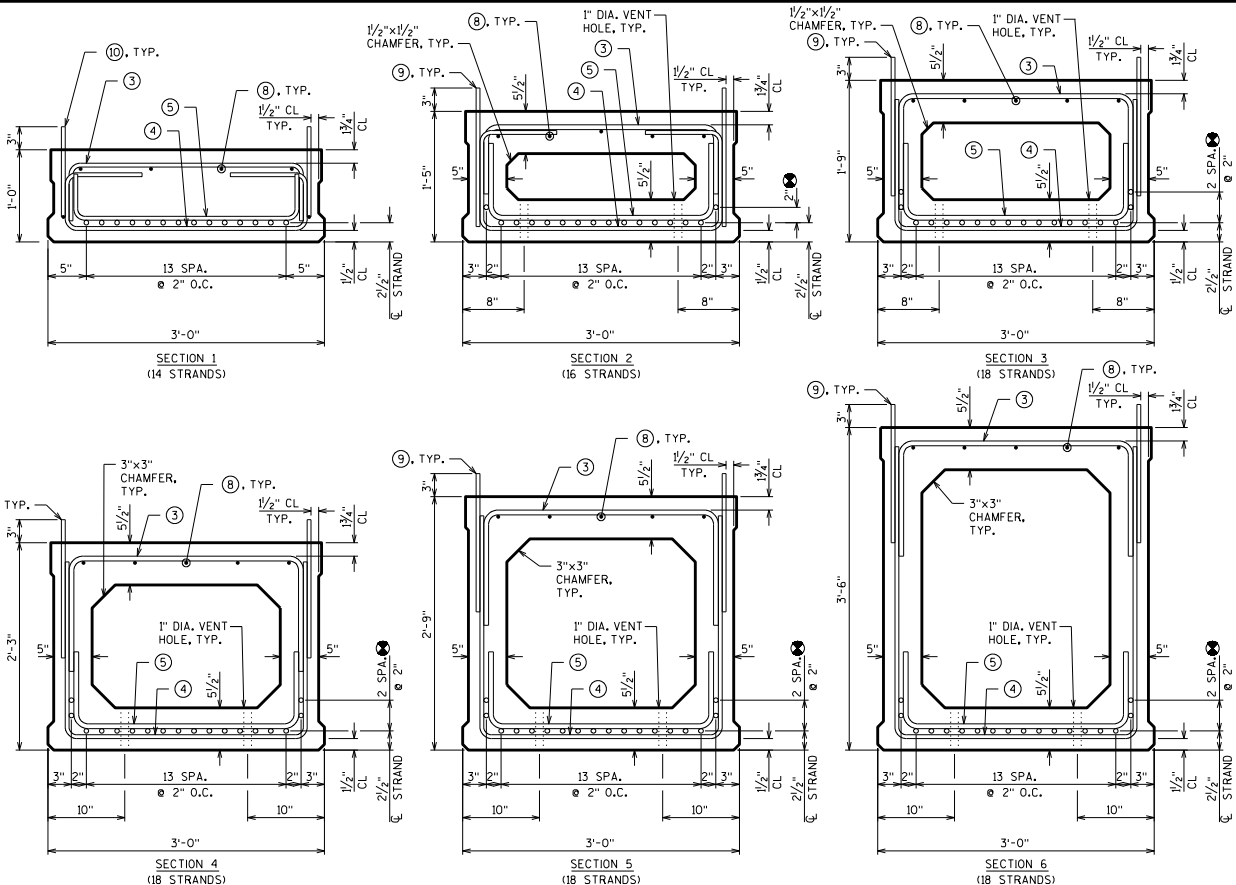

3'-0" SECTIONS

REBAR DIMENSION

SECT. DEPTH	SECT. NO.	"A"	"B"	"C"
1'-0"	1	7 1/2"	7 1/2"	6"
1'-5"	2	9"	1'-1"	10"
1'-9"	3	1'-3"	1'-5"	1'-2"
2'-3"	4	1'-3"	1'-11"	1'-8"
2'-9"	5	1'-3"	2'-5"	2'-2"
3'-6"	6	1'-3"	3'-2"	2'-11"

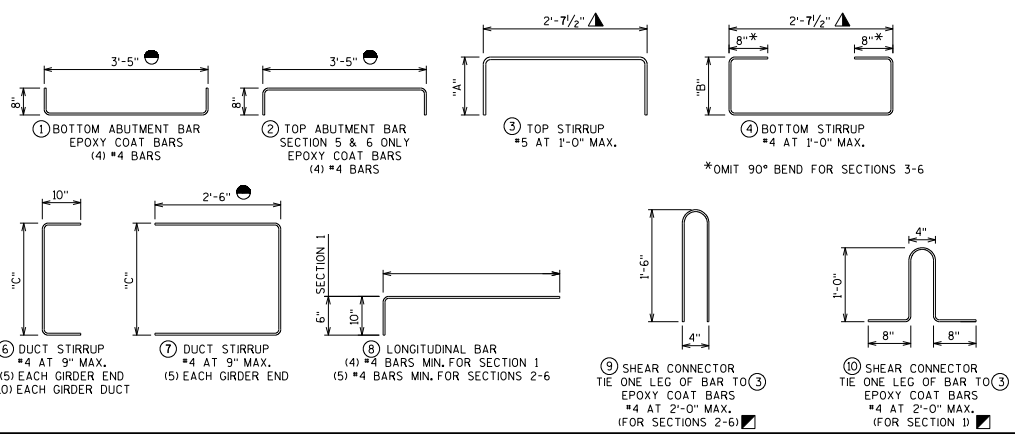

NOTES

THE CONCRETE MIX FOR THE PRESTRESSED BOX GIRDERS SHALL CONFORM TO SECTION 503.2.2 OF THE STANDARD SPECIFICATIONS.

AN APPROVED CONCRETE SEALER SHALL BE APPLIED TO THE BOTTOM OF THE GIRDERS AND THE EXTERIOR FACE OF EXTERIOR GIRDERS. DO NOT APPLY CONCRETE SEALER OR EPOXY TO THE SHEAR KEY OR THE TOP OF GIRDERS.

STRANDS SHALL BE FLUSH WITH END OF GIRDER. FOR CONCRETE ABUTMENTS, END OF STRANDS SHALL BE COATED WITH NON-BITUMINOUS JOINT SEALER. FOR GRS ABUTMENTS, COAT THE GIRDER ENDS, EXPOSED STRAND ENDS, AND ALL NON-BONDING SURFACES WITHIN 2 FEET OF THE GIRDER ENDS WITH A NON-PIGMENTED EPOXY CONFORMING TO AASHTO M-235 TYPE III, GRADE 2, CLASS B OR C. THE EPOXY SHALL BE APPLIED AT LEAST 3 DAYS AFTER MOIST CURING HAS CEASED AND PRIOR TO THE APPLICATION OF THE SEALER.

VOIDS SHALL BE VENTED AND DRAINED BY CASTING (2)-1" DIA. TUBES AT EACH END OF VOID SEGMENT, LOCATE TUBES AT BOTTOM EDGES OF THE CORNER FILLETS, AVOID STRAND LOCATIONS.

FOUR WAY SLING MUST BE USED TO ENGAGE ALL 4 LIFTING DEVICES ON BOTH ENDS OF UNITS.

POST-TENSIONING OF THE TRANSVERSE TENDONS SHALL NOT BEGIN UNTIL THE GROUT BETWEEN THE PRECAST BOX GIRDERS HAS BEEN ALLOWED TO CURE FOR 48 HOURS AND GROUT HAS REACHED A COMPRESSIVE STRENGTH OF 3,000 PSI.

SEAL WASHER SHALL BE SPONGE NEOPRENE GASKET 3/4" MIN. THICK. STRESS POCKETS SHALL BE FILLED WITH CHLORIDE FREE NON-SHRINK GROUT AFTER POST-TENSIONING.

TRANSITION BETWEEN CHANGING SLOPES OF POST-TENSIONING DUCTS SHALL BE PROVIDED BY EITHER A CIRCULAR OR PARABOLIC CURVE WITH A MINIMUM LENGTH OF 3'-0".

DESIGNER NOTES

THE MAXIMUM RECOMMENDED SKEW ANGLE OF THE STRUCTURE SHALL BE 30°.

BEAM SEATS SHALL BE SLOPED ALONG THE SUBSTRUCTURE UNITS TO ACCOUNT FOR THE CROSS SLOPE OR SUPERELEVATION ON THE DECK.

SLOPE BEAM SEATS PARALLEL TO GRADE LINE IF GRADE AT BRG. >1% PLACE ELEVATIONS ON PLANS TO MEET THESE REQUIREMENTS.

STRANDS TO BE DESIGNED, MAXIMUM NUMBER OF STRANDS AND STRAND ARRANGEMENTS ARE SHOWN, STRANDS NOT TO BE DRAPED.

MULTI-SPAN STRUCTURES REQUIRE ANCHOR DOWELS AT THE PIERS, WHICH MAY REDUCE THE MAXIMUM NUMBER OF STRANDS AVAILABLE BY 2. (CURRENTLY NOT USED)

THE FOLLOWING SPECIAL PROVISION SHALL BE USED:
PRESTRESSED GIRDERS BOX TYPE-XX (ISPV.0090.XXX)

SEE STANDARD 19.51 FOR SHEAR KEY RECESS DETAIL.

MATERIAL PROPERTIES

- CONCRETE MASONRY BRIDGES $f_c = 4,000$ PSI
- BAR STEEL REINFORCEMENT, GRADE 60 $f_y = 60,000$ PSI
- PRESTRESSED BOX GIRDERS, CONCRETE MASONRY $f_c = 5,000$ PSI
- STRANDS - 0.5" OR 0.6" DIA. ULTIMATE TENSILE STRENGTH $f_y = 270,000$ PSI


LEGEND

- DIMENSION GIVEN FOR A POST-TENSIONING DUCT 1'-10" FROM END OF PRESTRESSED BOX GIRDER.
- ▲ DIMENSION GIVEN FOR STIRRUPS PERPENDICULAR TO THE PRESTRESSED BOX GIRDER LENGTH. ADJUST THE DIMENSION FOR STIRRUPS AT SKEWED PRESTRESSED BOX GIRDER ENDS.
- ⊙ SHOW SPACING FOR THESE STRANDS ONLY IF REQUIRED BY DESIGN.
- SUBSTITUTE (1) BAR ON EXTERIOR EDGE OF EXTERIOR GIRDERS. SEE STANDARD 19.56.

3'-0" PRESTRESSED BOX GIRDER SECTIONS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION



APPROVED: Bill Oliva DATE: 7-16

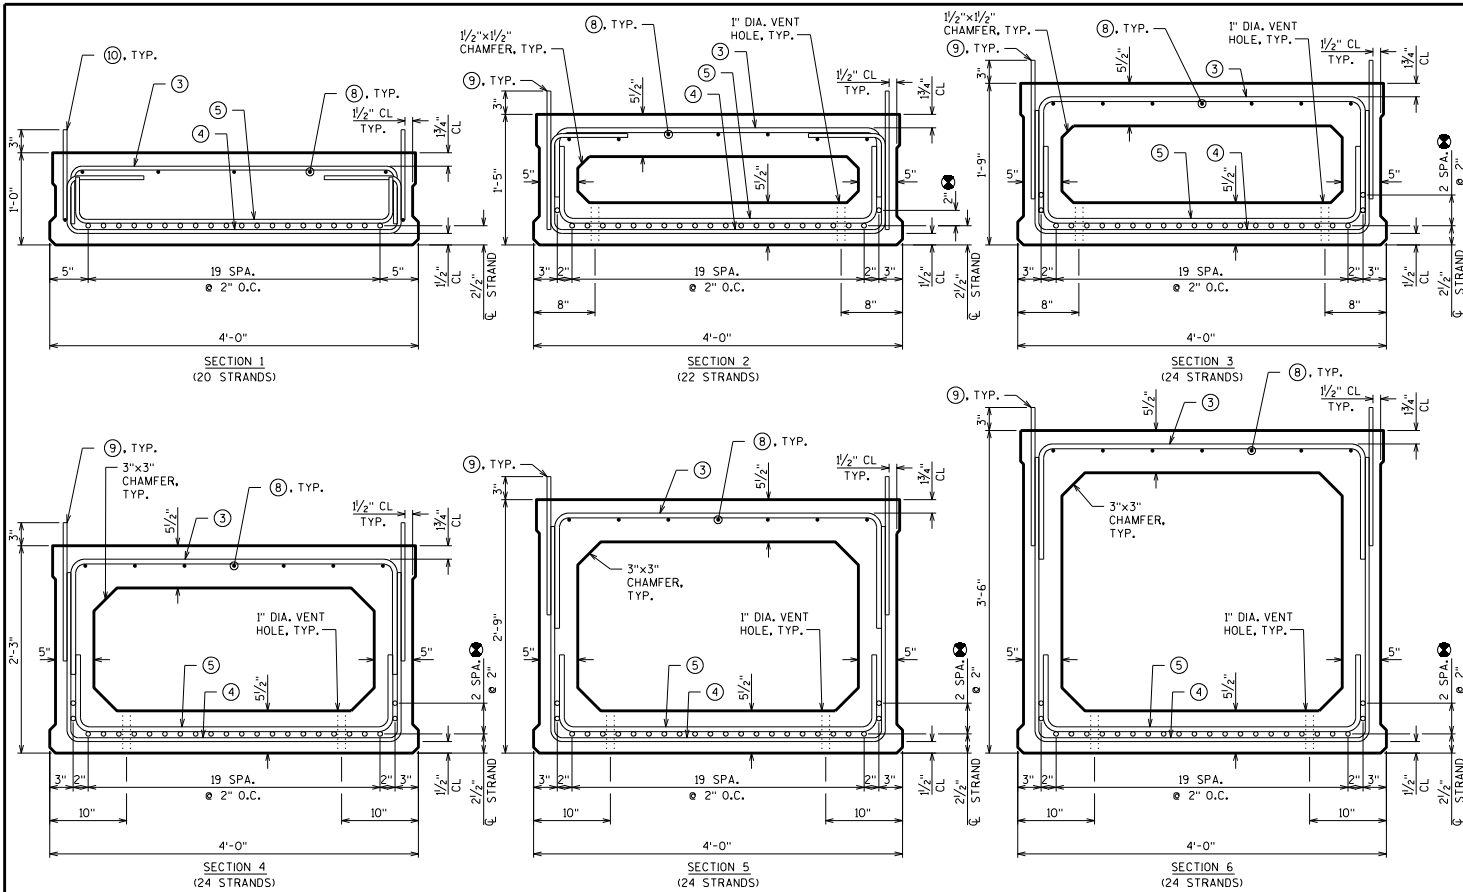

4'-0" SECTIONS

REBAR DIMENSION

SECT. DEPTH	SECT. NO.	"A"	"B"	"C"
1'-0"	1	7 1/2"	7 1/2"	6"
1'-5"	2	9"	1'-1"	10"
1'-9"	3	1'-3"	1'-5"	1'-2"
2'-3"	4	1'-3"	1'-11"	1'-8"
2'-9"	5	1'-3"	2'-5"	2'-2"
3'-6"	6	1'-3"	3'-2"	2'-11"

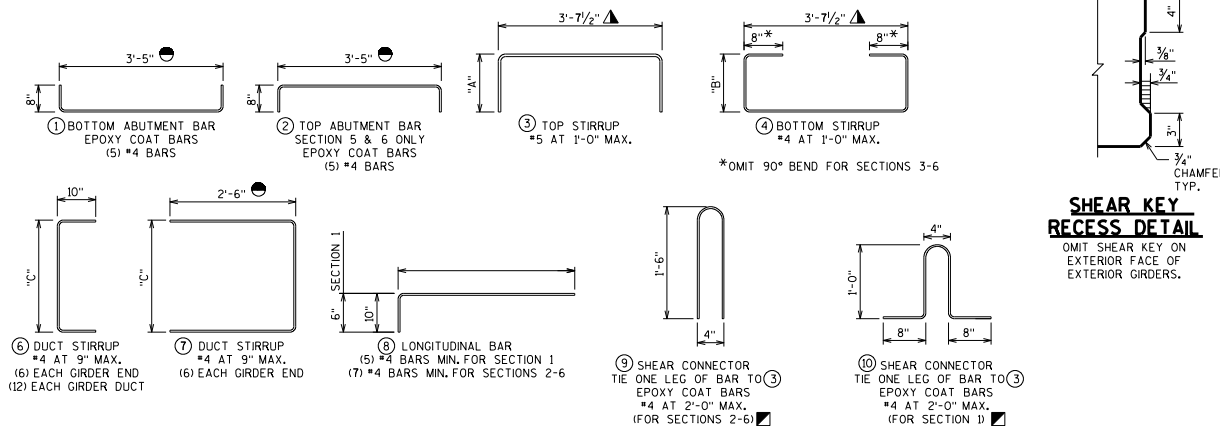

DESIGNER NOTE

SEE STANDARD 19.50 FOR NOTES, DESIGNER NOTES, MATERIAL PROPERTIES.

LEGEND

- DIMENSION GIVEN FOR A POST-TENSIONING DUCT 1'-10" FROM END OF PRESTRESSED BOX GIRDER.
- ▲ DIMENSION GIVEN FOR STIRRUPS PERPENDICULAR TO THE PRESTRESSED BOX GIRDER LENGTH. ADJUST THE DIMENSION FOR STIRRUPS AT SKEWED PRESTRESSED BOX GIRDER ENDS.
- ⊙ SHOW SPACING FOR THESE STRANDS ONLY IF REQUIRED BY DESIGN.
- SUBSTITUTE (11) BAR ON EXTERIOR EDGE OF EXTERIOR GIRDERS. SEE STANDARD 19.56.

SHEAR KEY RECESS DETAIL


OMIT SHEAR KEY ON EXTERIOR FACE OF EXTERIOR GIRDERS.

4'-0" PRESTRESSED BOX GIRDER SECTIONS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

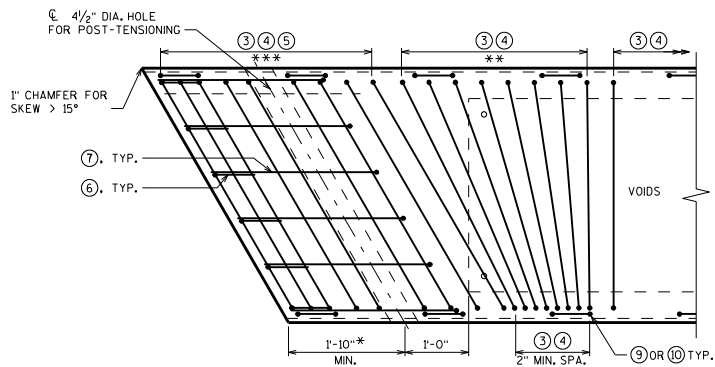


PART GIRDER PLAN WITH SKEW

①, ② & #4 TRANSVERSE BARS NOT SHOWN FOR CLARITY

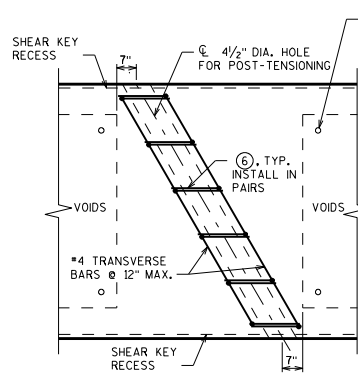

INTERIOR GIRDER DUCT PLAN

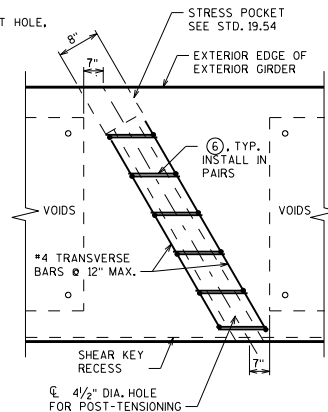

EXTERIOR GIRDER DUCT PLAN


LEGEND

- ☆ BARS NOT REQUIRED WHEN USED ON GRS ABUTMENTS.
- ◆ BARS PLACED PARALLEL TO GIRDERS. SPACING IS PERPENDICULAR TO THE \bar{C} OF THE GIRDERS.
- * WHEN WINGS ARE PARALLEL TO ABUTMENT \bar{C} , USE DIMENSIONS TO ALLOW FOR EASE OF POST-TENSIONING OPERATION.
- ** PLACE AT 5" MAX. SPACING UNTIL PERPENDICULAR TO THE \bar{C} OF THE GIRDER.
- *** PLACE ALONG SKEW FROM END OF PRESTRESSED BOX GIRDER UNTIL ALL END BLOCK BOTTOM STIRRUP BARS, ⑤, ARE PLACED.

DESIGNER NOTES


FOR BAR BEND DETAILS, SEE STANDARD 19.50 AND STANDARD 19.51

FOR SKEWED STRUCTURES CAST END OF PRESTRESSED BOX GIRDER ALONG SKEW.

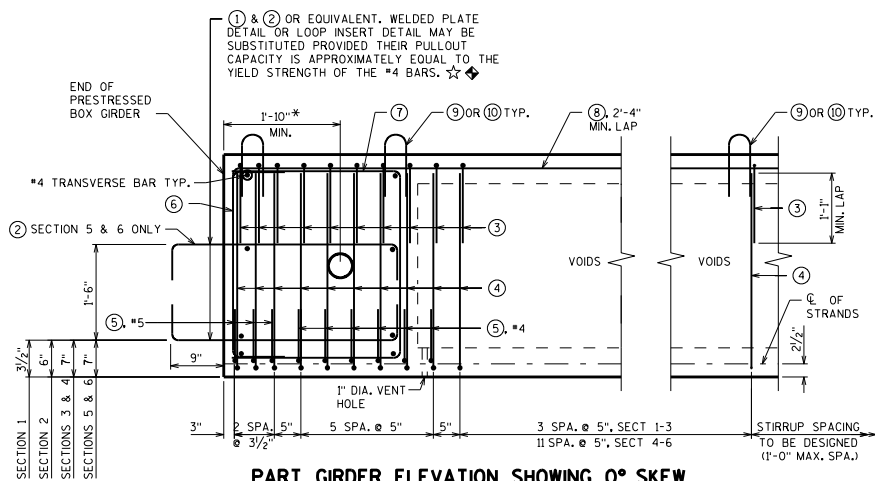


PART GIRDER ELEVATION SHOWING 0° SKEW


PLACE #4 TRANSVERSE BARS AS SHOWN ALONG SKEW

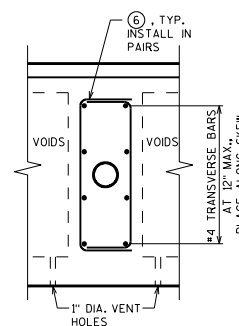

INTERIOR GIRDER DUCT ELEVATION

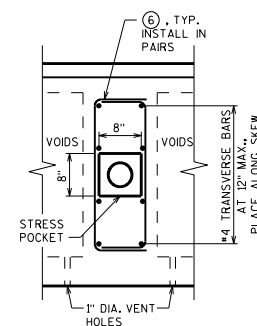


EXTERIOR GIRDER DUCT ELEVATION



WELDED PLATE DETAIL

(EQUIVALENT TO ONE #4 BAR)






LOOP INSERT DETAIL

PRESTRESSED BOX GIRDER DETAILS 1

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

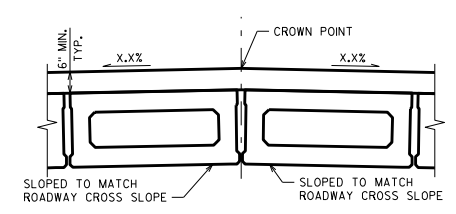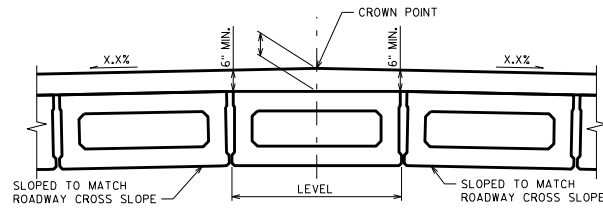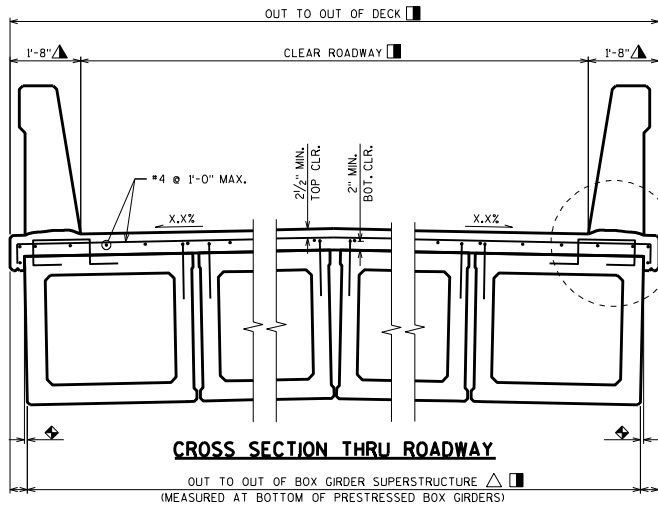


CROWN DETAIL AT LOCATION OF MIN. DECK THICKNESS

NUMBER OF SECTIONS



CLEAR ROADWAY	3'-0" SECTION	4'-0"* SECTION
26'-0"	10	7
30'-0"	11	8
36'-0"	13	10
40'-0"	14	11
44'-0"	16	12

* 4'-0" SECTIONS PREFERRED

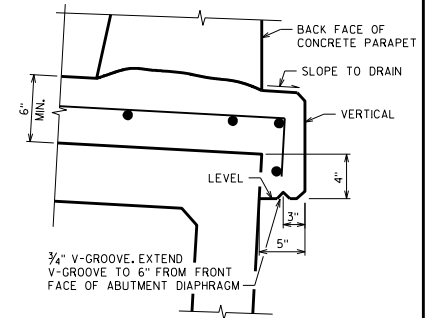


DECK OVERHANG DETAIL

SEE STANDARD 19.56 FOR ADDITIONAL DETAILS

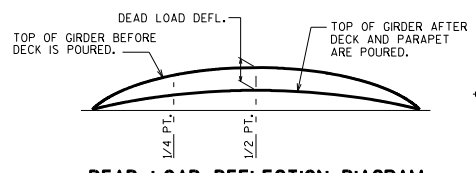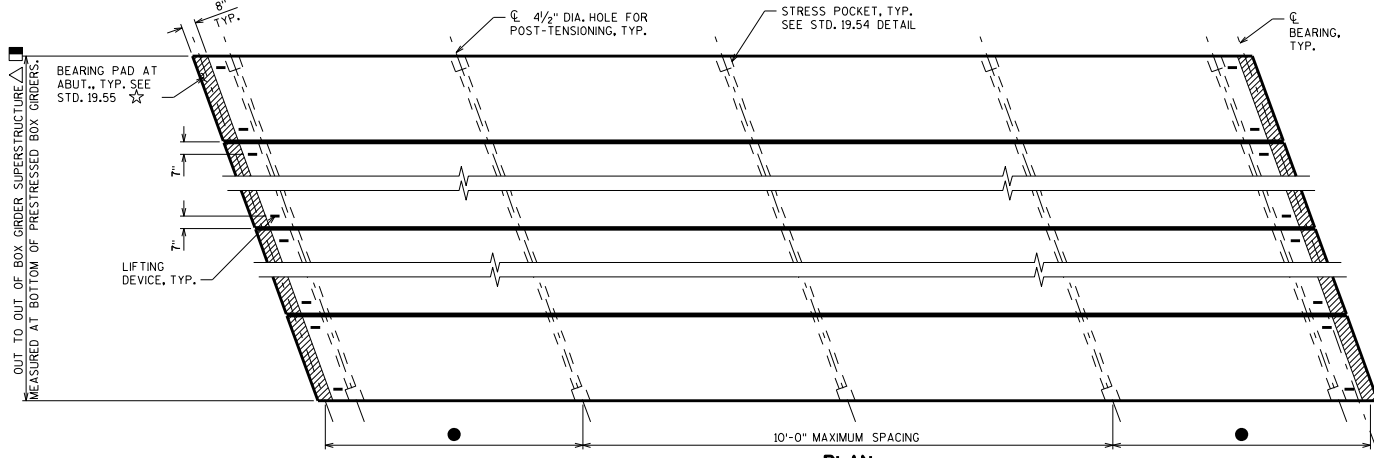

DEAD LOAD DEFLECTION DIAGRAM

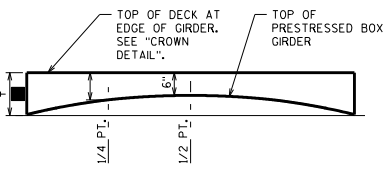

DECK THICKNESS DIAGRAM

■ TO DETERMINE DECK THICKNESS AT GIRDER ENDS FOLLOW THIS PROCESS:

- 6" MIN. DECK SLAB THICKNESS
- + FIELD MEASURED GIRDER CAMBER (AT MID SPAN)
- DEADLOAD DEFLECTION (AT MIDSPAN)
- = DECK THICKNESS, †

NOTE: PLAN DECK THICKNESS BASED ON THEORETICAL INITIAL CAMBER VALUE. 1/4 PT. MAY BE INTERPOLATED. USE FIELD MEASURED GIRDER CAMBER FOR ACTUAL DECK THICKNESS. THE 1/4 PT. IS INTERPOLATED BETWEEN DECK THICKNESS AT THE END OF DECK AND MIDSPAN.

** THE THEORETICAL INITIAL CAMBER VALUE AT THE TIME OF STRAND RELEASE AT MIDSPAN MULTIPLIED BY A FACTOR OF 1.4 TO ACCOUNT FOR CAMBER GROWTH FROM THE TIME OF STRAND RELEASE TO JOBSITE PLACEMENT.

SPAN	CAMBER (IN.) **
1	

THESE VALUES ARE NOT TO BE USED IN DETERMINING ††. USE FIELD MEASURED GIRDER CAMBER.

THESE VALUES ARE FOR INFORMATIONAL PURPOSES ONLY.

GIRDER DATA							
SPAN	GIRDER	GIRDER LENGTH "L"	DEAD LOAD DEFL. (IN.)		CONC. STRGTH. f'c (p.s.i.)	DIA. OF STRAND (IN.)	UNDRAPED PATTERN TOTAL NO. OF STRANDS
			1/4 PT.	1/2 PT.			
1							

* MINIMUM CYLINDER STRENGTH OF CONCRETE @ TIME OF TRANSFER OF PRESTRESS FORCE.

DESIGNER NOTES

△ ACCOUNT FOR NUMBER OF PRESTRESSED BOX GIRDERS, NUMBER OF JOINTS (AT 1' NORMAL TO C.G. GIRDER), AND ROADWAY CROSS SLOPE.

◆ DIMENSION IS HORIZONTAL DISTANCE FROM TOP OF PRESTRESSED BOX GIRDER TO BOTTOM OF PRESTRESSED BOX GIRDER.

DECK THICKNESS DETERMINATION PROCEDURE IS BASED ON TANGENT PROFILE GRADE LINE. STRUCTURES WITH VERTICAL CURVE PROFILE GRADE LINES MAY REQUIRE ADDITIONAL INVESTIGATION.

NOTES

NOTE: AN AVERAGE DECK THICKNESS OF WAS USED IN THE QUANTITY "CONCRETE MASONRY BRIDGES".

VARIATIONS TO THE GRADE LINE OVER 1/4" MUST BE SUBMITTED BY THE FIELD ENGINEER TO THE STRUCTURES DESIGN SECTION FOR REVIEW.

LEGEND

☆ BEARING PAD NOT REQUIRED FOR GRS ABUTMENTS.

● 1/4 SPAN FOR SPANS UP TO 80'-0".
 1/5 SPAN FOR SPANS OVER 80'-0".

■ DIMENSION ASSUMES 1" JOINT WIDTH. JOINT WIDTH DIMENSIONS MAY VARY DUE TO ±1/4" JOINT TOLERANCES.


▲ MAY BE REDUCED TO 1'-7" TO MAINTAIN ROADWAY CLEAR WIDTH.

PRESTRESSED BOX GIRDER DETAILS 2

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
 7-16

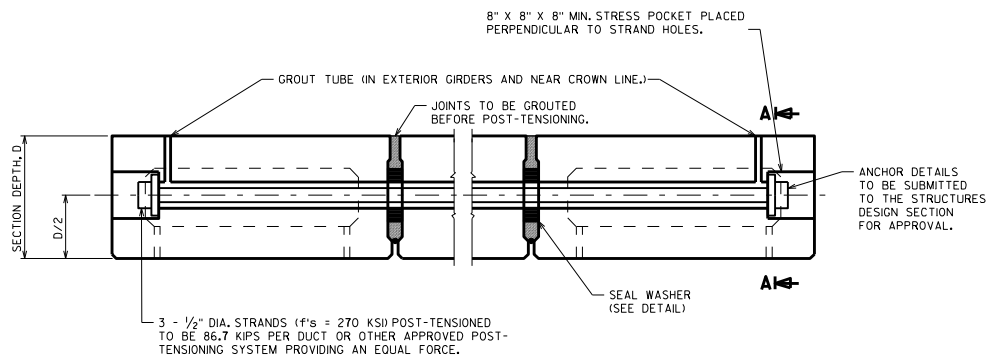


POST-TENSIONING DETAILS - ONE DUCT PER DIAPHRAGM


(SECTIONS 1 THROUGH 4)



SECTION A-A




SHEAR KEY DETAIL

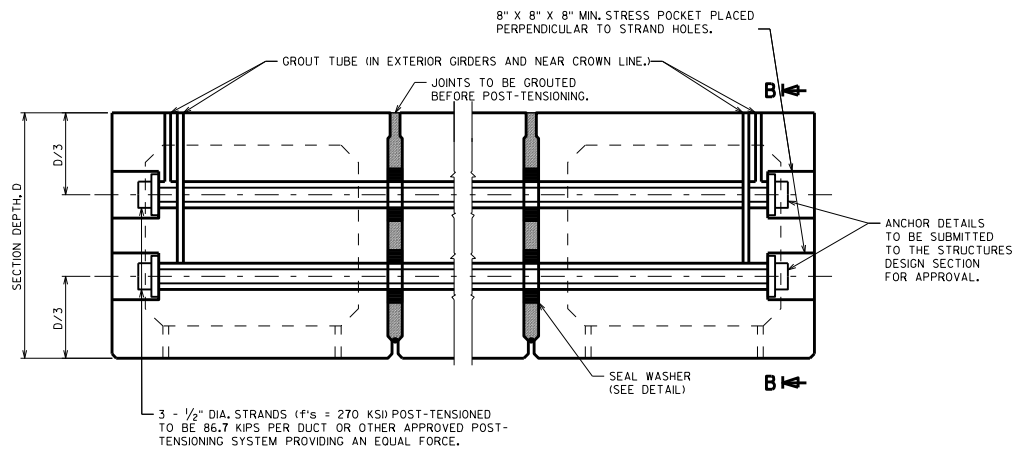


POST-TENSIONING DETAILS - TWO DUCTS PER DIAPHRAGM


(SECTIONS 5 AND 6)

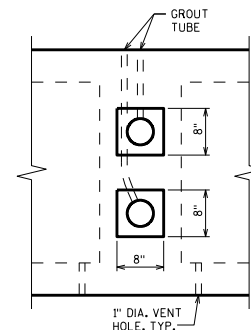


SECTION B-B



SEAL WASHER
(MAY ALSO BE ROUND)

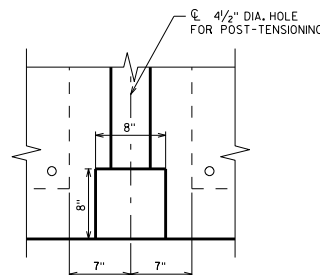

NO SKEW

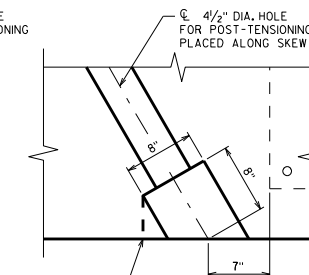

WITH SKEW




STRESS POCKET DETAIL

PRESTRESSED BOX GIRDER DETAILS 3

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

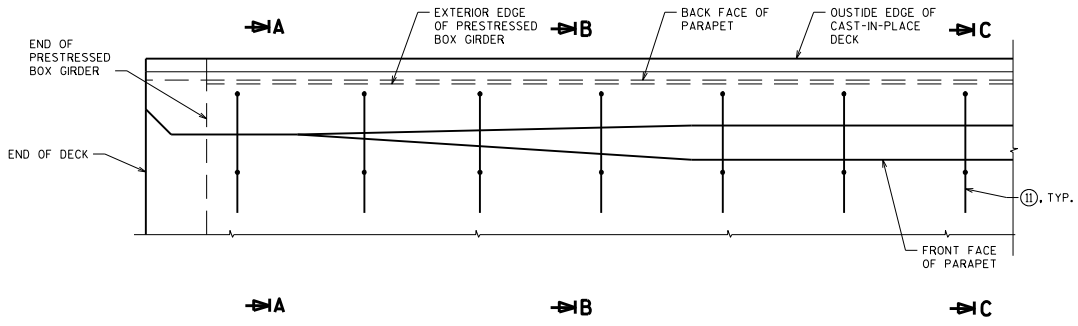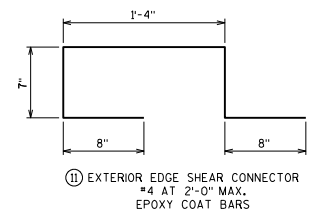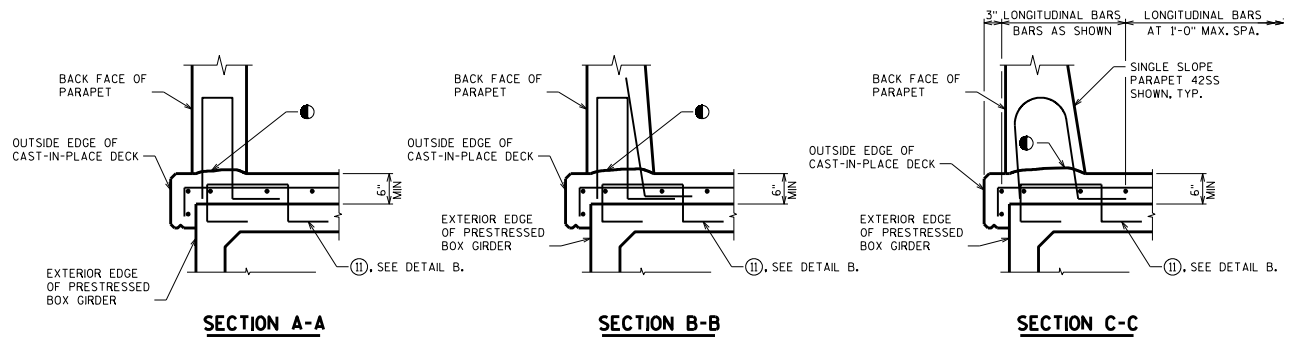


PLAN

SHOWING REINFORCEMENT CAST INTO PRESTRESSED BOX GIRDER
PARAPET AND DECK ARE SHOWN FOR CLARITY

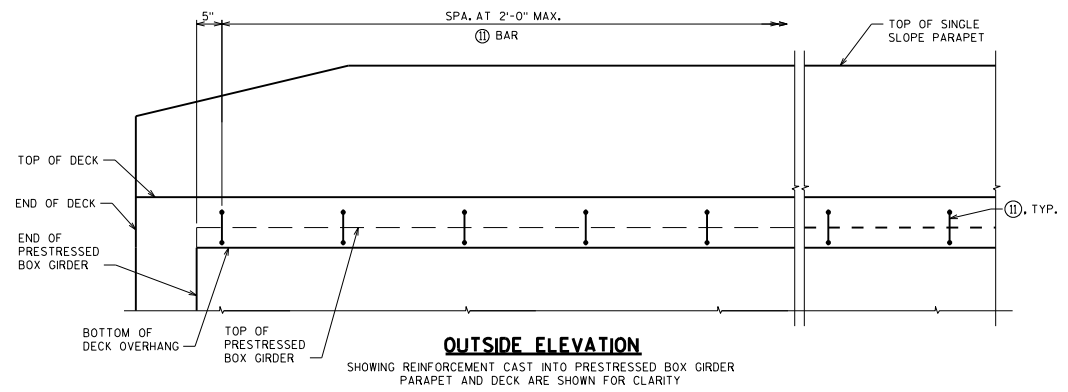

OUTSIDE ELEVATION

SHOWING REINFORCEMENT CAST INTO PRESTRESSED BOX GIRDER
PARAPET AND DECK ARE SHOWN FOR CLARITY

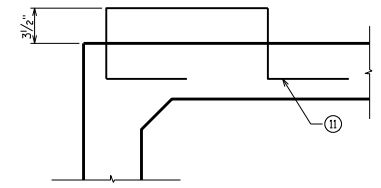

DETAIL B

LEGEND

● CONST. JOINT - STRIKE OFF AS SHOWN.

NOTE


BAR (II) TO BE PAID AS PART OF BID ITEM
"PRESTRESSED BOX GIRDER TYPE XX-INCH".

DESIGNER NOTES


SEE CHAPTER 30 STANDARDS FOR SINGLE SLOPE
PARAPET DETAILS.

DETAILS SHOWN ARE APPLICABLE FOR CONCRETE
ABUTMENTS. DETAILS TO BE MODIFIED FOR GRS
ABUTMENTS.

PRESTRESSED BOX GIRDER DETAILS 5	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

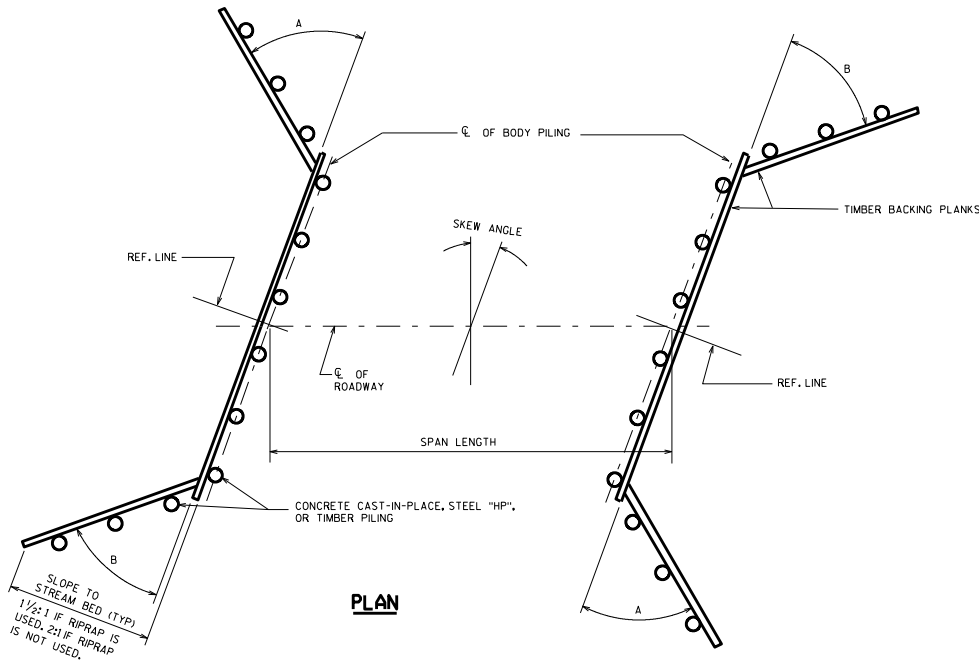

PLAN

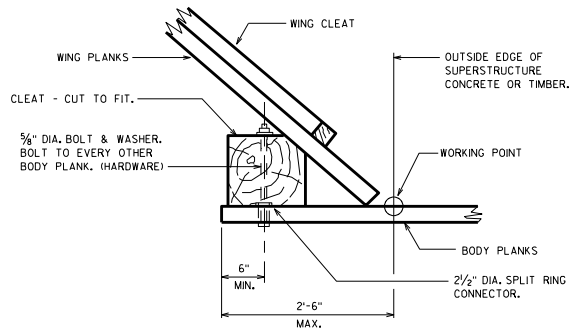

CORNER DETAIL

NOTES

- ALL TIMBER CONNECTORS AND HARDWARE EXCEPT THOSE OF MALLEABLE IRON SHALL BE GALVANIZED.
- TREAT ALL LUMBER AND TIMBER WITH ONE OF THE PRESERVATIVES RECOMMENDED IN THE STANDARD SPECIFICATIONS.
- TIE RODS SHALL BE COATED WITH THE COAL TAR OR BITUMASTIC COMPOUND USED FOR COVERING WING PILE ENDS.
- REFER TO AASHTO LRFD SPECIFICATIONS FOR LUMBER AND TIMBER DESIGN REQUIREMENTS.
- THE BODY BACKING PLANKS SHALL BE CONTINUOUS OVER 4 PILES (3 PANELS). PLANK SPLICES, IF REQUIRED SHALL BE AT THE CENTERLINE OF PILING AND ADJACENT SPLICES SHALL BE STAGGERED.
- ALL TIE RODS, TURNBUCKLES, NUTS AND WASHERS SHALL BE PAID FOR AS "STRUCTURAL STEEL CARBON".
- TIMBER CONNECTORS AND HARDWARE SHALL BE INCLUDED IN THE COST FOR "TREATED LUMBER AND TIMBER".
- ALTERNATE DETAILS MAY BE SUBMITTED USING EITHER GALVANIZED STEEL BRIDGE PLANK OR PRECAST CONCRETE PLANK IN LIEU OF TIMBER BACKED ABUTMENT PLANKING, SUBJECT TO APPROVAL BY THE ENGINEER.

SKREW ANGLE	"H" HEIGHT FROM STREAM BED OR BERM TO GRADE	WING ANGLE "A"	WING ANGLE "B"
0° TO 15° INCL.	H ≤ 10'-0"	45°	45°
0° TO 15° INCL.	* H > 10'-0"	50°	50°
15° TO 20° INCL.	H ≤ 10'-0"	55°	30°
15° TO 20° INCL.	* H > 10'-0"	50°	50°
OVER 20°	H ≤ 10'-0"	65°	25°
OVER 20°	● H > 10'-0"	65°	25°

- * USE TIE RODS ON WING PILING
- USE TIE RODS WITH A DEADMAN ON WING PILING.

SECTION	MOMENT CAPACITY (INCH - KIPS/FT.)
10 GAGE (6' x 2') GRADE A * ARMCO	22.9 (f _b = 18 K.S.I.)
7 GAGE (6' x 2') GRADE A * ARMCO	30.0 (f _b = 18 K.S.I.)


*ASTM A446

TIMBER ABUTMENTS GENERAL


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

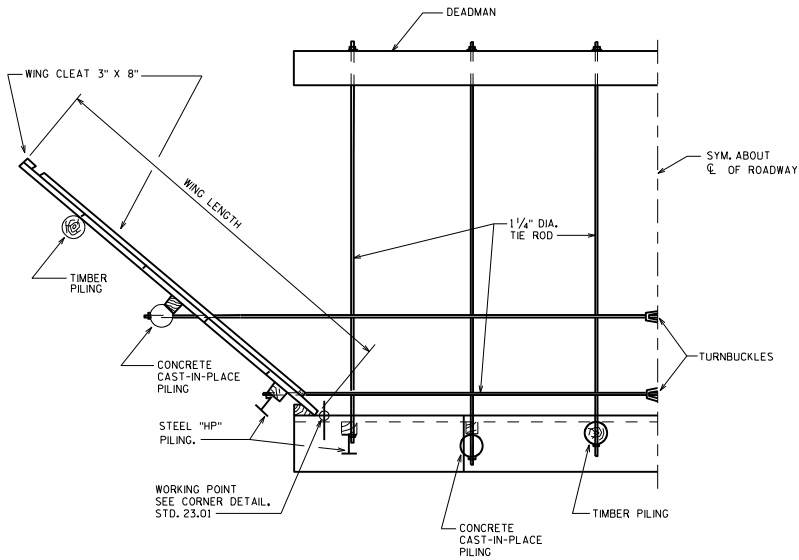

HALF PLAN

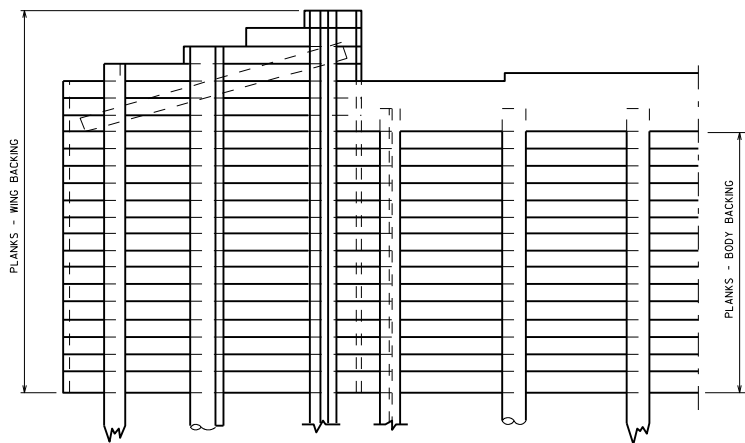


HALF ELEVATION

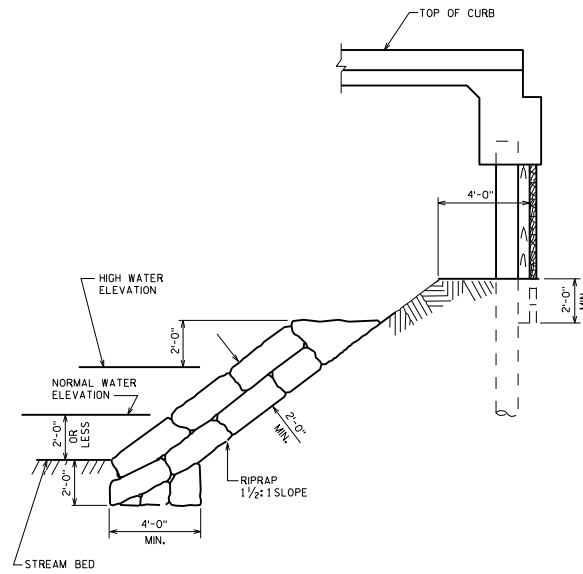


LONGITUDINAL SECTION WITH BERM

SHOWING TOE OF RIPRAP WHEN WATER IS 2'-0" OR LESS IN DEPTH.

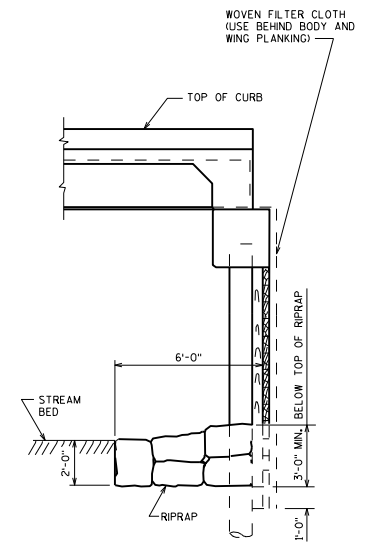

LONGITUDINAL SECTION WITHOUT BERM


WITHOUT BERM

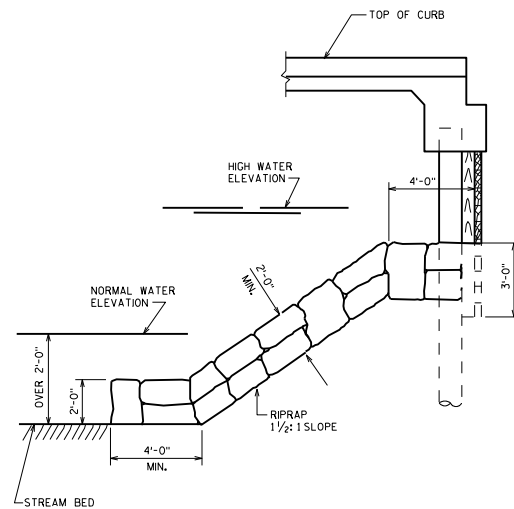

LONGITUDINAL SECTION WITH BERM


SHOWING TOE OF RIPRAP WHEN WATER IS OVER 2'-0" IN DEPTH.

TIMBER ABUTMENT	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

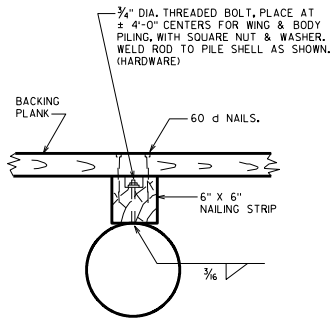


**CONCRETE
CAST-IN-PLACE PILING**

REFER TO STANDARD 1101 FOR SECTION
THRU REINFORCED CAST-IN-PLACE PILING
WHEN PILES ARE EXPOSED.

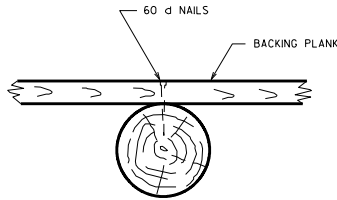


TIMBER PILING

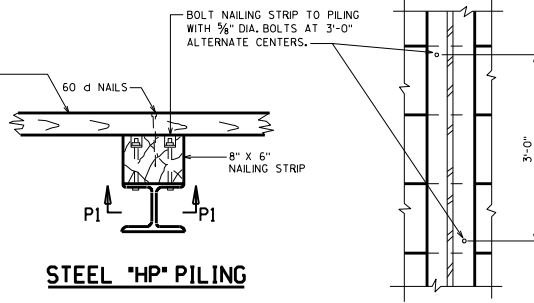


STEEL 'HP' PILING

SECTION P1

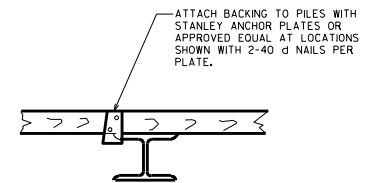


**STEEL 'HP' PILING
(ALTERNATE ATTACHMENT)**

BODY & WING PLANK CONNECTION DETAILS

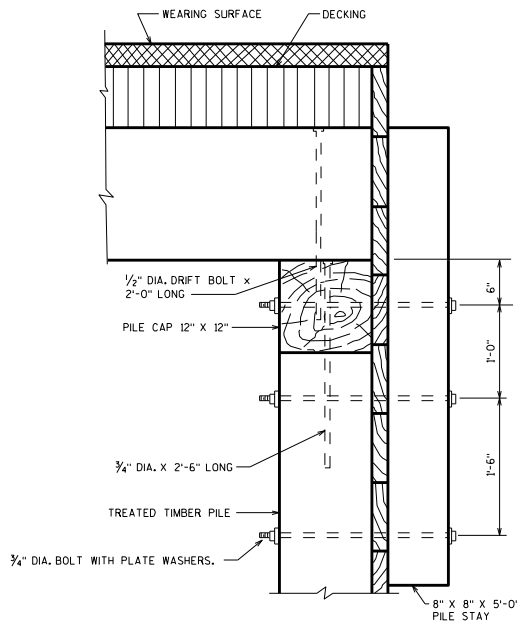

PILE CAP DETAIL

(TIMBER GIRDER)

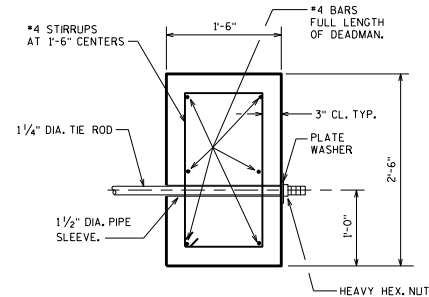


SECTION THRU DEADMAN

**TIMBER ABUTMENT
DETAILS**


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

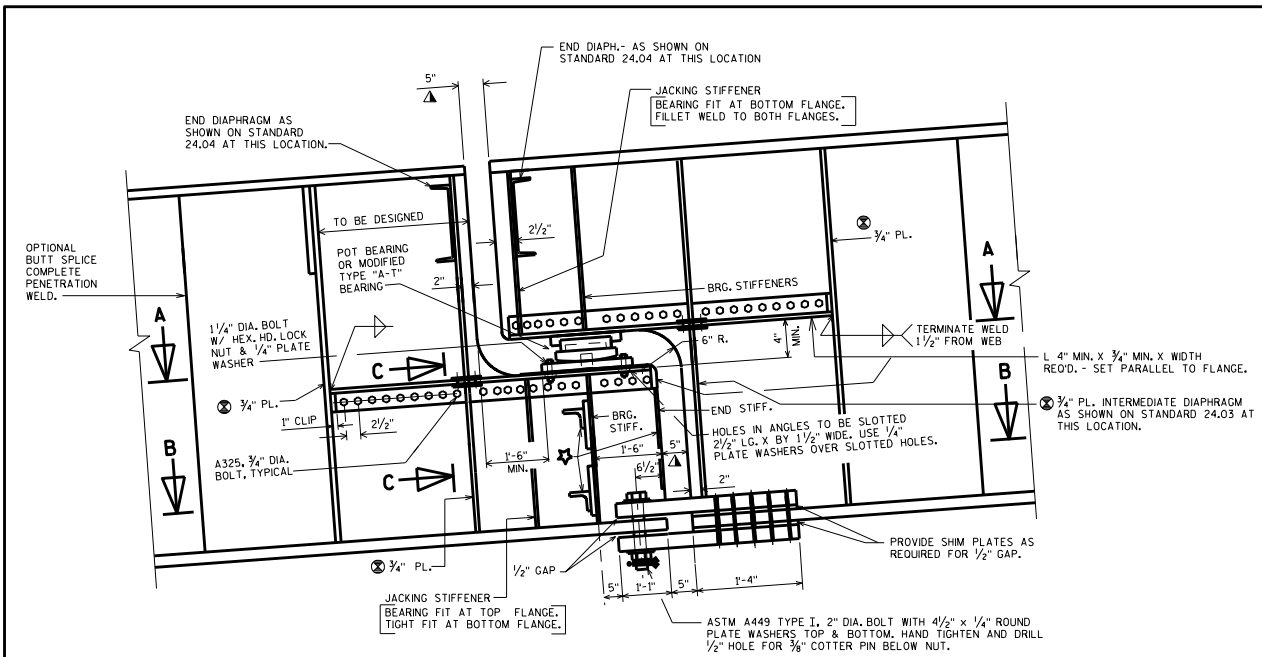


ELEVATION

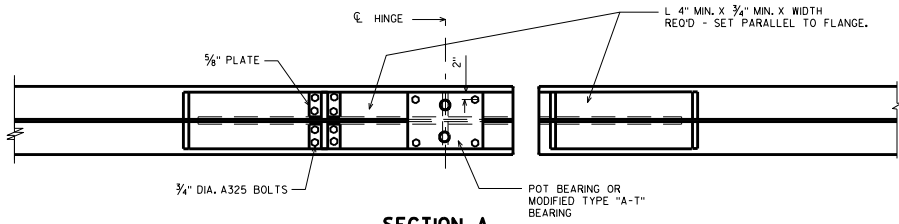

SECTION A

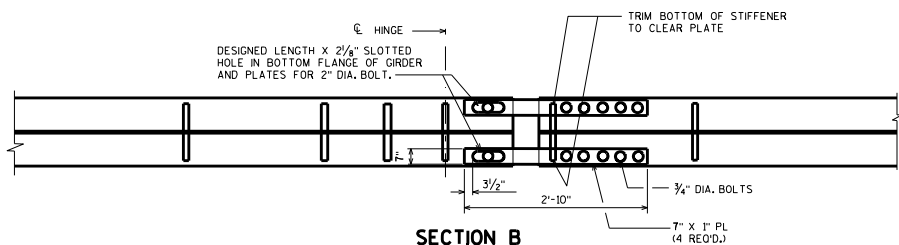

SECTION B

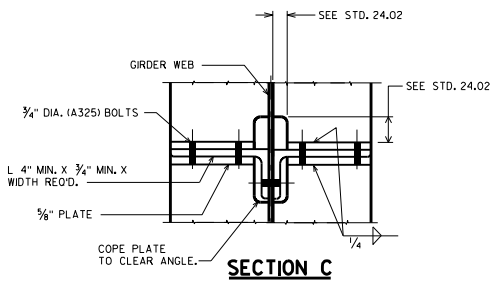

SECTION C

NOTES

FOR WELDING DETAILS SEE "CONNECTION STIFFENER DETAILS" ON STANDARD 24.02 MINIMUM PLATE SIZE SHOWN. DESIGN ACTUAL SIZE REQUIRED.

STIFFENERS AND BEARING PLATES ARE ALL PERPENDICULAR TO FLANGES. ANGLES ARE PARALLEL TO FLANGES.

DESIGNER NOTES

SIZE AND LENGTH OF ANGLES, NUMBER OF BOLTS THRU ANGLES, THICKNESS OF WEB PLATE, AND SIZE OF BEARING STIFFENERS AND JACKING STIFFENERS SHALL BE DETERMINED FROM AN ANALYSIS USING THE VERTICAL AND HORIZONTAL FORCES ACTING AT THE HINGE.


THE 5" OPENING BETWEEN GIRDER WEB AND FLANGE PLATES IS FOR FABRICATION ACTUAL OPENING IS BASED ON EXPANSION LENGTH AND TEMPERATURE.

SLOTTED HOLES OF 6" IN THE FLANGES AND CONNECTING BARS WILL ACCOMMODATE A TOTAL TEMPERATURE MOVEMENT OF 8" (+ 4" FROM 45°F). THE DESIGNER MAY NEED TO INCREASE OR DECREASE THE LENGTH OF THE SLOT TO MEET SPECIFIC JOB REQUIREMENTS.

CROSS FRAME UNDER BRG. AND END STIFFENER IS ONLY REQ'D. IF TOTAL WEB HEIGHT EXCEEDS 8'-0".

SEE BRIDGE MANUAL, SECTION 24.1 FOR CRITERIA FOR LOCATING HINGE JOINTS.

EXPANSION HINGE JOINT DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

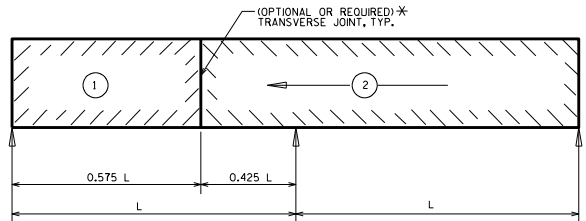

IDEAL DECK POUR SEQUENCE
(CONTINUOUS STEEL GIRDER - 2 SPANS SHOWN)


② INDICATES POUR NUMBER AND DIRECTION OF POUR

S = TOTAL NUMBER OF SPANS


P = TOTAL NUMBER OF SUPPORTS.

L = LENGTH OF END SPAN.


n = INTERIOR SPAN
END SPAN

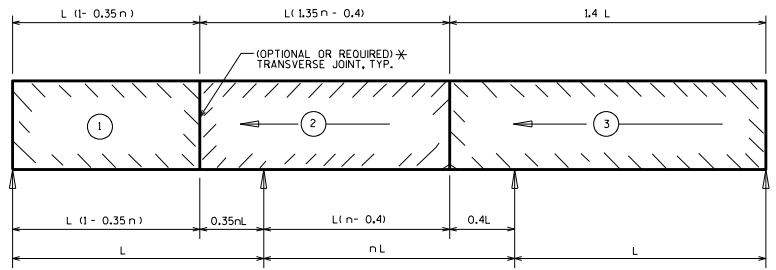

IDEAL DECK POUR SEQUENCE
(CONTINUOUS STEEL GIRDER - 3 SPANS SHOWN)

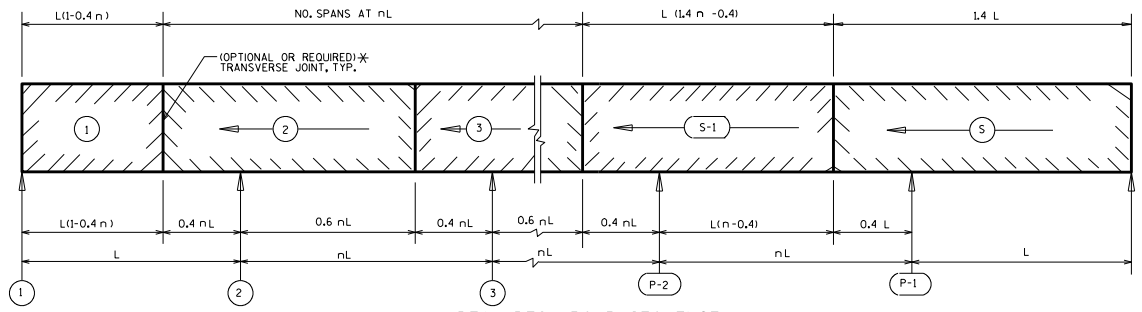

IDEAL DECK POUR SEQUENCE
(CONTINUOUS STEEL GIRDER - ANY NUMBER OF SPANS SHOWN)

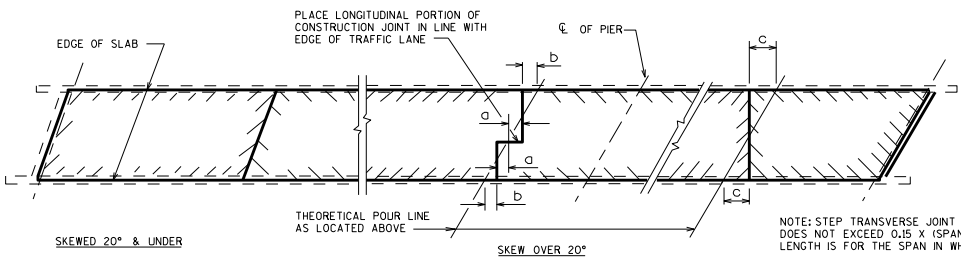

PLAN VIEW - SHOWING PLACEMENT OF TRANSVERSE CONSTRUCTION JOINTS

NOTE: STEP TRANSVERSE JOINT SO THAT "a", "b" OR "c" DOES NOT EXCEED 0.15 X (SPAN LENGTH), WHERE SPAN LENGTH IS FOR THE SPAN IN WHICH THE JOINT IS PLACED

NOTES

THE RATE OF PLACING CONCRETE SHALL EQUAL OR EXCEED 1/2 SPAN LENGTH PER HOUR BUT NEED NOT EXCEED 100 CU. YDS. PER HOUR. (REQUIRED ONLY FOR CONTINUOUS STEEL GIRDERS.)

SEQUENTIAL POURS MAY BE PLACED ON THE SAME DAY, UNLESS NOTED OTHERWISE.

THE CONTRACTOR MAY POUR THE ENTIRE DECK CONTINUOUSLY WHEN OPTIONAL TRANSVERSE CONSTRUCTION JOINTS ARE SHOWN ON THE PLANS. THE CONTRACTOR MAY SUBMIT AN ALTERNATE POURING SEQUENCE SUBJECT TO THE APPROVAL OF THE STRUCTURES DESIGN SECTION. (NOTE APPLICABLE WHEN OPTIONAL TRANSVERSE CONSTRUCTION JOINTS ARE SHOWN)

THE CONTRACTOR SHALL POUR THE ENTIRE DECK PER THE DECK POUR SEQUENCE. REQUIRED TRANSVERSE CONSTRUCTION JOINTS ARE SHOWN ON THE PLANS. THE CONTRACTOR MAY SUBMIT AN ALTERNATE POURING SEQUENCE SUBJECT TO THE APPROVAL OF THE STRUCTURES DESIGN SECTION. (NOTE REQUIRED WHEN REQUIRED TRANSVERSE CONSTRUCTION JOINTS ARE SHOWN)

DESIGNER NOTES

* THE DESIGNER SHALL DETERMINE IF TRANSVERSE JOINTS ARE OPTIONAL OR REQUIRED.

OPTIONAL TRANSVERSE CONSTRUCTION JOINTS SHALL BE DETAILED ON THE PLANS TO LIMIT THE VOLUME OF POUR TO < 600 CU. YDS. IN URBAN AREAS AND < 300 CU. YDS. IN OTHER AREAS. GENERALLY FOR STEEL GIRDER SUPERSTRUCTURES LOCATE THE TRANSVERSE JOINTS AT THE 0.6 POINT (CONCRETE IN 60% OF SPAN) AND FOR PRESTRESS GIRDER SUPERSTRUCTURES LOCATE JOINTS NEAR THE 0.75 POINT. (CONCRETE IN 75% OF SPAN) CONSIDER CUT-OFF POINTS OF CONTINUITY REINFORCING STEEL WHEN LOCATING JOINTS FOR PRESTRESS GIRDER SUPERSTRUCTURES. LOCATION OF JOINTS IN STEEL GIRDER SUPERSTRUCTURES MAY VARY IF DEFLECTIONS ARE INFLUENCED BY IN SPAN HINGES OR UNUSUAL SPAN LENGTH RATIOS. CHECK WITH THE STRUCTURES DEVELOPMENT SECTION FOR ADDITIONAL INFORMATION.


REQUIRED TRANSVERSE CONSTRUCTION JOINTS SHALL BE DETAILED ON THE PLANS ONLY WHEN REQUIRED BY DESIGN. SEQUENTIAL STAGES, AS DISCUSSED IN SECTION 24.12.2, REQUIRE AT LEAST 48 HOURS BETWEEN POURS. ALL PLACEMENT REQUIREMENTS SHALL BE NOTED ON THE PLANS.

DETAIL TRANSVERSE CONSTRUCTION JOINTS 5'-0" FROM CL OF IN SPAN HINGES, (ONE ON EACH SIDE OF HINGE) THE CONCRETE BETWEEN THESE JOINTS SHOULD BE THE LAST POUR PLACED.

WHEN THE WIDTH OF SLAB IS GREATER THAN 90 FEET, A LONGITUDINAL CONSTRUCTION JOINT SHALL BE DETAILED. LOCATE LONGITUDINAL CONSTRUCTION JOINT ALONG EDGE OF LAINE AND AT LEAST 6 INCHES FROM EDGE OF TOP FLANGE OF GIRDER.

FOR GRADES OVER 3% THE PREFERRED DIRECTION OF POUR IS UPHILL.

AN ALTERNATE POURING SEQUENCE IS TO POUR THE DL POSITIVE MOMENT AREAS AND THEN THE DL NEGATIVE MOMENT AREAS. THE SEQUENCE MAY BE STARTED ANYWHERE ON THE BRIDGE.

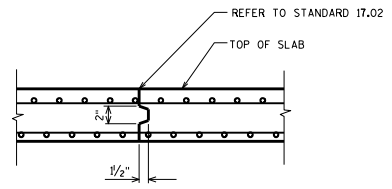

SECTION THRU TRANSVERSE OR LONGITUDINAL JOINT

SLAB POURING SEQUENCE	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

LENGTH OF PLATE "C"	TOTAL LOAD KIPS	PLATE C			PLATE D			HEIGHT FEET
		X	Y	Z	X	Y	Z	
10"	215	5"	2 3/8"	10"	8"	1 3/4"	1'-7"	0.354
12"	260	5"	2 3/8"	1'-0"	9"	1 3/4"	1'-9"	0.354
280	5"	2 3/8"	1'-0"	10"	2 3/8"	1'-9"	0.406	
14"	280	5"	1 3/4"	1'-2"	9"	1 3/4"	1'-11"	0.318
335	5"	2 3/8"	1'-2"	11"	2 3/8"	1'-11"	0.406	
385	5"	2 3/8"	1'-2"	1'-1"	2 3/8"	1'-11"	0.448	
410	5"	2 3/8"	1'-2"	1'-3"	2 3/8"	2'-0"	0.448	
16"	275	5"	1 3/4"	1'-4"	8"	1 3/4"	2'-1"	0.318
330	5"	1 3/4"	1'-4"	10"	2 3/8"	2'-1"	0.370	
390	5"	2 3/8"	1'-4"	1'-0"	2 3/8"	2'-1"	0.406	
465	5"	2 3/8"	1'-4"	1'-2"	2 3/8"	2'-2"	0.448	
18"	490	5"	2 3/8"	1'-4"	1'-4"	3 3/8"	2'-2"	0.490
325	5"	1 3/4"	1'-6"	9"	1 3/4"	2'-3"	0.318	
390	5"	1 3/4"	1'-6"	11"	2 3/8"	2'-3"	0.370	
465	5"	2 3/8"	1'-6"	1'-1"	2 3/8"	2'-4"	0.448	
495	5"	2 3/8"	1'-6"	1'-2"	2 3/8"	2'-4"	0.448	
560	5"	2 3/8"	1'-6"	1'-4"	3 3/8"	2'-4"	0.490	
20"	350	5"	1 3/4"	1'-8"	9"	1 3/4"	2'-5"	0.318
380	5"	1 3/4"	1'-8"	10"	2 3/8"	2'-5"	0.370	
460	5"	2 3/8"	1'-8"	1'-0"	2 3/8"	2'-6"	0.406	
530	5"	2 3/8"	1'-8"	1'-2"	2 3/8"	2'-6"	0.448	
600	5"	2 3/8"	1'-8"	1'-4"	3 3/8"	2'-6"	0.490	
640	5"	2 3/8"	1'-8"	1'-6"	3 3/8"	2'-6"	0.531	
22"	405	5"	1 3/4"	1'-10"	10"	2 3/8"	2'-7"	0.370
490	5"	1 3/4"	1'-10"	1'-0"	2 3/8"	2'-8"	0.370	
565	5"	2 3/8"	1'-10"	1'-2"	2 3/8"	2'-8"	0.448	
635	5"	2 3/8"	1'-10"	1'-4"	3 3/8"	2'-8"	0.490	
705	5"	2 3/8"	1'-10"	1'-6"	3 3/8"	2'-8"	0.531	
720	5"	2 3/8"	1'-10"	1'-8"	3 3/8"	2'-8"	0.531	


ANCHOR BOLT NOTES

FOR SPAN LENGTHS UP TO 100'-0":
USE A TYPE I MASONRY PLATE "D" WITH
(2) - 1/2" DIA. x 1'-5" LONG ANCHOR BOLTS.

FOR SPAN LENGTHS FROM 100'-0" UP TO 150'-0":
USE A TYPE I MASONRY PLATE "D" WITH
(2) - 1/2" DIA. x 1'-10" LONG ANCHOR BOLTS.


FOR SPAN LENGTHS GREATER THAN 150'-0":
USE A TYPE II MASONRY PLATE "D" WITH
(4) - 1/2" DIA. x 1'-10" LONG ANCHOR BOLTS.

CHECK THAT ANCHOR BOLTS PROVIDE ADEQUATE
HORIZONTAL CAPACITY.

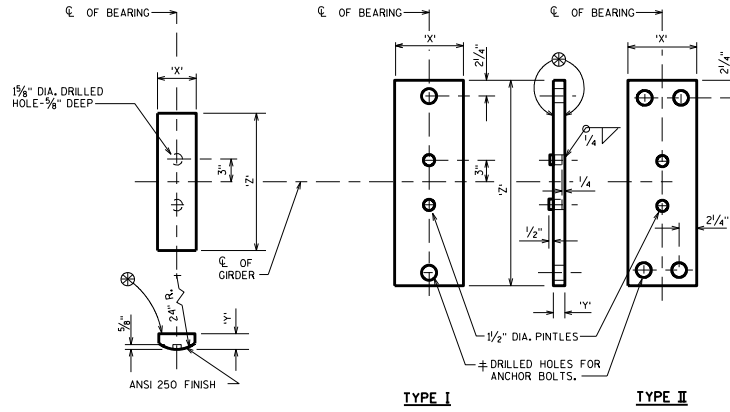


ROCKER PLATE "C"

MASONRY PLATE "D"

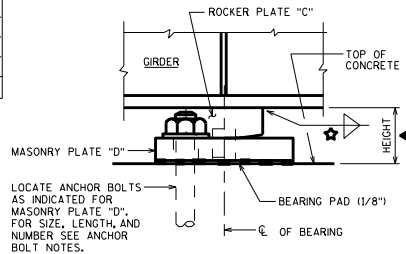

FIXED BEARING ASSEMBLY

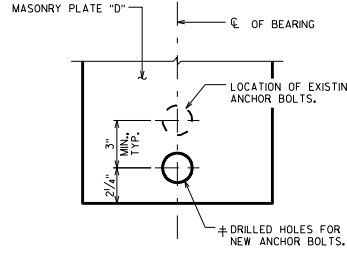

MASONRY PLATE "D" BEARING REPLACEMENTS

BEARING NOTES

ALL BEARINGS ARE SYMMETRICAL ABOUT CL OF GIRDER AND CL OF BEARING.

IN LIEU OF USING SHIM PLATES, FABRICATOR MAY INCREASE THICKNESS OF MASONRY PLATE "D" BY THE SHIM PLATE THICKNESS.

ALL STRUCTURAL STEEL BEARING PLATES SHALL BE FLAT ROLLED STEEL PLATES WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL.

ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS.

ALL FINISHED SURFACES SHALL BE MACHINE FINISHED BY AN AUTOMATIC PROCESS.

ANCHOR BOLTS SHALL BE THREADED 3". PROVIDE ONE STANDARD WROUGHT WASHER AND ONE HEX NUT PER BOLT. PROJECT ANCHOR BOLTS, MASONRY PLATE "D" THICKNESS + 2/4", ABOVE TOP OF CONCRETE.

ALL MATERIAL IN BEARINGS, INCLUDING SHIM PLATES, BUT EXCLUDING PINTLES, ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 50W.

STEEL PINTLES SHALL CONFORM TO ASTM A449 OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.

ALL MATERIAL IN TYPE "A" BEARINGS, INCLUDING SHIM PLATES AND BEARING PADS, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "BEARING ASSEMBLIES FIXED B-...", EACH.

CHAMFER TOP OF PINTLES 1/8". DRILL HOLES FOR ALL PINTLES IN MASONRY PLATE "D" FOR A DRIVING FIT.

PROVIDE 1/4" THICK BEARING PAD THE SAME SIZE AS MASONRY PLATE "D" FOR EACH BEARING.

CHAMFER ANCHOR BOLTS PRIOR TO THREADING.

ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 36, OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.

ANCHOR BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153, CLASS C.

ROCKER PLATE "C" SHALL BE SHOP PAINTED WITH A WELDABLE PRIMER.

MASONRY PLATE "D" SHALL BE GALVANIZED.

PLACE SHIM PLATES BETWEEN BEARING PAD AND MASONRY PLATE "D". PLATES SHALL HAVE "X" AND "Z" DIMENSIONS THAT MATCH MASONRY PLATE "D".

DRILLED HOLES FOR ANCHOR BOLTS IN MASONRY PLATE "D" SHALL HAVE A DIAMETER 1/8" LARGER THAN ANCHOR BOLT.

FINISH THESE SURFACES TO ANSI 250 IF "Y" DIMENSION IS GREATER THAN 2".

DESIGNER NOTES

HEIGHT OF BEARINGS GIVEN IN TABLE INCLUDES 1/8" BEARING PAD.

DETAIL SHIM PLATES AS DESCRIBED IN NOTES ON STANDARD 24.02.

REFER TO THE DETAILS BELOW FOR THE USE OF BEVELED ROCKER PLATE "C" ON GRADES GREATER THAN 3% AND ALSO CLEARANCE REQUIREMENTS.

FOR WELD SIZE, REFER TO STANDARD 24.02


ADJUST HEIGHT IF BEVELED ROCKER PLATE "C" IS USED.

FOR BEARING REPLACEMENTS, DESIGNER SHALL UTILIZE A WIDER BEARING THAN THE EXISTING GIRDER BOTTOM FLANGE WIDTH TO ALLOW FOR FIELD WELDING CLEARANCES.

CALCULATE THE REACTION AT THE BEARINGS DUE TO "TOTAL LOADS". USE THE AASHTO LRFD SERVICE I LOAD COMBINATION. CONSIDER ONLY DEAD LOAD (DC + DW) AND HL-93 LIVE LOADS (LL), INCLUDING A 33% DYNAMIC LOAD ALLOWANCE (IM).

THE VALUES IN THE TABLES ARE THE BEARING CAPACITIES FOR "TOTAL LOAD" (DC + DW + (LL + IM)).


SELECT A BEARING THAT HAS A CAPACITY GREATER THAN OR EQUAL TO THE CALCULATED REACTION FOR "TOTAL LOADS".

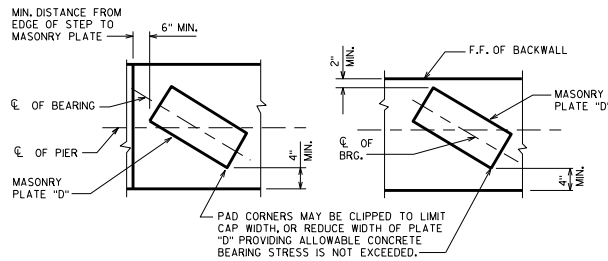

AT SKEWED PIER

AT SKEWED ABUTMENTS

CLEARANCE DIAGRAM

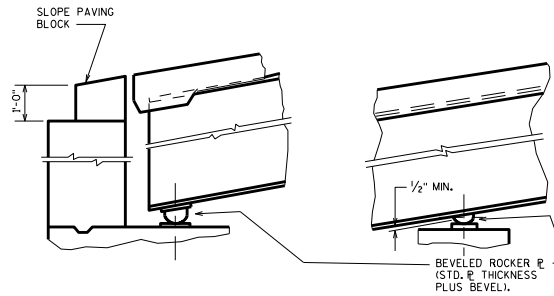

AT EXPANSION BRG.

AT FIXED BRG.


BEVELED ROCKERS WITH GRADES GREATER THAN 3%

**FIXED BEARING DETAILS
TYPE 'A' - STEEL GIRDERS**


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*


DATE:
7-16

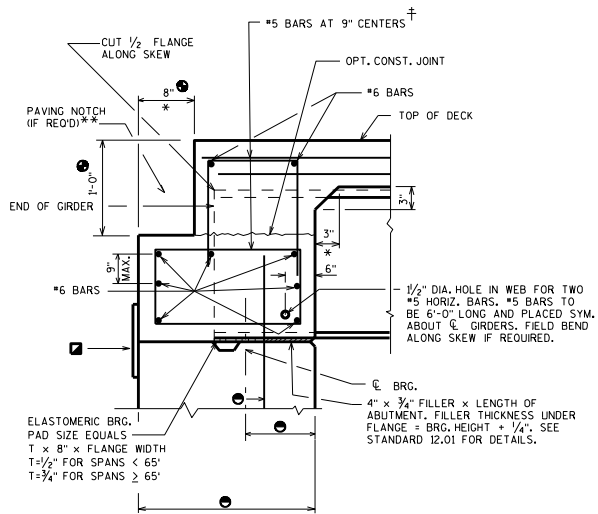

**STEEL GIRDER WITH
FIXED SEAT**

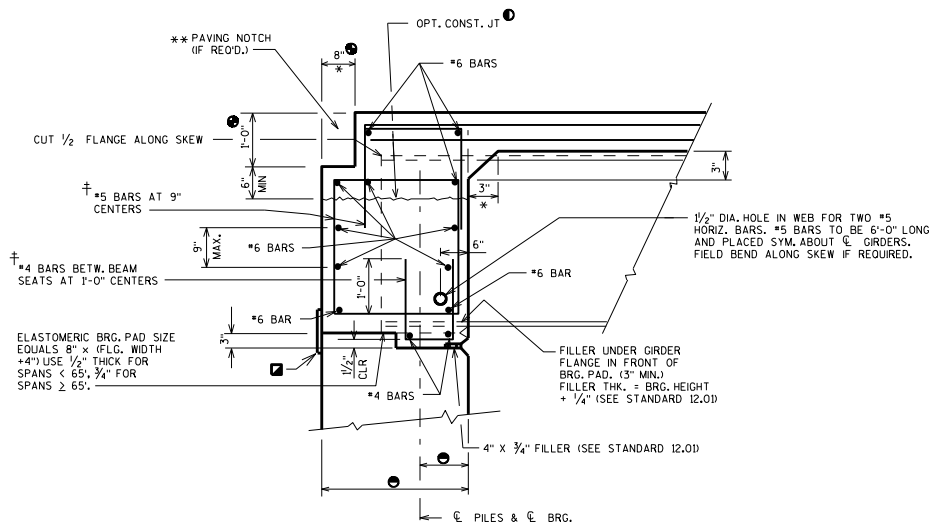

**STEEL GIRDER WITH
SEMI-EXPANSION SEAT**

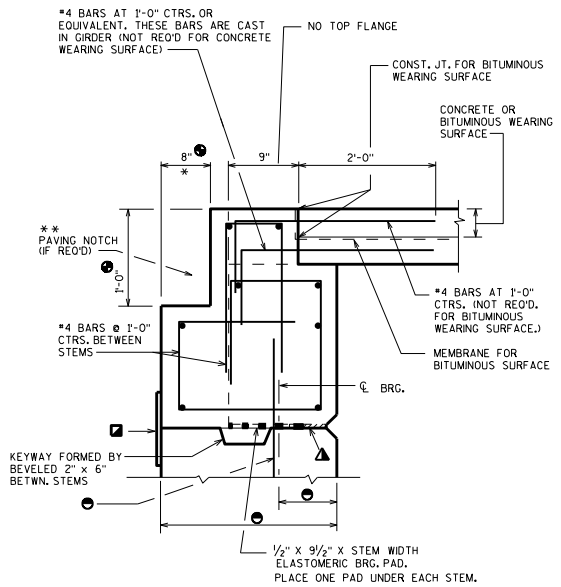

**PRECAST DOUBLE TEE OR
MULTI-STEM SECTION**


- NOTES**
- FOR SKEWED STRUCTURES CAST END OF PRECAST TEE ALONG SKEW.
 - ▲ 3/4" x 4" FILLER x LENGTH OF ABUT. PLACE ADDITIONAL FILLER BETWEEN BRG. PAD AND 3/4" x 4" FILLER.
 - * DIMENSION IS TAKEN NORMAL TO C. SUBSTRUCTURE UNITS.
 - 1'-6" RUBBERIZED MEMBRANE WATERPROOFING
 - † BARS PLACED PARALLEL TO GIRDERS. SPACING PERPENDICULAR TO C. GIRDERS.
- DESIGNER NOTES**
- SEE STANDARD 19.55 FOR PRESTRESSED BOX GIRDER BEARING DETAILS.
 - ① THE USE OF THIS OPT. CONST. JOINT IS NOT RECOMMENDED FOR SKEWS OVER 15° WHEN LARGE DEADLOAD END ROTATION IS ANTICIPATED.
 - ** USE PAVING NOTCH ON ALL U.S.H. BRIDGES, S.T.H. BRIDGES, I.H. BRIDGES & ON C.T.H. BRIDGES WITH CONCRETE APPROACHES.
 - ② PAVING NOTCH IS 1'-0" WIDE BY 1'-4" DEEP IF STRUCTURAL APPROACH SLAB (STD. 12.10) IS USED.
 - ③ SEE STD. 12.01

**BRG. DETAILS FOR STEEL GDERS.
AND PRECAST UNITS ON A1
ABUTMENTS**

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

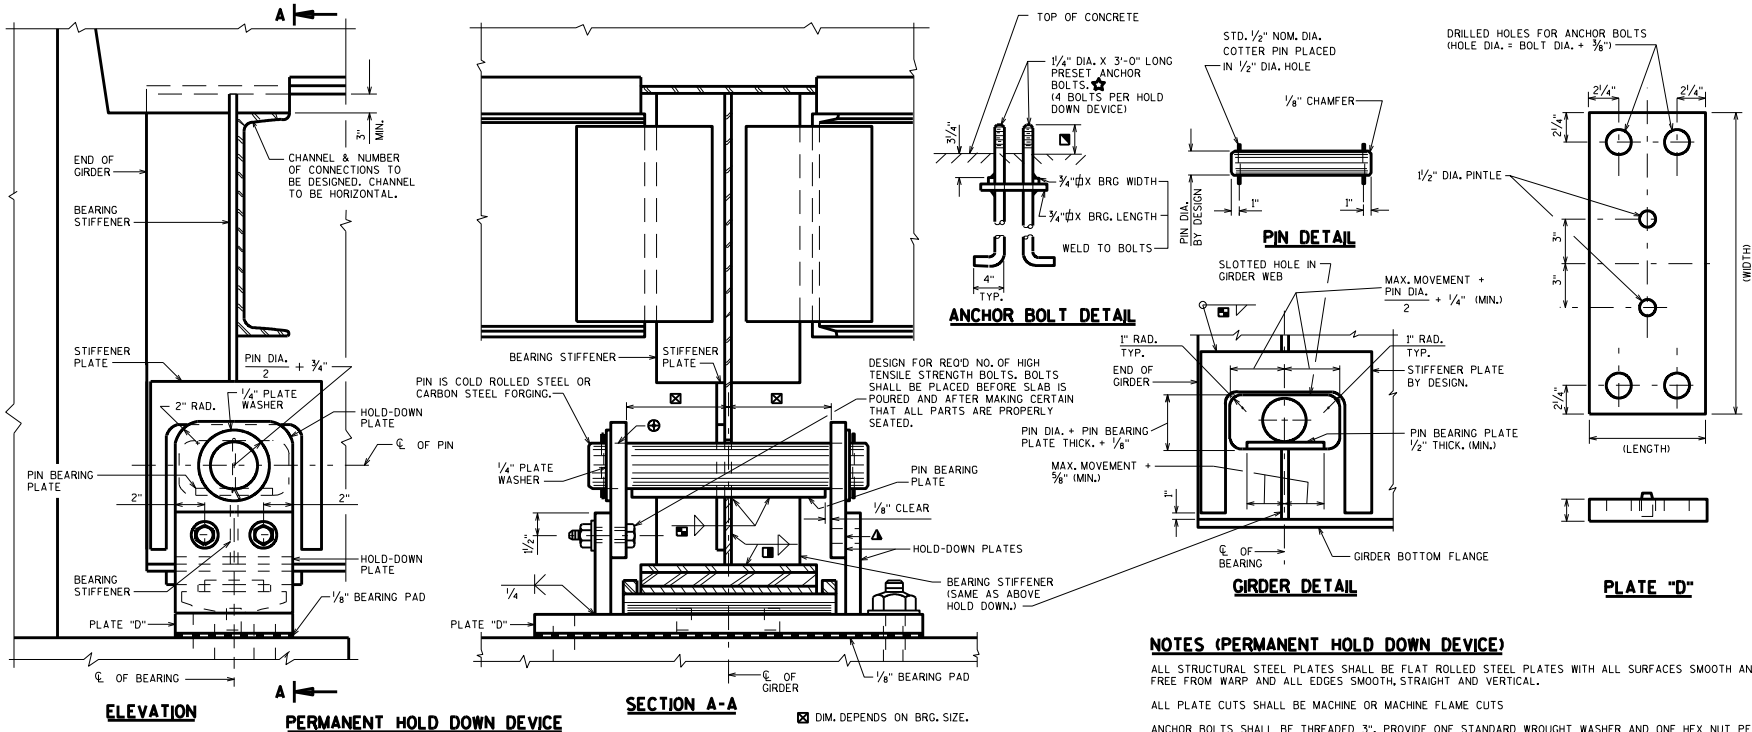


ELEVATION

PERMANENT HOLD DOWN DEVICE

SECTION A-A

☒ DIM. DEPENDS ON BRG. SIZE.


WHEN REQUIRED, HOLD DOWN DEVICES SHALL BE PLACED SYMMETRICALLY ABOUT LONGITUDINAL \bar{C} OF FRAMING PLAN. MAXIMUM SPACING OF HOLD DOWNS SHALL BE AT ALTERNATE GIRDERS. HOLD DOWN DEVICE TO BE DESIGNED FOR MINIMUM UPLIFT CAPACITY OF 20 KIPS.

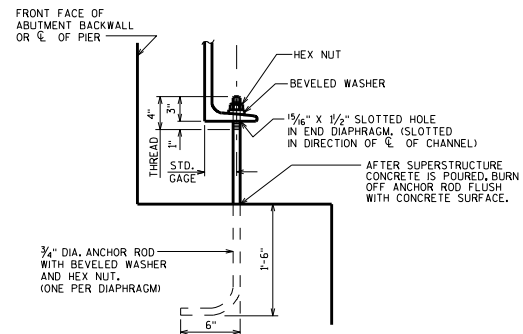

ELEVATION - NEW CONSTRUCTION

TEMPORARY HOLD DOWN DEVICES SHALL BE PLACED AT THAT END OF ALL CONTINUOUS STEEL GIRDER UNITS WHERE THE SLAB POUR TERMINATES, EXCEPT WHERE PERMANENT HOLD DOWN DEVICES ARE PLACED AT THIS LOCATION. LOCATE 1'-6" (NORMAL) OFF \bar{C} OF GIRDER. TO BE PAID FOR AS "STRUCTURAL CARBON STEEL".

TEMPORARY HOLD DOWN DEVICE

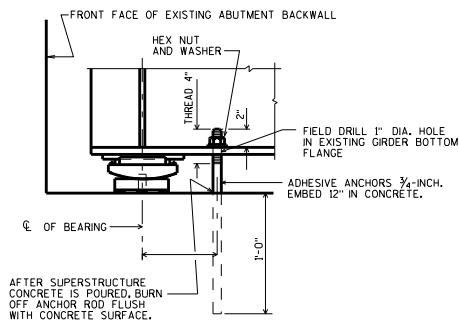

ELEVATION - DECK REPLACEMENT

PLACE ONE ANCHOR ROD PER GIRDER AT ABUTMENT WHERE SLAB POUR TERMINATES. LOCATE 4" (NORMAL) OFF \bar{C} OF GIRDER. ANCHOR ROD, NUT, WASHER, AND DRILLED HOLE IN GIRDER FLANGE SHALL BE PAID FOR AS "ADHESIVE ANCHORS 3/4-INCH".


NOTES (PERMANENT HOLD DOWN DEVICE)

- ALL STRUCTURAL STEEL PLATES SHALL BE FLAT ROLLED STEEL PLATES WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL.
- ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS
- ANCHOR BOLTS SHALL BE THREADED 3". PROVIDE ONE STANDARD WROUGHT WASHER AND ONE HEX NUT PER BOLT. CHAMFER TOP OF ANCHOR BOLTS PRIOR TO THREADING.
- ANCHOR BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153, CLASS C.
- THE MATERIAL FOR THE HOLD-DOWN PLATES SHALL CONFORM TO ASTM A709 GRADE 50W.
- ALL MATERIAL WELDED TO THE GIRDERS, WHICH INCLUDES BEARING STIFFENERS, STIFFENER PLATE, AND PIN BEARING PLATE, SHALL MATCH THE STEEL REQUIREMENTS OF THE WEB AT THAT LOCATION.
- ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 36 OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.
- ALL MATERIAL IN HOLD DOWN DEVICES, WHICH INCLUDES HOLD-DOWN PLATES, HIGH TENSILE STRENGTH BOLTS, PINS AND ANCHOR BOLTS, SHALL BE INCLUDED IN THE UNIT PRICE BID FOR "BEARING ASSEMBLIES EXPANSION B-...".
- ALL MATERIAL WELDED TO THE GIRDERS, WHICH INCLUDES BEARING STIFFENERS, STIFFENER PLATE, AND PIN BEARING PLATE, SHALL BE INCLUDED IN THE BID ITEM USED FOR THE STEEL GIRDER QUANTITIES.
- ★ FOR REPLACEMENT BEARINGS, ANCHOR BOLTS SHALL BE 1/2" DIAMETER X 3'-0" LONG AND FULLY THREADED ADHESIVE ANCHORS. ANCHOR BOLTS SHALL BE PAID FOR AS "ADHESIVE ANCHORS 1 1/2-INCH". EMBED IN CONCRETE AS DETAILED.
- ▲ SHOP DRILL HOLES IN HOLD-DOWN PLATE ATTACHED TO PLATE "D". FIELD DRILL HOLES IN UPPER HOLD-DOWN PLATE AFTER ALIGNING IN THE FIELD.
- ☑ SEE STANDARD 24.02 FOR TABLE OF FILLET WELD SIZES.
- ☑ SEE STANDARD 24.02 FOR WELD DETAILS SHOWING BEARING STIFFENER CONNECTION TO WEB AND FLANGE.
- ☑ PROJECT ANCHOR BOLTS, PLATE "D" THICKNESS + 2/4", ABOVE TOP OF CONCRETE.
- ☑ HOLES FOR PIN IN HOLD-DOWN PLATES AND PLATE WASHERS SHALL BE AS STATED IN STANDARD SPECIFICATION 506.3.17.

HOLD DOWN DEVICES

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

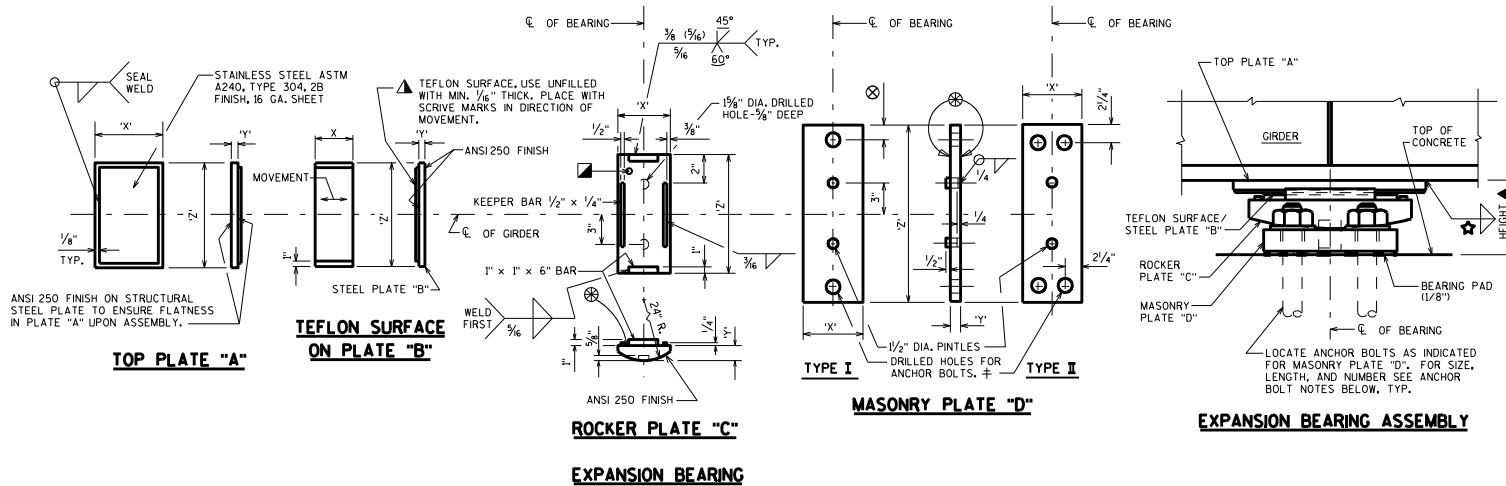

BEARING NOTES

- ALL BEARINGS ARE SYMMETRICAL ABOUT \bar{C} OF GIRDER AND \bar{C} OF BEARING.
- FINISH THESE SURFACES TO ANSI 250 IF "Y" DIMENSION IS GREATER THAN 2".
- ANCHOR BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153, CLASS C.
- ROCKER PLATE "C" AND MASONRY PLATE "D" SHALL BE GALVANIZED, TOP PLATE "A" AND STEEL PLATE "B" SHALL BE SHOP PAINTED. USE A WELDABLE PRIMER ON TOP PLATE "A". DO NOT PAINT STAINLESS STEEL OR TEFLON SURFACES.
- ALL MATERIAL IN BEARINGS, INCLUDING SHIM PLATES, BUT EXCLUDING STAINLESS STEEL SHEET, TEFLON SURFACE, PINTLES, ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 50W.
- IN LIEU OF USING SHIM PLATES, FABRICATOR MAY INCREASE THICKNESS OF TOP PLATE "A" OR MASONRY PLATE "D" BY THE SHIM PLATE THICKNESS.
- DIMENSION IS 2" WHEN 1/4" DIA. ANCHOR BOLTS ARE USED AND 2 1/4" WHEN 1/2" DIA. ANCHOR BOLTS ARE USED.
- ALL MATERIAL IN TYPE "A-T" BEARINGS, INCLUDING SHIM PLATES AND BEARING PADS, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "BEARING ASSEMBLIES EXPANSION B-...", EACH.
- CHAMFER ANCHOR BOLTS PRIOR TO THREADING.
- ALL FINISHED SURFACES SHALL BE MACHINE FINISHED BY AN AUTOMATIC PROCESS.
- ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS.
- ALL STRUCTURAL STEEL BEARING PLATES SHALL BE FLAT ROLLED STEEL PLATES WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL.
- PROVIDE 1/8" THICK BEARING PAD THE SAME SIZE AS MASONRY PLATE "D" FOR EACH BEARING.
- ANCHOR BOLTS SHALL BE THREADED 3". PROVIDE ONE STANDARD WROUGHT WASHER AND ONE HEX NUT PER BOLT. PROTECT ANCHOR BOLTS, MASONRY PLATE "D" THICKNESS + 2/4", ABOVE TOP OF CONCRETE.
- CHAMFER TOP OF PINTLES 1/8". DRILL HOLES FOR ALL PINTLES IN MASONRY PLATE "D" FOR A DRIVING FIT.
- STEEL PINTLES SHALL CONFORM TO ASTM A449 OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.
- ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 36, OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.
- PLACE SHIM PLATES BETWEEN BEARING PAD AND MASONRY PLATE "D". PLATES SHALL HAVE "X" AND "Z" DIMENSIONS THAT MATCH MASONRY PLATE "D".
- PROVIDE A METHOD FOR HANDLING ROCKER PLATE "C" DURING GALVANIZING.
- BOND STEEL PLATE "B" AND TEFLON WITH ADHESIVE MATERIAL MEETING FEDERAL SPECIFICATION MMM-A-134, FEP FILM OR EQUAL.
- DRILLED HOLES FOR ANCHOR BOLTS IN MASONRY PLATE "D" SHALL HAVE A DIAMETER 3/16" LARGER THAN ANCHOR BOLT.
- AT INSTALLATION, ENSURE STAINLESS STEEL SLIDING FACE OF THE UPPER ELEMENT AND THE TFE SLIDING FACE OF THE LOWER ELEMENT HAVE THE SURFACE FINISH SPECIFIED AND ARE CLEAN AND FREE OF ALL DUST, MOISTURE, OR ANY OTHER FOREIGN MATTER.

10" BEARING

TOTAL LOAD (KIPS)	PLATE A			PLATE B			PLATE C			PLATE D			HEIGHT FEET
	X	Y	Z	X	Y	Z	X	Y	Z	X	Y	Z	
100	9"	5/8"	10"	5"	1/2"	10"	7"	1 1/8"	1'-0 1/4"	8"	1 1/2"	1'-8"	0.360
180	1'-1"	5/8"	10"	9"	1/2"	10"	11"	2 3/8"	1'-0 1/4"	8"	1 1/2"	1'-8"	0.438
260	1'-5"	5/8"	10"	1'-1"	1/2"	10"	1'-3"	3 3/8"	1'-0 1/4"	11"	2"	1'-8"	0.604

12" BEARING

TOTAL LOAD (KIPS)	PLATE A			PLATE B			PLATE C			PLATE D			HEIGHT FEET
	X	Y	Z	X	Y	Z	X	Y	Z	X	Y	Z	
125	9"	5/8"	1'-0"	5"	1/2"	1'-0"	7"	1 1/8"	1'-2 1/4"	8"	1 1/2"	1'-10"	0.360
175	11"	5/8"	1'-0"	7"	1/2"	1'-0"	9"	1 5/8"	1'-2 1/4"	8"	1 1/2"	1'-10"	0.401
275	1'-3"	5/8"	1'-0"	11"	1/2"	1'-0"	1'-1"	2 7/8"	1'-2 1/4"	11"	2"	1'-10"	0.521

14" BEARING

TOTAL LOAD (KIPS)	PLATE A			PLATE B			PLATE C			PLATE D			HEIGHT FEET
	X	Y	Z	X	Y	Z	X	Y	Z	X	Y	Z	
210	11"	5/8"	1'-2"	7"	1/2"	1'-2"	9"	1 5/8"	1'-4 1/4"	8"	1 1/2"	2'-0"	0.401
375	1'-5"	5/8"	1'-2"	1'-1"	1/2"	1'-2"	1'-3"	3 3/8"	1'-4 1/4"	1'-2"	2 7/8"	2'-0"	0.677
500	1'-9"	5/8"	1'-2"	1'-5"	1/2"	1'-2"	1'-7"	4 3/8"	1'-4 1/4"	1'-5"	3 3/8"	2'-1"	0.802

16" BEARING

TOTAL LOAD (KIPS)	PLATE A			PLATE B			PLATE C			PLATE D			HEIGHT FEET
	X	Y	Z	X	Y	Z	X	Y	Z	X	Y	Z	
245	11"	5/8"	1'-4"	7"	1/2"	1'-4"	9"	1 5/8"	1'-6 1/4"	8"	1 1/2"	2'-2"	0.401
370	1'-3"	5/8"	1'-4"	11"	1/2"	1'-4"	1'-1"	2 7/8"	1'-6 1/4"	1'-0"	2 3/8"	2'-3"	0.552
525	1'-7"	5/8"	1'-4"	1'-3"	1/2"	1'-4"	1'-5"	3 3/8"	1'-6 1/4"	1'-4"	3 3/8"	2'-3"	0.719
575	1'-9"	5/8"	1'-4"	1'-5"	1/2"	1'-4"	1'-7"	4 3/8"	1'-6 1/4"	1'-6"	3 3/8"	2'-3"	0.844

18" BEARING

TOTAL LOAD (KIPS)	PLATE A			PLATE B			PLATE C			PLATE D			HEIGHT FEET
	X	Y	Z	X	Y	Z	X	Y	Z	X	Y	Z	
280	11"	5/8"	1'-6"	7"	1/2"	1'-6"	9"	1 5/8"	1'-8 1/4"	9"	2"	2'-4"	0.443
360	1'-1"	5/8"	1'-6"	9"	1/2"	1'-6"	11"	2 3/8"	1'-8 1/4"	11"	2"	2'-4"	0.479
600	1'-7"	5/8"	1'-6"	1'-3"	1/2"	1'-6"	1'-5"	3 3/8"	1'-8 1/4"	1'-5"	3 3/8"	2'-5"	0.719
650	1'-11"	5/8"	1'-6"	1'-7"	1/2"	1'-6"	1'-9"	4 3/8"	1'-8 1/4"	1'-10"	3 3/8"	2'-5"	0.844

20" BEARING

TOTAL LOAD (KIPS)	PLATE A			PLATE B			PLATE C			PLATE D			HEIGHT FEET
	X	Y	Z	X	Y	Z	X	Y	Z	X	Y	Z	
225	9"	5/8"	1'-8"	5"	1/2"	1'-8"	7"	1 1/8"	1'-10 1/4"	8"	1 1/2"	2'-6"	0.360
315	11"	5/8"	1'-8"	7"	1/2"	1'-8"	9"	1 5/8"	1'-10 1/4"	9"	2"	2'-6"	0.443
495	1'-3"	5/8"	1'-8"	11"	1/2"	1'-8"	1'-1"	2 7/8"	1'-10 1/4"	1'-1"	2 7/8"	2'-7"	0.594
675	1'-7"	5/8"	1'-8"	1'-3"	1/2"	1'-8"	1'-5"	3 3/8"	1'-10 1/4"	1'-6"	3 3/8"	2'-7"	0.760
705	1'-11"	5/8"	1'-8"	1'-7"	1/2"	1'-8"	1'-9"	4 3/8"	1'-10 1/4"	1'-11"	3 3/8"	2'-7"	0.844

DESIGNER NOTES

- HEIGHT OF BEARINGS GIVEN IN TABLES INCLUDES 1/4" BEARING PAD, 1/8" GAGE STAINLESS STEEL SHEET AND 1/16" TEFLON SURFACE.
- DETAIL SHIM PLATES AS DESCRIBED IN NOTES ON STANDARD 24.02.
- SEE STANDARD 27.02 FOR THE USE OF BEVELED ROCKER PLATE "C" ON GRADES GREATER THAN 3% AND ALSO CLEARANCE REQUIREMENTS.
- AT ABUTMENTS, WHEN THE "X" DIMENSION OF PLATE "A" EXCEEDS 11", INCREASE STANDARD DISTANCE FROM \bar{C} OF BEARING TO END OF GIRDER.

- ★ FOR WELD SIZE, REFER TO STANDARD 24.02.
- ▲ ADJUST HEIGHT IF BEVELED ROCKER PLATE "C" IS USED.

FOR BEARING REPLACEMENTS, DESIGNER SHALL UTILIZE A WIDER BEARING THAN THE EXISTING GIRDER BOTTOM FLANGE WIDTH TO ALLOW FOR FIELD WELDING CLEARANCES.

FOR BEARING REPLACEMENTS, SEE STD. 27.02 FOR MINIMUM ANCHOR BOLT CLEARANCE INFORMATION.

CALCULATE THE REACTIONS AT THE BEARINGS DUE TO "TOTAL LOADS" AND ALSO "DEAD LOADS" ONLY. USE THE AASHTO LRFD SERVICE I LOAD COMBINATION. CONSIDER ONLY DEAD LOAD (DC + DW) AND HL-93 LIVE LOADS (LL), INCLUDING A 33% DYNAMIC LOAD ALLOWANCE (IM).

THE VALUES IN THE TABLES ARE THE BEARING CAPACITIES FOR "TOTAL LOAD" (DC + DW + LL + IM). TAKE 60% OF THE VALUES IN THE TABLES TO DETERMINE THE BEARING CAPACITIES FOR "DEAD LOAD" ONLY (DC + DW).

SELECT A BEARING THAT HAS A "TOTAL LOAD" CAPACITY GREATER THAN OR EQUAL TO THE CALCULATED "TOTAL LOAD" REACTION AND ALSO A "DEAD LOAD" CAPACITY GREATER THAN OR EQUAL TO THE CALCULATED "DEAD LOAD" REACTION.

ANCHOR BOLT NOTES


- FOR SPAN LENGTHS UP TO 100'-0": USE A TYPE I MASONRY PLATE "D" WITH (2) - 1 1/4" DIA. X 1'-5" LONG ANCHOR BOLTS.
- FOR SPAN LENGTHS FROM 100'-0" UP TO 150'-0": USE A TYPE I MASONRY PLATE "D" WITH (2) - 1 1/2" DIA. X 1'-10" LONG ANCHOR BOLTS.
- FOR SPAN LENGTHS GREATER THAN 150'-0": USE A TYPE II MASONRY PLATE "D" WITH (4) - 1 1/2" DIA. X 1'-10" LONG ANCHOR BOLTS.

CHECK THAT ANCHOR BOLTS PROVIDE ADEQUATE HORIZONTAL CAPACITY.

STAINLESS STEEL - TFE EXPANSION BEARING DETAILS TYPE 'A-T'

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

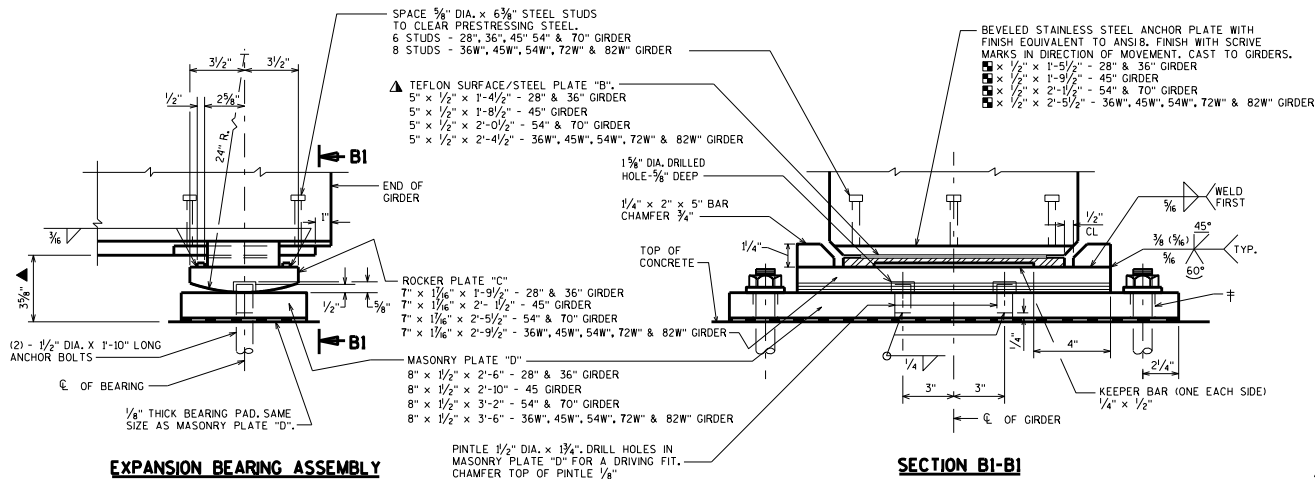

EXPANSION BEARING ASSEMBLY

SECTION BI-BI

BEARING NOTES

- ALL BEARINGS ARE SYMMETRICAL ABOUT \bar{C} OF GIRDER AND \bar{C} OF BEARING.
- ALL MATERIAL IN BEARINGS, BUT EXCLUDING STAINLESS STEEL PLATE, TEFLON SURFACE, PINTLES, ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 50W. STAINLESS STEEL PLATE SHALL CONFORM TO ASTM A240, TYPE 304.
- STEEL PINTLES SHALL CONFORM TO ASTM A449 OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.
- ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 36, OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.
- ALL STRUCTURAL STEEL BEARING PLATES SHALL BE FLAT ROLLED STEEL PLATES WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT, AND VERTICAL.
- ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS.
- ALL FINISHED SURFACES SHALL BE MACHINE FINISHED BY AN AUTOMATIC PROCESS.
- ANCHOR BOLTS SHALL BE THREADED 3". PROVIDE ONE STANDARD WROUGHT WASHER AND ONE HEX NUT PER BOLT. PROJECT ANCHOR BOLTS, MASONRY PLATE "D" THICKNESS + 2 $\frac{1}{4}$ " ABOVE TOP OF CONCRETE.
- CHAMFER ANCHOR BOLTS PRIOR TO THREADING.
- MASONRY PLATE "D", ROCKER PLATE "C", ANCHOR BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153, CLASS "C". STEEL PLATE "B" SHALL BE SHOP PAINTED, DO NOT PAINT TEFLON SURFACE.
- ALL MATERIAL IN "STEEL BEARINGS FOR PRESTRESSED CONCRETE GIRDERS", INCLUDING BEARING PADS, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "BEARING ASSEMBLIES EXPANSION B-1", EACH.
- † DRILLED HOLES FOR ANCHOR BOLTS IN MASONRY PLATE "D" SHALL HAVE A DIAMETER $\frac{3}{16}$ " LARGER THAN ANCHOR BOLT.
- ▲ TEFLON SURFACE, USE UNFILLED WITH MINIMUM $\frac{1}{16}$ " THICKNESS. PLACE WITH SCRIVE MARKS IN DIRECTION OF MOVEMENT. BOND STEEL PLATE "B" AND TEFLON WITH ADHESIVE MATERIAL MEETING FEDERAL SPECIFICATION MMM-A-134, FEP FILM OR EQUAL.
- PROVIDE A METHOD FOR HANDLING ROCKER PLATE "C" DURING GALVANIZING.
- AT INSTALLATION, ENSURE STAINLESS STEEL SLIDING FACE OF THE UPPER ELEMENT AND THE TFE SLIDING FACE OF THE LOWER ELEMENT HAVE THE SURFACE FINISH SPECIFIED AND ARE CLEAN AND FREE OF ALL DUST, MOISTURE, AND ANY OTHER FOREIGN MATTER.



DESIGNER NOTES

- IF ALL BEARINGS AT A GIVEN SUBSTRUCTURE UNIT ARE FIXED, UTILIZE $\frac{1}{2}$ " THICK ELASTOMERIC BEARING PADS AND FULL-DEPTH CONCRETE DIAPHRAGMS.
- FOR EXPANSION BEARINGS, USE LAMINATED ELASTOMERIC BEARINGS WHENEVER POSSIBLE.
- SEE STANDARD 27.02 AND 19.31 FOR CLEARANCE REQUIREMENTS AND STANDARD 27.02 FOR THE USE OF BEVELED ROCKER PLATE "C" ON GRADES GREATER THAN 3%.
- HEIGHT OF BEARING SHOWN IN "EXPANSION BEARING ASSEMBLY" INCLUDES $\frac{1}{16}$ " BEARING PAD AND $\frac{1}{16}$ " TEFLON SURFACE.
- ▲ ADJUST HEIGHT IF BEVELED ROCKER PLATE "C" IS USED.
- ANCHOR PLATE LENGTH TO BE DESIGNED. MINIMUM LENGTH IS 10"

CALCULATE THE REACTIONS AT THE BEARINGS DUE TO "TOTAL LOADS" AND ALSO "DEAD LOADS" ONLY, USE THE AASHTO LRFD SERVICE I LOAD COMBINATION AND CHECK TO SEE IF THE REACTIONS EXCEED THE BEARING CAPACITIES IN THE TABLE BELOW. CONSIDER ONLY DEAD LOAD (DC + DW) AND HL-93 LIVE LOADS (LL), INCLUDING A 33% DYNAMIC LOAD ALLOWANCE (IM).

IF EITHER REACTION EXCEEDS ITS CORRESPONDING BEARING CAPACITY, THE BEARING DETAILS AS SHOWN ON THIS STANDARD MUST BE MODIFIED TO INCREASE THE BEARING CAPACITY. IF BEARING DETAILS ARE CHANGED AND ANY PLATE HAS A THICKNESS GREATER THAN 2", THEN PROVIDE AN ANSIB250 FINISH TO TOP AND BOTTOM SURFACE OF THESE PLATES.

GIRDER SIZE	28" & 36"	45"	54" & 70"	36W", 45W", 54W", 72W" & 82W"
TOTAL LOAD (DC+DW+(LL+IM))	180	230	280	330
DEAD LOAD (DC + DW)	110	140	170	200

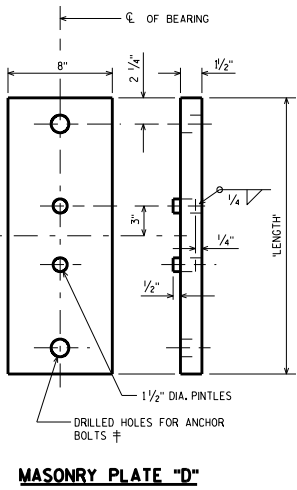
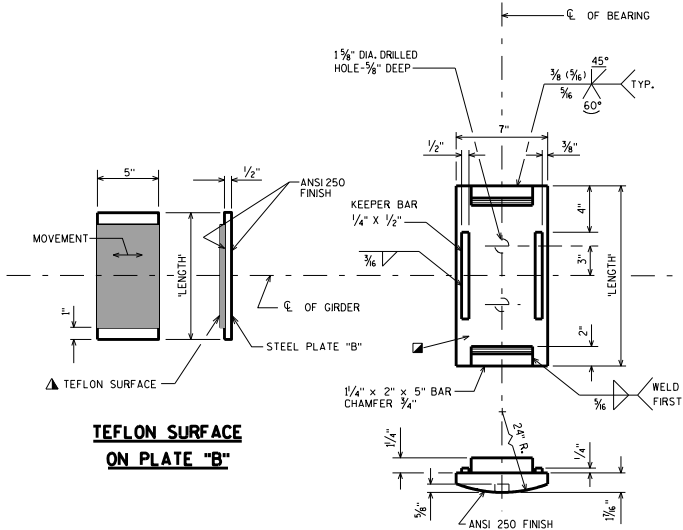


STEEL BEARINGS FOR PRESTRESSED CONCRETE GIRDERS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

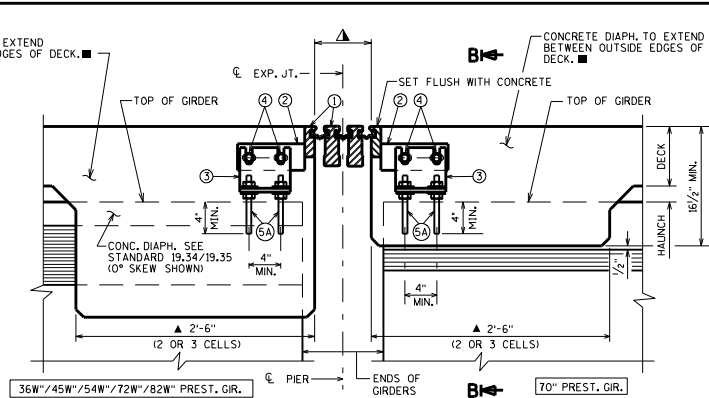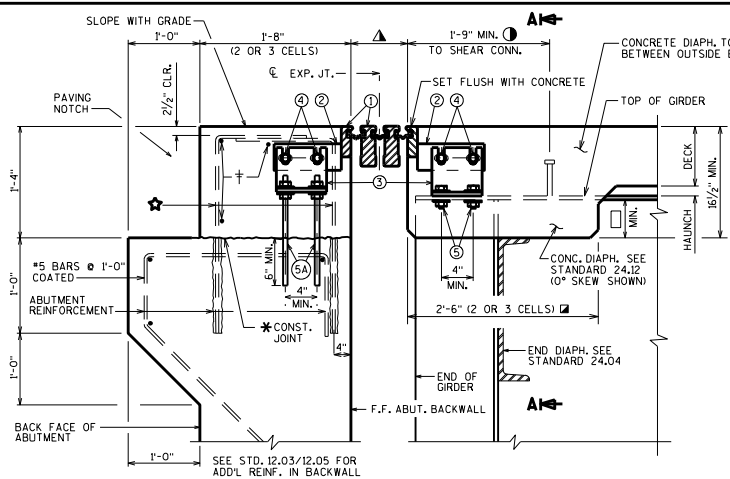


JOINT @ PIER (PRESTRESSED GIRDERS)
NORMAL TO \bar{C} SUBSTRUCTURE

- LEGEND**
- MODULAR EXPANSION JOINT DEVICE, \square CELLS.
 - $1/2$ " PLATE, ONE PER GIRDER MIN. PROVIDE 2 - 1" X 2" MIN. SLOTTED HOLES PLACED HORIZONTALLY FOR NO. 4.
 - WT 6 X 29 (OR EQUIVALENT) BUILT UP T-SECTION, ONE PER GIRDER. PROVIDE 2 - 1" X 3" MIN. SLOTTED HOLES PLACED VERTICALLY IN WEB OF WT FOR BOLTS NO. 4.
 - $3/4$ " DIA. HIGH STRENGTH BOLTS WITH NUTS & WASHERS. (A325 GALV.)
 - $3/4$ " DIA. HIGH STRENGTH BOLTS WITH NUTS & WASHERS. FIELD DRILL HOLES IN GIRDER TOP FLANGE. (A325 GALV.)
 - $3/4$ " DIA. THREADED ROD WITH 2 NUTS & WASHERS. GROUT THREADED ROD INTO FIELD DRILLED HOLES (GALV.)
 - SUPPORT BOX ASSEMBLY FOR SUPPORT BAR (SPA, PER MANUFACTURER). FABRICATE BOX FROM $1/2$ " PLATES.
 - $3/4$ " BULKHEAD PLATE. WELD TO NO. 1, NO. 8 AND NO. 14. WHEN CONDUIT IS PRESENT IN PARAPET OR SIDEWALK, ACCOMMODATE FOR BY PROVIDING OPENING IN NO. 7.
 - INSIDE PLATE. FABRICATE FROM $3/8$ " PLATE.
 - OUTSIDE PLATE. FABRICATE FROM $3/8$ " PLATE.
 - $3/4$ " DIA. X 4" LONG STUDS. WELD TO NO. 7, 8, & 14 AS SHOWN.
 - $3/4$ " DIA. X 2" STAINLESS STEEL FLAT CTSK. SLOTTED HEAD CAP SCREWS W/ ANTI-SEIZE LUBRICANT. RECESS $1/8$ " BELOW PL. SURFACE.
 - $1/2$ " PLATE WITH $3/8$ " DIA. LOOP ANCHOR FABRICATED AS SHOWN. SPACED AT MANUFACTURER'S SPEC.
 - INSIDE PLATE. FABRICATE FROM $3/8$ " PLATE
 - ADIPRENE BUTTON. SEE DETAIL. SET IN OUTSIDE PLATE.

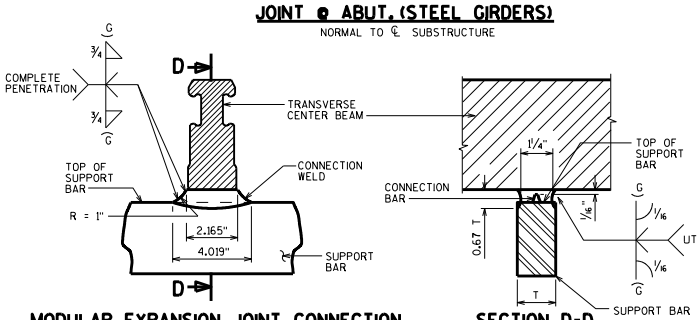

JOINT @ ABUT. (STEEL GIRDERS)
NORMAL TO \bar{C} SUBSTRUCTURE

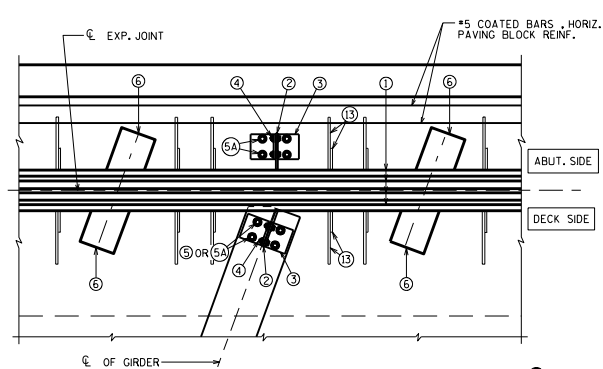


PART PLAN

- AT LOCATION WHERE EXT. GIR. IS ADJACENT TO A RAISED SIDEWALK (STD.30.07), CONC. DIAPH. DOES NOT EXTEND OUT TO EDGE OF DECK, BUT IS TERMINATED AT INSIDE FACE OF EXT. GIR.
- *5 COATED BARS, \pm 8'-0" LONG, 1'-0" MIN. LAP. CUT IN FIELD TO CLEAR JOINT SUPPORT SYSTEM AS REQ'D.
- * POUR CONC. ABOVE THIS JOINT AFTER SUPERSTRUCTURE CONC. IS IN PLACE. STRIKE OFF & LEAVE ROUGH.
- \square DIMENSION IS PARALLEL TO \bar{C} GIRDER.
- \triangle MANUFACTURER'S RECOMMENDED JOINT OPENING BASED ON THE TEMPERATURE ON THE DAY OF PLACEMENT PER TEMPERATURE TABLE. THE MODULAR EXPANSION DEVICE SHALL HAVE THE NUMBER OF CELLS AS INDICATED IN Q.
- \star (2) COATED L-SHAPED ADHESIVE ANCHORS $3/8$ "-INCH. EMBED 12" IN CONCRETE. SPACE AT 1'-0". PLACE ADHESIVE ANCHORS AFTER MODULAR JOINT IS IN POSITION.
- \blacksquare TOP FLANGE WIDTH WITHIN LIMITS OF CONC. DIAPH. SHALL BE $\leq 20^\circ$ FOR SKEWS $\leq 30^\circ$
- \blacktriangle FOR PRESTRESSED GIRDERS, PLACE THE FOLLOWING NOTE ON PLANS: "JOINT MANUFACTURER SHALL INFORM AND PROVIDE NECESSARY DETAILS TO THE PRESTRESSED GIRDER FABRICATOR, WHEN FORM-OUT OF THE TOP FLANGE IS REQ'D, TO ALLOW PLACEMENT OF SUPPORT BOX ASSEMBLY."


**MODULAR EXPANSION JOINT CONNECTION
DETAIL AND WELD SPECIFICATION**

SECTION D-D

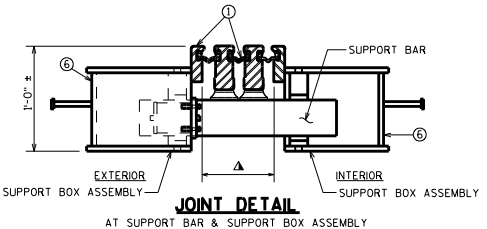


JOINT DETAIL

AT SUPPORT BAR & SUPPORT BOX ASSEMBLY

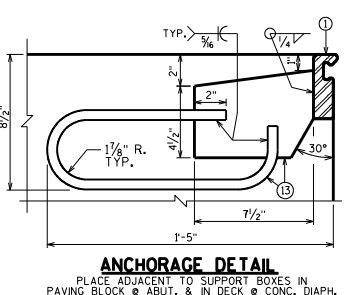


ANCHORAGE DETAIL

PLACE ADJACENT TO SUPPORT BOXES IN PAVING BLOCK @ ABUT. & IN DECK @ CONC. DIAPH.

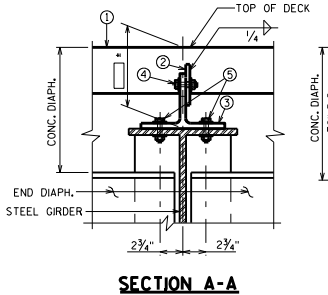

SECTION A-A

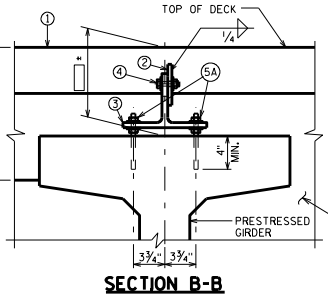

SECTION B-B

NOTE:
MODULAR EXPANSION DEVICE DESIGN AND DETAILS ARE SPECIFIC TO THE MANUFACTURER SELECTED FROM THOSE LISTED IN THE SPECIAL PROVISIONS. FABRICATION DRAWING IS SUBJECT TO THE APPROVAL OF THE BUREAU OF STRUCTURES.

\blacktriangle SUPPORT BOXES ARE SHOWN FOR GENERAL INFORMATION AND LOCATION MAY VARY ACCORDING TO FABRICATOR DESIGN. SPACE SUPPORT BOXES TO MISS GIRDER TOP FLANGES WHEN POSSIBLE, BUT NOT TO EXCEED MAXIMUM SPACING PER SPECIAL PROVISIONS.

TEMP. TABLE

TEMPERATURE TABLE FOR SETTING JOINT OPENINGS TO BE DETERMINED BY JOINT MANUFACTURER WITH THE FOLLOWING DESIGN DATA:

- \square IN. OF MOVEMENT PER 10° F
- MEDIAN TEMPERATURE OF 45° F
- TEMP. RANGE IN TABLE FROM 15° F TO 185° F FOR PRESTRESSED CONCRETE GIRDERS AND FROM (-5°) F TO $(+95^\circ)$ F FOR STEEL GIRDERS.
- ADJUST INITIAL JOINT OPENINGS BY A REDUCTION OF \square IN., WHICH ACCOUNTS FOR SHRINKAGE (CREEP) OF THE SUPERSTRUCTURE OVER TIME, TO PRODUCE FINAL JOINT OPENINGS FOR TABLE.

A TABLE OF JOINT OPENINGS BASED ON ABOVE DATA SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL.

INCLUDE ITEM 4. FOR PRESTRESSED GIRDER STRUCTURES ONLY. SEE CHAPT. 28 IN BRIDGE DESIGN MANUAL FOR ADJUSTMENT FACTOR.

- STANDARD COVERS:**
- SKEWS $\leq 30^\circ$
 - 2 OR 3 CELL MODULAR EXPANSION JOINTS
 - STEEL GIRDER BRIDGES
 - PRESTRESSED GIRDER BRIDGES (70", 36", 45", 54", 72" AND 82" SECTION)


NOTES

- ONE FIELD SPlice PERMITTED IN STEEL EXTRUSIONS. DETAILS SHALL BE SUBMITTED FOR APPROVAL. NO SPlicing PERMITTED IN NEOPRENE GLAND.
- AFTER FABRICATION, BUT BEFORE SHIPMENT, STRAIGHTEN STEEL EXTRUSIONS SUCH THAT THEY SHALL BE FREE FROM WARP, TWIST & SWEAP.
- NO EXPANSION JOINT PROTRUSIONS PERMITTED ABOVE ROADWAY SURFACE. ON PARAPET ROADWAY FACE OR ABOVE SIDEWALK SURFACE IF FOR RAISED SIDEWALK.
- THE EXPANSION JOINT SEALS SHALL BE PLACED, BONDED & SEALED AS RECOMMENDED BY THE MANUFACTURER. FORM WORK SHALL BE PLACED BETWEEN THE SUPPORT BOXES TO PREVENT CONCRETE INTRUSION INTO THE SUPPORT BOX. A TECHNICAL REPRESENTATIVE OF THE MANUFACTURER SHALL BE PRESENT DURING INSTALLATION. PRIOR TO SETTING THE JOINT ASSEMBLY INTO POSITION, THE PROJECT ENGINEER SHALL DETERMINE THE PROPER JOINT OPENING.
- EXPANSION JOINT EXTRUSIONS SHALL BE FABRICATED TO CONFORM TO ROADWAY CROWN & GRADE. FABRICATOR SHALL PROVIDE MEANS OF KEEPING GALVANIZED EXTRUSIONS CLEAN & SMOOTH DURING SHIPMENT AND PRIOR TO APPLYING LUBRICANT ADHESIVE FOR NEOPRENE GLAND INSTALLATION.
- SANDBLAST BARS, PLATES, WT-SECTION, ANCHORAGE LOOP, & EXTRUSIONS AFTER FABRICATION IN ACCORDANCE WITH SSPC SP. #6 "COMMERCIAL BLAST CLEANING". AFTER BLAST CLEANING, THIS ASSEMBLY SHALL BE HOT DIPPED GALVANIZED.
- COST OF FURNISHING & PLACING OF THE EXPANSION JOINTS COMPLETE WITH PARAPET PLATES & SIDEWALK PLATES SHALL BE PAID FOR UNDER THE PRICE BID FOR "EXPANSION DEVICE MODULAR B-1".
- BAR STEEL REINF. IN DECK AND CONC. DIAPHRAGM SHALL BE RECESSED AS NECESSARY TO ALLOW PLACEMENT OF JOINT ASSEMBLY. TOP TRANSVERSE BARS, ADJACENT TO MOD. JT., TO BE CUT AND PLACED BETWEEN JT. SUPPORT SYSTEM.

MODULAR EXPANSION JOINT DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

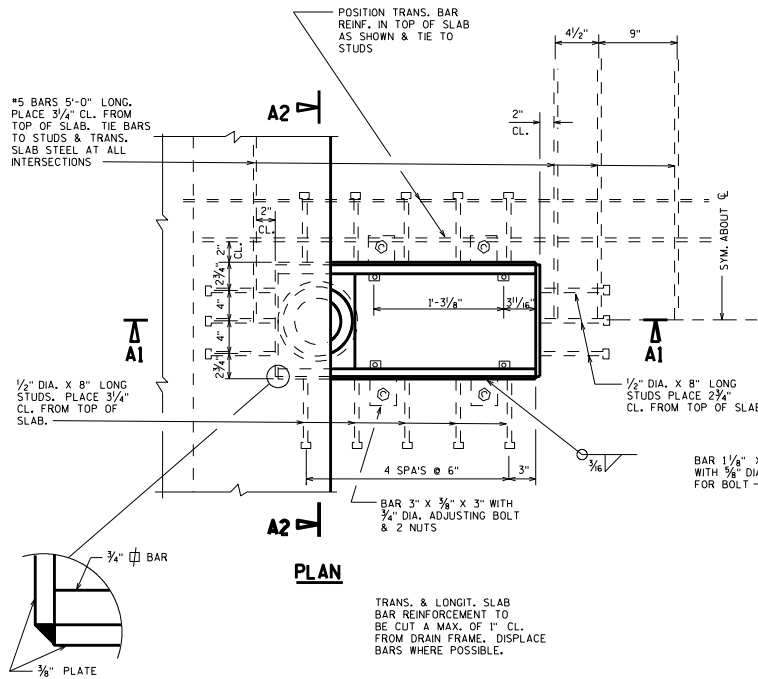


PLAN

TRANS. & LONGIT. SLAB BAR REINFORCEMENT TO BE CUT A MAX. OF 1" CL. FROM DRAIN FRAME. DISPLACE BARS WHERE POSSIBLE.

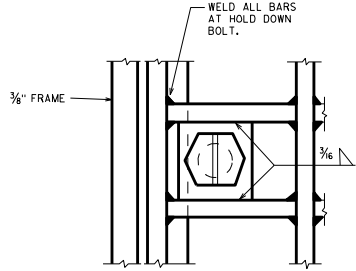

PART PLAN

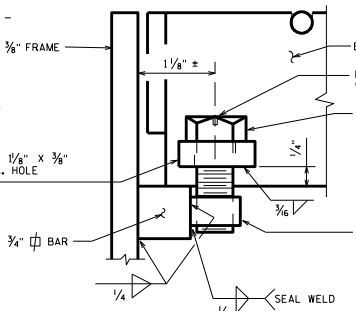


SECTION AT HOLD DOWN BOLT

NOTES


ALL DRAIN MATERIAL INCLUDING GRATE, EXCLUDING PIPE & GRATE HOLD DOWN BOLTS, SHALL BE ASTM A36 STEEL.
 MATERIAL FOR BRACKETS SHALL CONFORM TO ASTM A36.
 THE CONTRACTOR MAY PROPOSE AN ALTERNATE TYPE OF BRACKET. THE PROPOSED ALTERNATE DETAILS SHALL BE SUBMITTED AND SUBJECT TO THE APPROVAL OF THE ENGINEER.
 ALL STEEL SHALL BE GALVANIZED. WELDS SHALL BE MADE WITH LOW HYDROGEN ELECTRODES.
 SEAL WELD INSIDE OF DRAIN.
 PRIOR TO GALVANIZING A NO. 6 BLAST CLEANING IS REQUIRED.
 FLANGED 6" DIA. FIBERGLASS PIPE CONFORMING TO ASTM D2996, GRADE 1, CLASS A, MAY BE USED AS AN ALTERNATE TO GALVANIZED STANDARD PIPE CONFORMING TO ASTM A53.

DESIGNER NOTES

ALL MATERIAL FOR FLOOR DRAINS AS SHOWN ON THIS SHEET SHALL BE INCLUDED IN THE BID ITEM "FLOOR DRAINS TYPE 'H'".
 ALL MATERIAL FOR DOWNSPOUTS AND BRACKETS AS SHOWN ON THIS SHEET SHALL BE INCLUDED IN THE BID ITEM "DOWNSPOUT 6-INCH".
 ON THE PRESTRESSED GIRDER SHEET, SHOW LOCATION OF HOLES FOR BRACKET ANCHORAGE FROM TOP/BOTTOM AND END OF GIRDER.

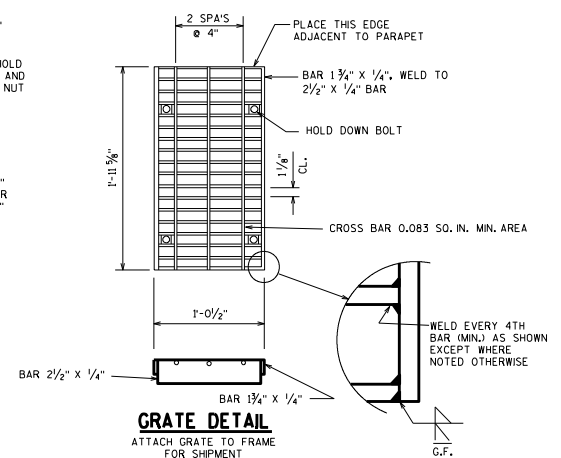


GRATE DETAIL
ATTACH GRATE TO FRAME FOR SHIPMENT

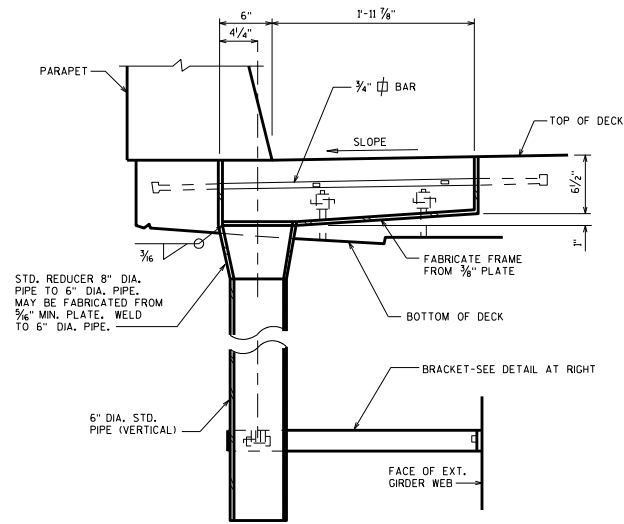


SECTION A1

STD. REDUCER 8" DIA. PIPE TO 6" DIA. PIPE. MAY BE FABRICATED FROM 5/8" MIN. PLATE. WELD TO 6" DIA. PIPE.

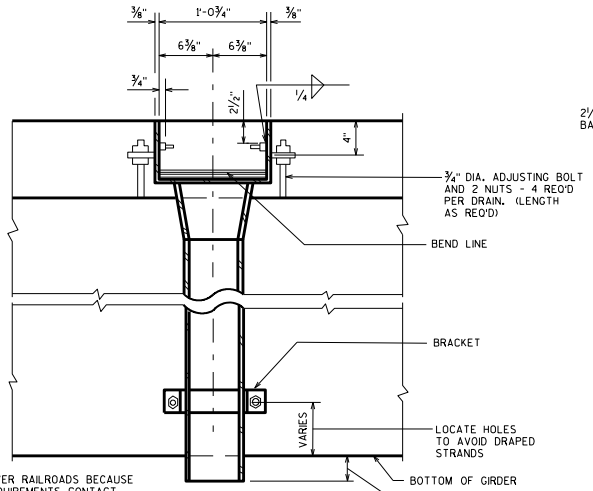


SECTION A2

DETAIL NOT TO BE USED OVER RAILROADS BECAUSE IT VIOLATES CLEARANCE REQUIREMENTS. CONTACT RAILROADS AND HARBORS SECTION FOR GUIDANCE.

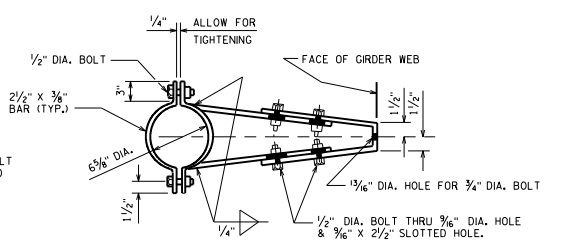


BRACKET DETAIL

FLOOR DRAIN TYPE 'H'	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

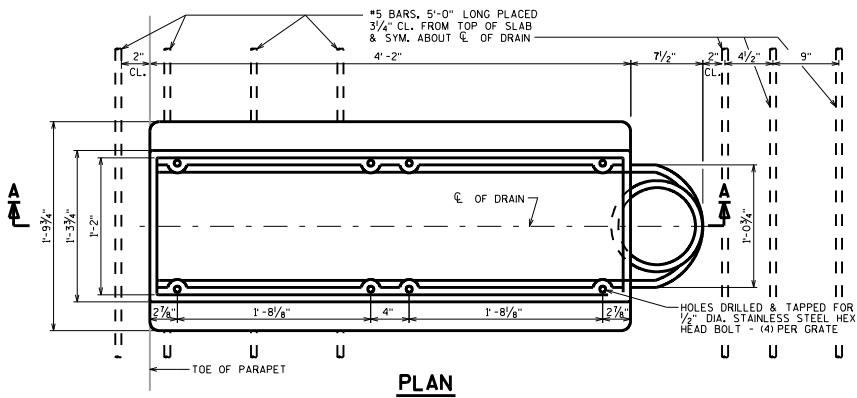

PLAN

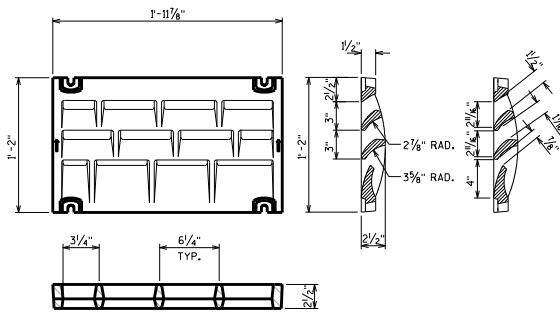

GRATE CASTING DETAILS

ATTACH GRATES TO FRAME FOR SHIPMENT

NOTES

ALL MATERIAL FOR TYPE "WF" CASTING AND 8" DIA. CONNECTION PIPE, EXCLUDING GRATE HOLD DOWN SCREWS, SHALL BE GRAY IRON CONFORMING TO ASTM A48, CLASS 50.

MATERIAL FOR BRACKETS SHALL CONFORM TO ASTM A36.

THE CONTRACTOR MAY PROPOSE AN ALTERNATE TYPE OF BRACKET. THE PROPOSED ALTERNATE DETAILS SHALL BE SUBMITTED AND SUBJECT TO THE APPROVAL OF THE ENGINEER.

8" DIA. DOWNSPOUTS SHALL BE REINFORCED THERMOSETTING RESIN PIPE CONFORMING TO SECTION 514 OF THE STANDARD SPECIFICATIONS.


TRANSVERSE & LONGITUDINAL SLAB BAR REINFORCEMENT TO BE CUT A MAXIMUM OF 1" CLEAR FROM DRAIN FRAME. DISPLACE BARS WHERE POSSIBLE.

DESIGNER NOTES


ALL MATERIAL FOR FLOOR DRAINS AS SHOWN ON THIS SHEET SHALL BE INCLUDED IN THE BID ITEM "FLOOR DRAINS TYPE WF".

ALL MATERIAL FOR DOWNSPOUTS, CONNECTORS, AND BRACKETS AS SHOWN ON THIS SHEET SHALL BE INCLUDED IN THE BID ITEM "DOWNSPOUT 8-INCH".


ON THE PRESTRESSED GIRDER SHEET, SHOW LOCATION OF HOLES FOR BRACKET ANCHORAGE FROM TOP/BOTTOM AND END OF GIRDER.

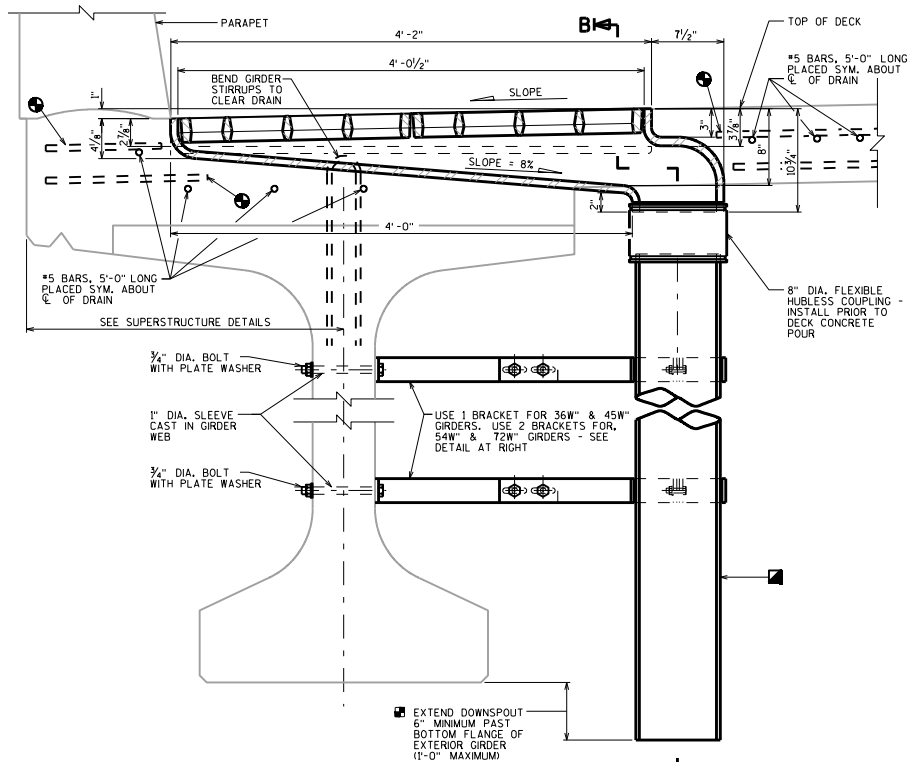

SECTION A-A

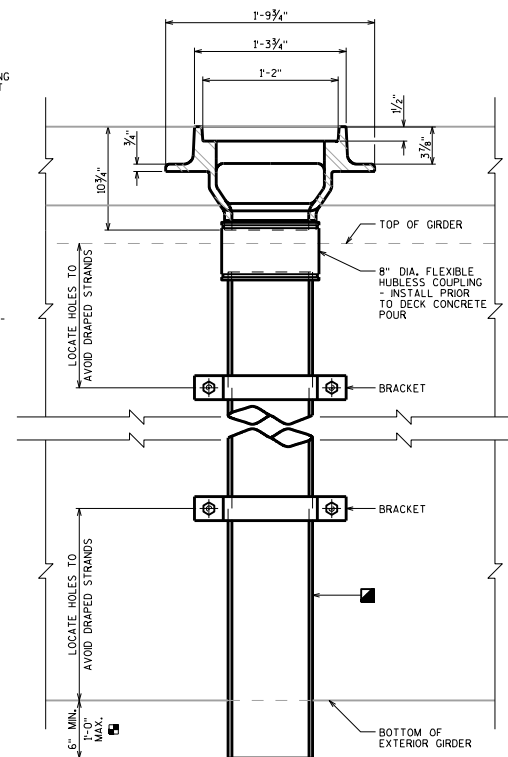


SECTION B-B

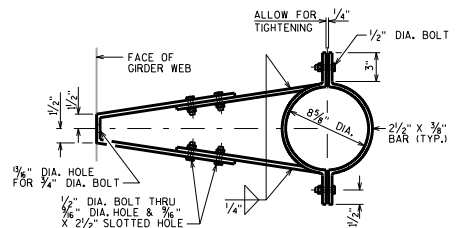


BRACKET DETAIL

DETAIL NOT TO BE USED OVER RAILROADS BECAUSE IT VIOLATES CLEARANCE REQUIREMENTS. CONTACT RAILROADS AND HARBORS SECTION FOR GUIDANCE.

FLOOR DRAIN TYPE "WF"	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

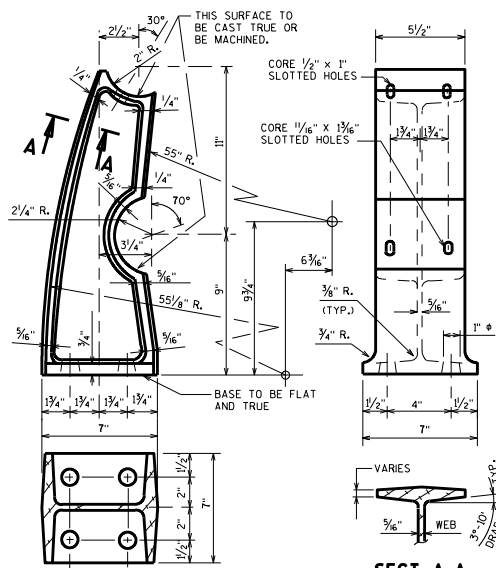


ALUMINUM POST CASTING

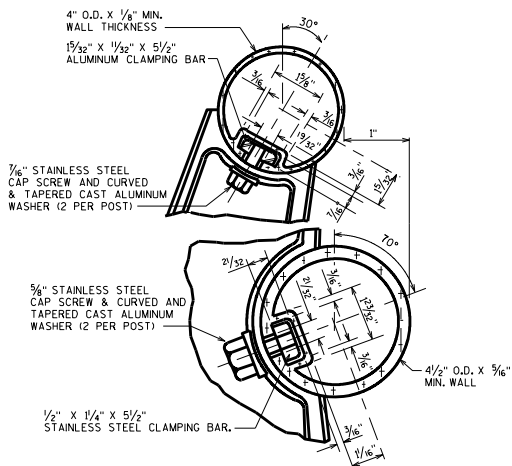


DETAIL OF ATTACHMENT TO POST


NOTES: MAX. REDUCTION IN DIAMETER OF BENT SECTION SHALL BE 3%. WALL THICKNESS OF TUBING SHOWN ABOVE SHALL BE MIN. NOMINAL AVERAGE WALL THICKNESS. MAX. REDUCTION IN SLOT WIDTH IN BENT TUBING SHALL BE 1/8".

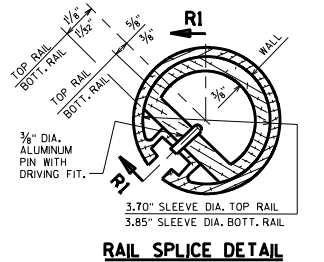


RAIL SPLICE DETAIL

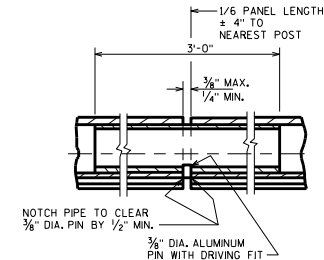

SECTION R1

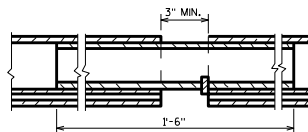


SLEEVE DETAIL AT ABUTMENT




DETAIL AT RAIL OPENINGS


ALL SLEEVE DETAILS SAME AS "RAIL SPLICE DETAIL" UNLESS SHOWN OTHERWISE

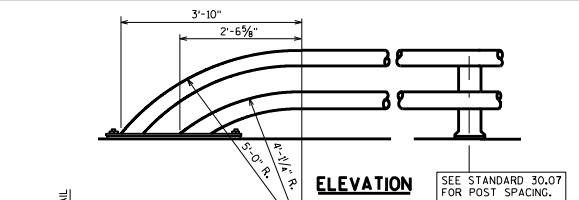

ELEVATION

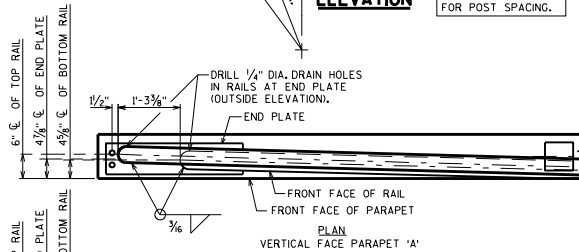


PLAN

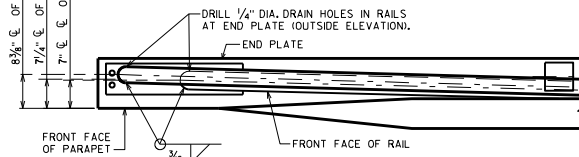


PLAN


DETAIL OF RAIL BEND AT ABUTMENTS

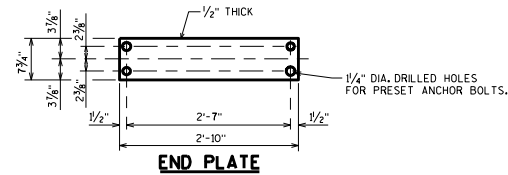


END PLATE

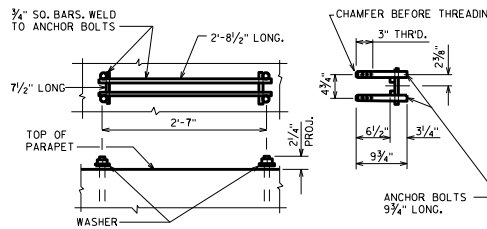


ANCHOR BOLTS AT END PLATE

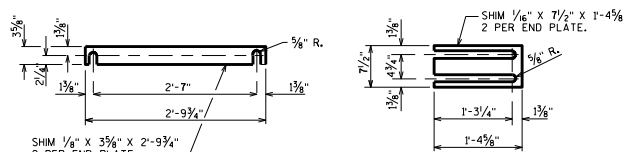

END PLATE SHIM DETAILS

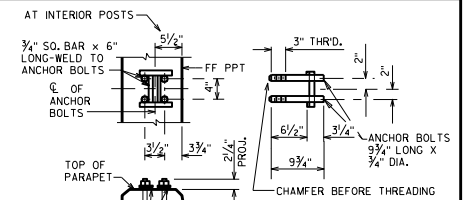

ANCHOR BOLTS AT POSTS

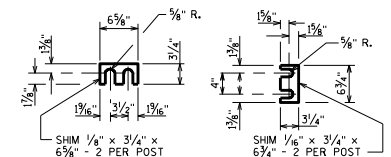


POST SHIM DETAILS

NOTES


BID ITEM SHALL BE "RAILING TUBULAR TYPE H B - -" WHICH INCLUDES ALL ITEMS SHOWN.
 SHIMS SHALL CONFORM TO SAME MATERIAL AS POSTS.
 ANCHOR BOLTS, NUTS AND WASHERS SHALL BE STAINLESS STEEL.
 RAILINGS SHALL BE FABRICATED IN 2 AND 3 PANEL LENGTHS.
 RAILING POSTS SHALL BE SET NORMAL TO GRADE LINE.
 ALL POST SPACINGS ARE MEASURED HORIZONTALLY ALONG CENTERLINE OF THE POST BASE.
 SHIMS SHALL BE USED UNDER POSTS AND END PLATES WHERE RECD. FOR ALIGNMENT.
 FILL ALL EXPOSED OPENINGS BETWEEN SHIMS AND POST ANCHOR BOLT HOLES WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.
 RAILS SHALL BE BUILT STRAIGHT AND SPRUNG INTO PLACE FOR STRUCTURES CURVED UP TO 3". FOR STRUCTURES CURVED GREATER THAN 3", RAILS SHALL BE CURVED TO FIT.

RAILING WEIGHT = 20 LB/FT

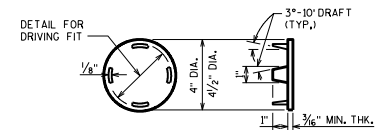


RAIL CLOSURE CAP DETAIL


TUBULAR RAILING TYPE 'H' (ALUM.)	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

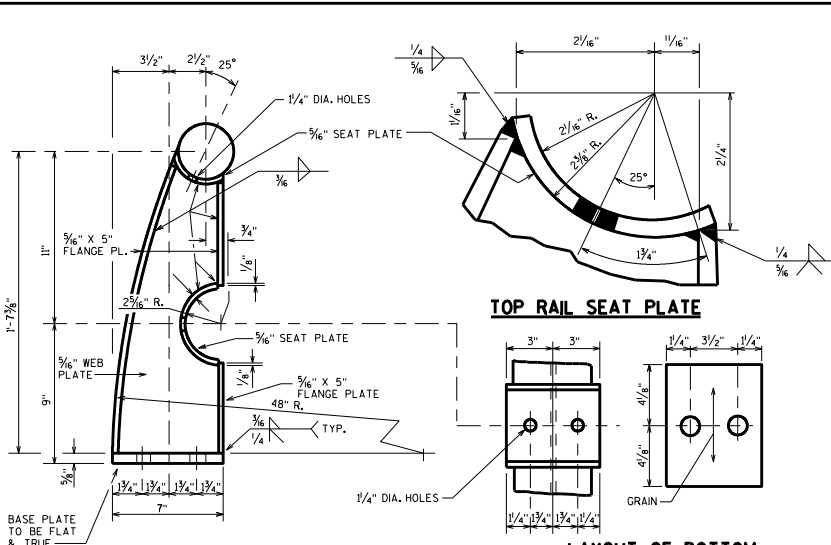


TOP RAIL SEAT PLATE




LAYOUT OF BOTTOM RAIL SEAT PL.




LAYOUT OF TOP RAIL SEAT PL.

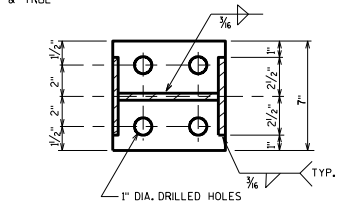


STEEL POST DETAILS

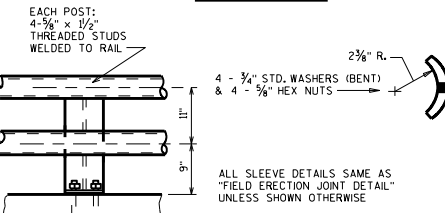

RAIL TO POST CONN.




SHIPPING BAR
END SECTION ONLY

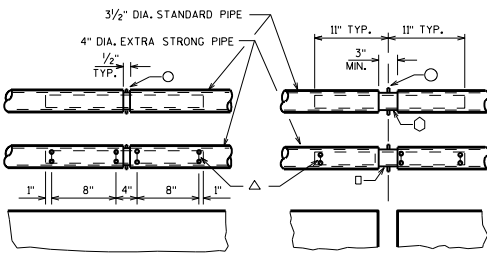


FIELD ERECTION JOINT DETAIL




DETAIL AT RAIL OPENING

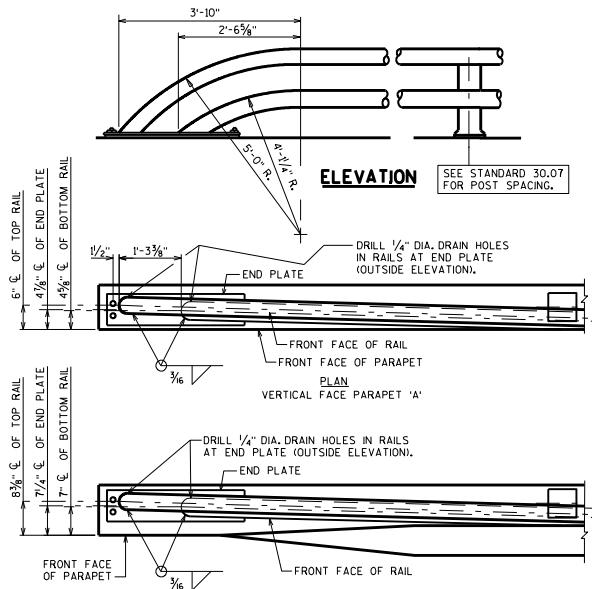


DETAIL OF RAIL BEND AT ABUTMENTS

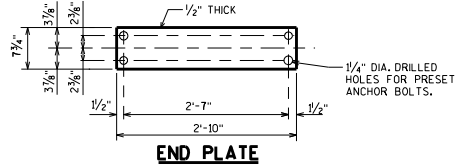


END PLATE

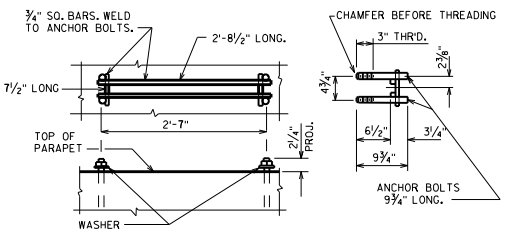


ANCHOR BOLTS AT END PLATE

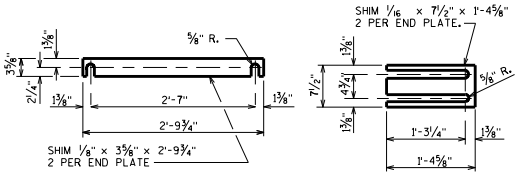

END PLATE SHIM DETAILS

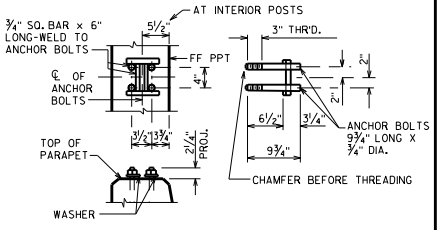

ANCHOR BOLTS AT POSTS

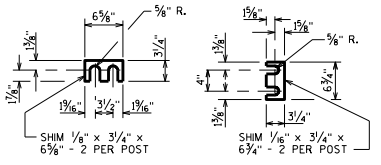

POST SHIM DETAILS

NOTES



- BID ITEM SHALL BE "RAILING TUBULAR TYPE H B-..." WHICH INCLUDES ALL ITEMS SHOWN.
- ANCHOR BOLTS, NUTS AND WASHERS SHALL BE EITHER STAINLESS STEEL OR ASTM A307. IF A307 IS USED ELECTRO-GALVANIZE NUTS, WASHERS & TOP 3/2" OF ANCHOR BOLTS.
- CLOSURE ENDS ON STEEL RAILING SHALL BE 1/4" PLATE. WELD AND GRIND SMOOTH.
- RAILINGS SHALL BE FABRICATED IN 2 AND 3 PANEL LENGTHS.
- RAILING POSTS SHALL BE SET NORMAL TO GRADE LINE.
- ALL POST SPACINGS ARE MEASURED HORIZONTALLY ALONG CENTERLINE OF THE POST BASE.
- SHIMS SHALL BE USED UNDER POSTS AND END PLATES WHERE REQD. FOR ALIGNMENT.
- FILL ALL EXPOSED OPENINGS BETWEEN SHIMS AND POST ANCHOR BOLT HOLES WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.
- RAILS, POSTS & SHIMS SHALL BE MADE FROM MATERIALS CONFORMING TO ASTM DESIGNATION A709, GRADE 36.
- ALL MATERIALS, EXCEPT ANCHORAGES, SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING, ALL STEEL SHALL BE GIVEN A NO. 6 BLAST CLEANING BY SSPC SPECIFICATIONS.
- RAILS SHALL BE BUILT STRAIGHT AND SPRUNG INTO PLACE FOR STRUCTURES CURVED UP TO 3". FOR STRUCTURES CURVED GREATER THAN 3", RAILS SHALL BE CURVED TO FIT.

RAILING WEIGHT = 30 LB/FT

LEGEND

- 3/16" x 3/8" WELDED STUDS
- 3" DIA. STD. PIPE x 1'-10" LONG
- 3" DIA. EXTRA STRONG PIPE x 1'-10" LONG
- △ 1/2" DIA. WELD BEADS AT 1/3 PTS. ON PIPE 11" CIRCUMF. GRIND BEADS SO THAT SLEEVE FITS FREELY IN THE LD. OF 4" DIA. EXTRA STRONG PIPE.

TUBULAR RAILING TYPE 'H' (STEEL)	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

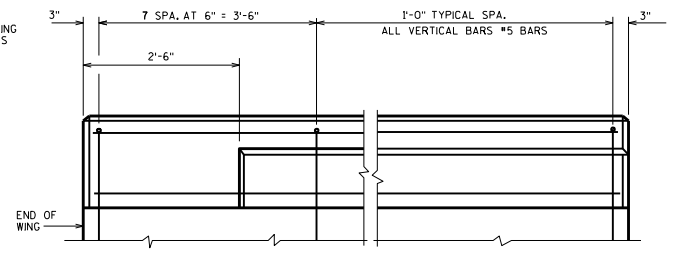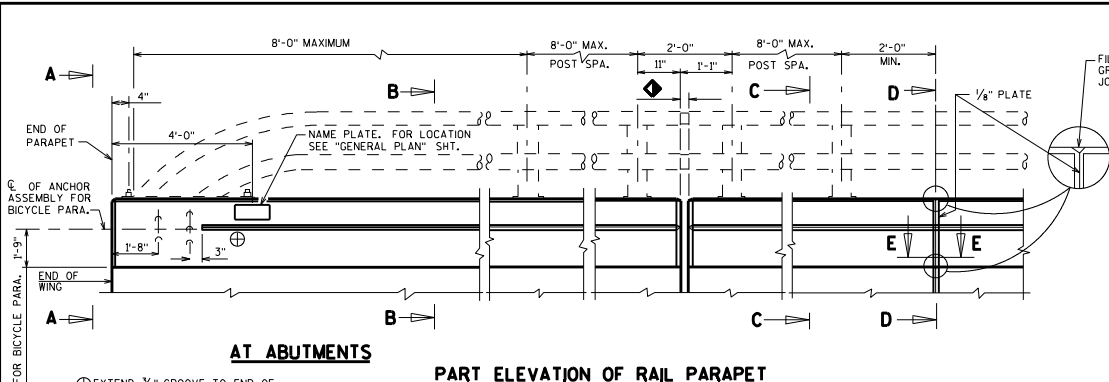


VIEW SHOWING OUTSIDE FACE OF PARAPET & REINF.

BILL OF BARS


BAR MARK	CO. QTY.	NO. REQD.	LENGTH PPT HT	BEVY	BAR SERIES	LOCATION
S501	X		4-8	6-8	X	PARAPET VERT.
A501	X		7-5	9-5	X	PARAPET VERT.

⊕ EXTEND 3/4" GROOVE TO END OF PARAPET WHEN ANCHOR ASSEMBLY IS NOT USED

◆ ROADWAY OPENING OR 2 1/2" MIN. FOR EXPANSION JOINT. USE 1/2" OPENING WITH FILLER FOR AT ABUTMENTS

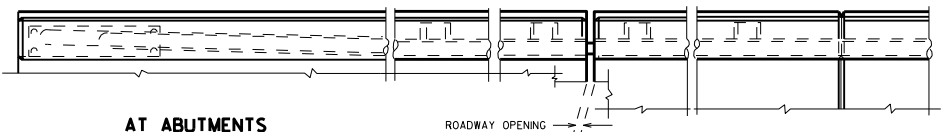


PART PLAN OF RAIL PARAPET

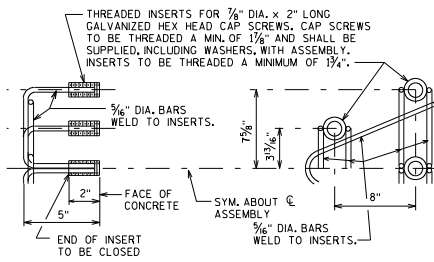

DETAIL OF ANCHOR ASSEMBLY

NOTE: HEX. HEAD CAP SCREWS & WASHERS TO BE GALVANIZED IN ACCORDANCE WITH AASHTO M232 CLASS C.

ASSEMBLY BID ITEM SHALL BE "ANCHOR ASSEMBLIES FOR STEEL PLATE BEAM GUARD", EACH.




NOTES

WHEN PARAPETS ARE POURED CONTINUOUSLY FROM END TO END, THEY SHALL BE SEPARATED AT THE DEFLECTION JOINTS BY A PIECE OF 1/8" ZINC OR PLASTIC PLATE CUT AS SHOWN IN SECTION 'D' BY SHADED AREA. IF CONSTRUCTION JOINTS IN PARAPETS ARE USED AT THE DEFLECTION JOINTS, ONE SIDE OF JOINT SHALL BE COATED WITH AN APPROVED LIQUID BOND BREAKER AND PLATE SEPARATORS MAY BE OMITTED.

☑ HORIZ. CONST. JOINT-STRIKE OFF AS SHOWN AND LEAVE ROUGH.

A A501 BAR MAY BE USED IN LIEU OF A S501 BAR ADJACENT TO THE PAVING NOTCH ON TYPE 'A' ABUTMENTS.

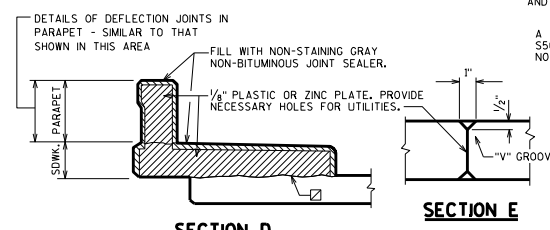

SECTION D

SHOWING DEFLECTION JOINT IN PARAPET OR SIDEWALK USING THE FOLLOWING CRITERIA:

1. GIRDER STRUCTURES AND SLAB STRUCTURES WITH A SIDEWALK SHOULD HAVE A DEFLECTION JOINT IN THE SIDEWALK AND PARAPET OVER THE PIER.

IF THERE IS A LIGHT STANDARD AT THE PIER, PLACE A DEFLECTION JOINT APPROX. 4'-0" EACH SIDE OF PIER, WITH NONE DIRECTLY OVER THE PIER.

2. GIRDER STRUCTURES AND SLAB STRUCTURES WITHOUT SIDEWALKS SHOULD HAVE NO DEFLECTION JOINTS IN THE PARAPETS.


	1'-8" PARAPET	2'-8" PARAPET
AREA	1.44 SF	2.27 SF
WEIGHT	216 LB/FT	340 LB/FT

VERTICAL FACE PARAPET 'A'

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*


DATE:
7-16

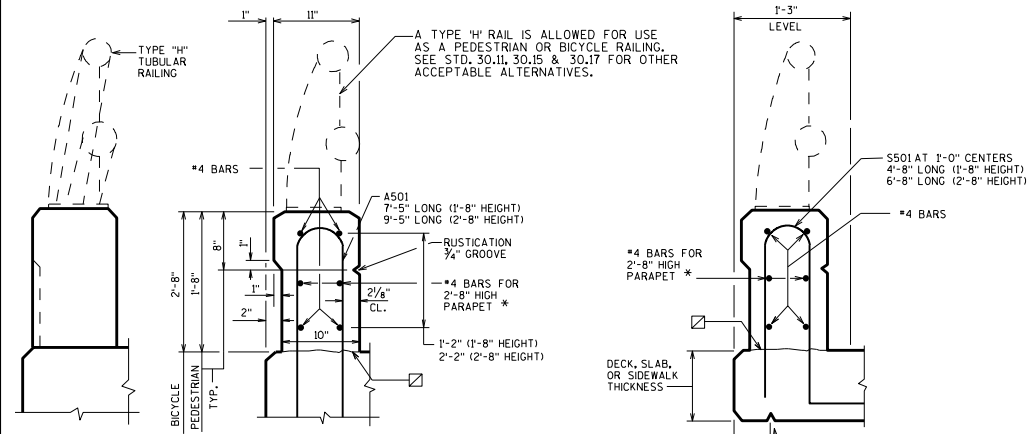


* OPTIONAL CONSTRUCTION JOINTS IN THE PARAPETS MAY BE USED. RUN BAR REINF. THRU THE JOINT, LAP LONGIT. BARS 4 MIN. OF 1'-5". MIN. JOINT SPACING OF 80'-0". DEFINE CONST. JOINT WITH A 3/4" - "V" GROOVE.

AT SIDEWALK OR DECK


SECTION C

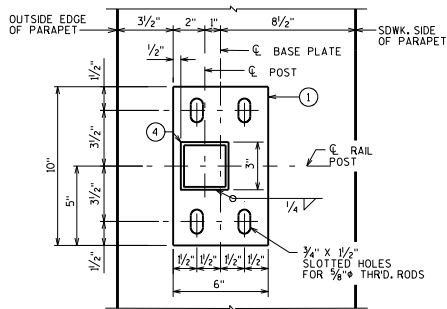

TYPICAL RAIL POST BASE PLATE

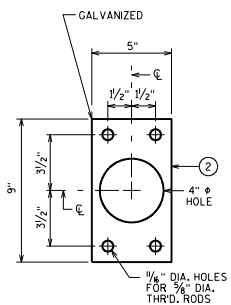

ANCHOR PLATE

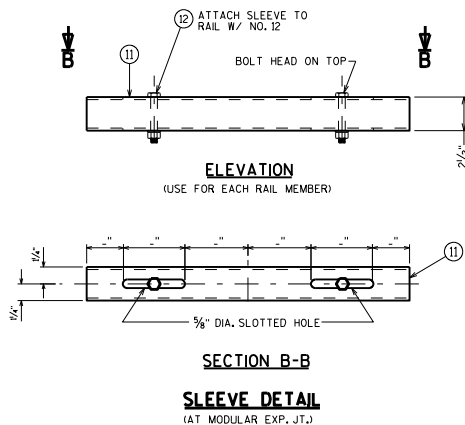


ELEVATION
(USE FOR EACH RAIL MEMBER)

SECTION B-B


SLEEVE DETAIL
(AT MODULAR EXP. JT.)

NOTE: CONSTRUCT BOTTOM RAIL AND SLEEVE CONNECTION FIRST, THEN MIDDLE RAIL, AND THEN TOP RAIL, TO ALLOW EASE IN PLACEMENT OF BOLT NO. 12.

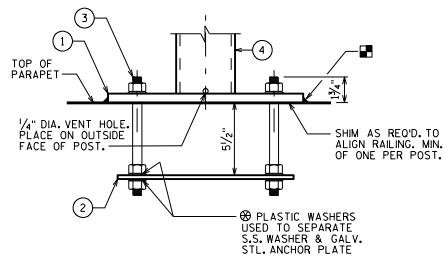


ANCHORAGE FOR RAIL POSTS

★ NOTE: ANCHOR PLATE NOT REQUIRED WHEN ADHESIVE ANCHORS ARE USED.

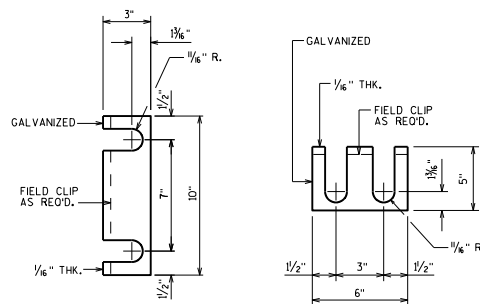

RAIL POST SHIM DETAIL

(2 SETS PER POST)

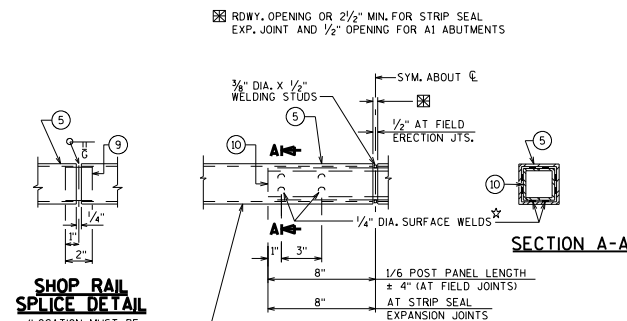

SHOP RAIL SPLICE DETAIL
(LOCATION MUST BE SHOWN ON SHOP DRAWINGS)

FIELD ERECTION JOINT DETAIL

★ MIN. 3/8" FLAT SURFACE DIA. PUNCHINGS OR STUDS MAY BE USED AS AN ALTERNATE.

PROVIDE 3/4" DIA. DRAIN HOLES IN LOW END OF ALL RAILS, CLEAR OF SPLICE SLEEVE.

LEGEND

- ① BASE PLATE 3/8" X 6" X 10" WITH 3/4" X 1/2" SLOTTED HOLES FOR THRD RODS NO. 3, WELD TO NO. 4 AS SHOWN. SLOTS PARALLEL TO LONG SIDE OF PLATE.
- ② 1/2" X 5" X 9" ANCHOR PLATE (GALVANIZED) WITH 1/2" DIA. HOLES FOR THRD. RODS NO. 3.
- ③ 3/8" DIA. X 9" LONG, TYPE 316 STAINLESS STEEL THREADED RODS (MIN. TENSILE STRENGTH = 70 KSI) WITH NUT AND WASHERS OF SAME ALLOY GROUP. ★
- ④ STRUCTURAL TUBING 3" X 3" X 3/8" POSTS, PLACE VERTICAL. WELD TO NO. 1 AND USE 1" DIA. HOLES (FRONT AND BACK) FOR BOLT NO. 6.
- ⑤ STRUCTURAL TUBING 3" X 3" X 3/8" RAILS, WITH 1/2" DIA. HOLES (FRONT AND BACK) FOR BOLT NO. 6, BOLT TO NO. 4.
- ⑥ 3/8" DIA. A325 SLOTTED ROUND HEAD BOLT WITH HEX NUT, 3/8" X 1/2" X 1/2" WASHER, AND LOCK WASHER.
- ⑨ RECTANGULAR SLEEVE FABRICATED FROM 3/8" PLATES. PROVIDE "SLIDING FIT".
- ⑩ RECTANGULAR SLEEVE FABRICATED FROM 3/8" PLATES. 11'-4" Ø FIELD ERECTION JTS. (11'-4" Ø STRIP SEAL EXP. JTS.)
- ⑪ SLEEVE FABRICATED FROM STRUCTURAL TUBING 2 1/2" X 2 1/2" X 3/8" X 1'-1" LONG. SLOTTED HOLES IN TOP AND BOTTOM.
- ⑫ 1/2" DIA. STAINLESS STEEL BOLT WITH NUT AND LOCKWASHER.

★ ALTERNATIVE ANCHORAGE: 4 EQUIVALENT STAINLESS STEEL CONCRETE ADHESIVE ANCHORS 3/8"-INCH, EMBED 7" IN CONCRETE. ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.2.12 OF THE STANDARD SPECIFICATIONS.

NOTES





- BID ITEM SHALL BE "RAILING STEEL TYPE 3T B--", WHICH SHALL INCLUDE ALL STEEL ITEMS SHOWN.
- POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT, AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.
- ENDS OF STRUCTURAL TUBING SHALL BE SAWED, GRIND SMOOTH EXPOSED EDGES. ALL CUT ENDS SHALL BE TRUE AND SMOOTH.
- ALL PLATES, AND RECTANGULAR SLEEVES SHALL CONFORM TO ASTM A709 GRADE 36. ALL STRUCTURAL TUBING SHALL CONFORM TO ASTM A500 GRADE B.
- ANCHORAGES SHALL BE ACCURATELY PLACED TO PROVIDE CORRECT ALIGNMENT OF RAILING. SET NORMAL TO GRADE.
- CUT BOTTOM OF POST TO MAKE POST VERTICAL IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTION.
- STEEL SHIMS SHALL BE PROVIDED & USED UNDER BASE PLATE NO. 1, WHERE REQUIRED FOR ALIGNMENT, AND SHALL BE GALVANIZED.
- ☐ CAULK AROUND PERIMETER OF BASE PLATES, NO. 1 AND FILL BOLT SLOT OPENINGS IN SHIMS AND BASE PLATES WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER. ALL JOINTS IN CONCRETE PARAPET ARE TO BE VERTICAL.
- ALL MATERIAL (EXCEPT NO. 3 & 12) SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING, THE STEEL RAILING SHALL BE GIVEN A NO. 6 BLAST CLEANING PER SSPC SPECIFICATIONS.
- VENT HOLES SHALL BE DRILLED IN POST AND RAIL MEMBERS AS REQUIRED TO FACILITATE GALVANIZING AND DRAINAGE.
- RAILING SHALL BE FABRICATED IN LENGTHS THAT INCLUDE 3 OR 4 POSTS.
- WHEN PAINTING REQ'D: (ADD)
- PAINT OVER GALVANIZING (EXCEPT NO. 2) WITH AN APPROVED TIE COAT AND TOP COAT AS SPECIFIED IN THE CONTRACT DOCUMENTS. THE RAILING SHALL BE PAINTED FEDERAL COLOR NO. [] (FILL IN COLOR NAME).
- INSIDE OF TUBES TO BE PAINTED AT ALL FIELD ERECTION AND EXPANSION JOINTS.
- TOUCH-UP PAINTING TO BE DONE AT COMPLETION OF STEEL RAILING INSTALLATION TO THE SATISFACTION OF THE ENGINEER AT NO EXTRA COST.

**COMBINATION RAILING
TYPE '3T' DETAILS**


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

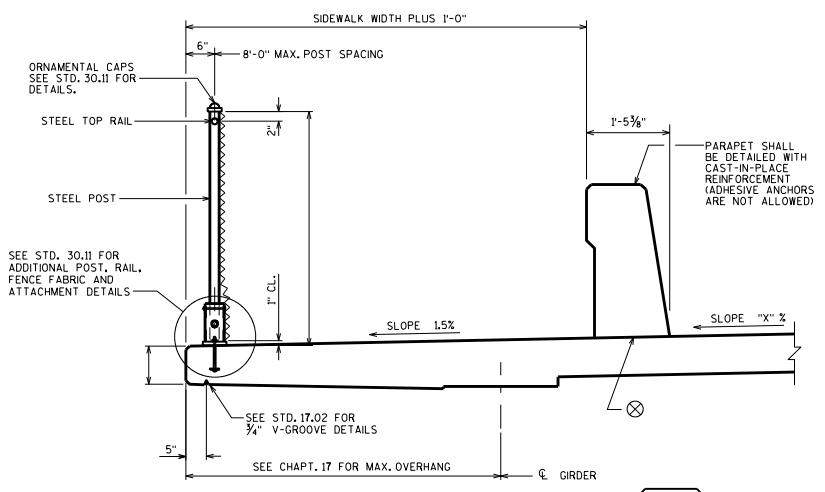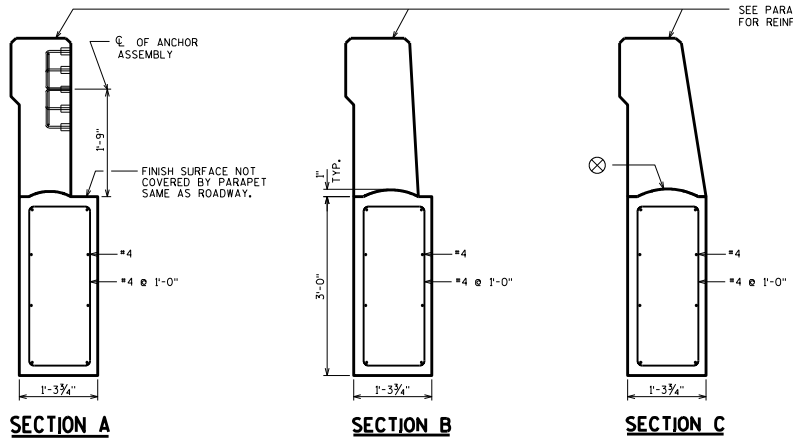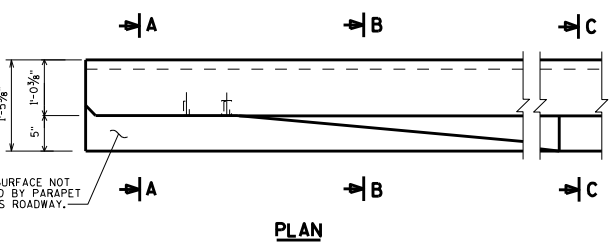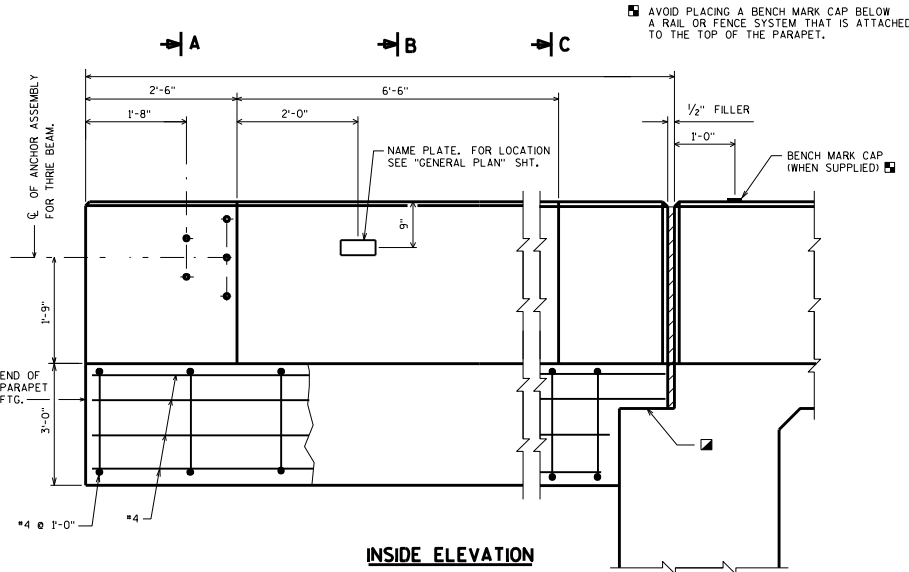

SECTION THRU PARAPET ON BRIDGE
CHAIN LINK FENCE MOUNTED ON DECK

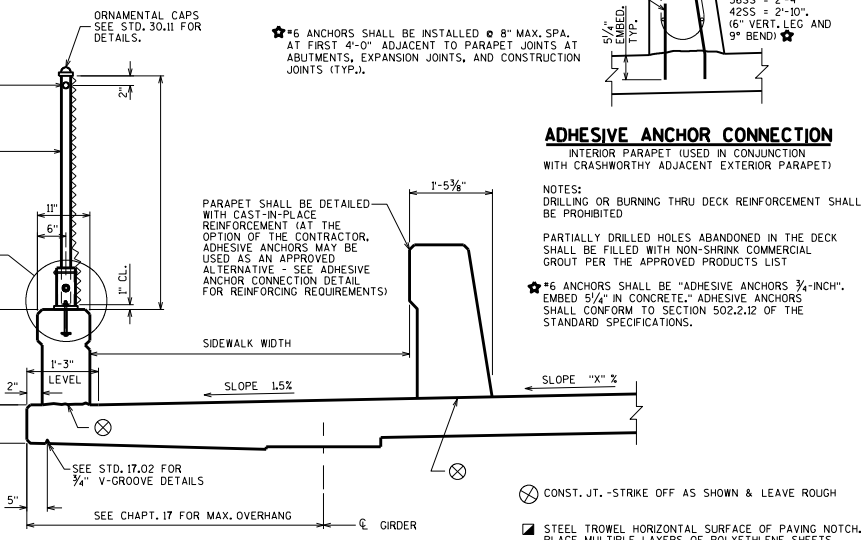

ADHESIVE ANCHOR CONNECTION

INTERIOR PARAPET (USED IN CONJUNCTION WITH CRASHWORTHY ADJACENT EXTERIOR PARAPET)

NOTES:
DRILLING OR BURNING THRU DECK REINFORCEMENT SHALL BE PROHIBITED

PARTIALLY DRILLED HOLES ABANDONED IN THE DECK SHALL BE FILLED WITH NON-SHRINK COMMERCIAL GROUT PER THE APPROVED PRODUCTS LIST

*6 ANCHORS SHALL BE "ADHESIVE ANCHORS 3/4"-INCH." EMBED 5/8" IN CONCRETE. ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.2.12 OF THE STANDARD SPECIFICATIONS.

SECTION THRU PARAPET ON BRIDGE
CHAIN LINK FENCE MOUNTED ON PARAPET


DESIGNER NOTES

'32SS' PARAPET SHOWN IN THIS STANDARD. FOR DETAILS, INCLUDING REINFORCING, SEE STANDARD 30.30. SEE STANDARDS 30.31, 30.32, AND 30.33 FOR SIMILAR DETAILS USED WITH OTHER PARAPET TYPES.

ALL PARAPET FOOTING BARS SHALL BE EPOXY COATED.

DO NOT SHOW THE ADHESIVE ANCHOR CONNECTION DETAIL ON THE PLAN. THE CONTRACTOR MAY REQUEST THIS DETAIL IF DESIRED.

PARAPET FOOTING	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

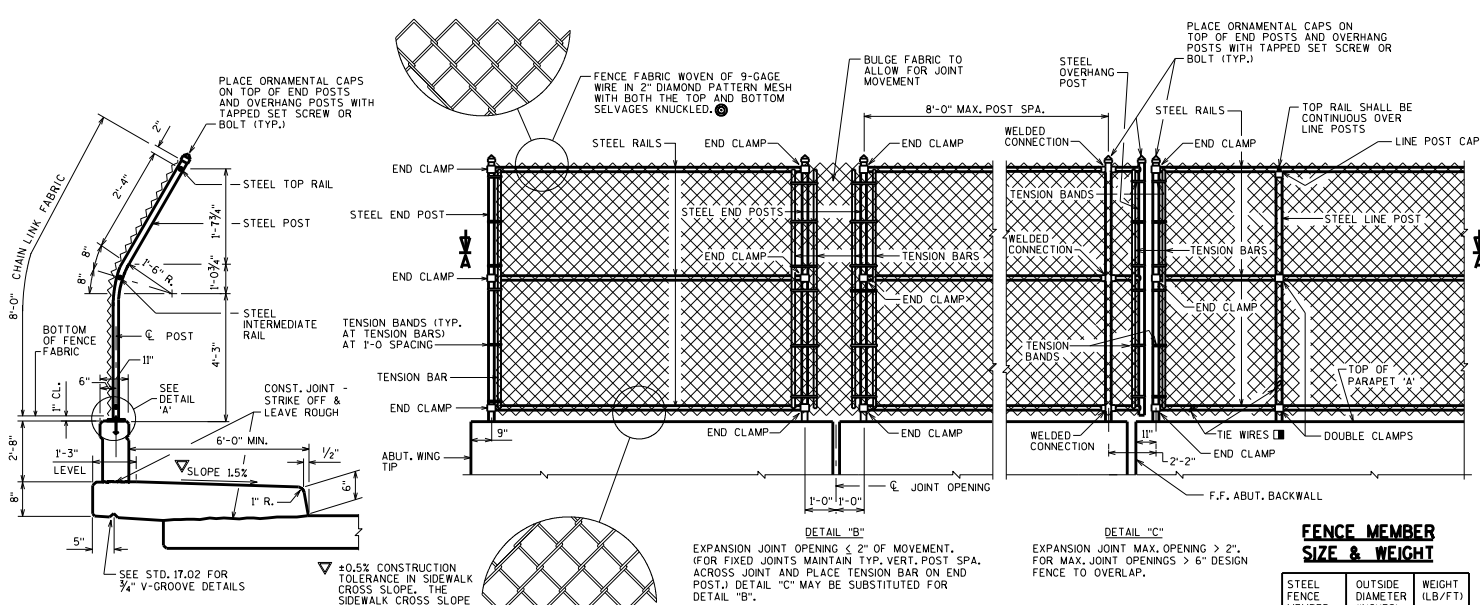

NOTES
POSTS ARE TO BE SET VERTICAL.

METALLIC-COATED FENCE SYSTEM:
ALL FENCE COMPONENTS SHALL BE GALVANIZED STEEL, EXCEPT THE FENCE FABRIC WHICH MAY BE ALUMINUM-COATED STEEL OR GALVANIZED STEEL.

FABRIC SHALL CONFORM TO ASTM A491 OR A392, CLASS 2. STEEL RAILS, POSTS AND POST SLEEVES SHALL CONFORM TO ASTM F1083, STANDARD WEIGHT PIPE (SCHEDULE 40). FITTINGS SHALL CONFORM TO ASTM F626.

THE BID ITEM SHALL BE "FENCE CHAIN LINK - FT.", L.F.

POLYMER-COATED FENCE SYSTEM:
ALL FENCE COMPONENTS SHALL BE GALVANIZED STEEL WITH A COLORED POLYMER-COATING ON THE OUTSIDE.

FABRIC SHALL CONFORM TO ASTM F668, CLASS 2B. STEEL RAILS, POSTS AND POST SLEEVES SHALL CONFORM TO ASTM F1083, STANDARD WEIGHT PIPE (SCHEDULE 40). FITTINGS SHALL CONFORM TO ASTM F626. SEE THE "BRIDGE SPECIAL PROVISIONS" FOR ADDITIONAL DETAILS.

THE COLOR OF POLYMER-COATING FOR THIS STRUCTURE SHALL BE (SPECIFY: DARK GREEN, BROWN OR BLACK) IN ACCORDANCE WITH ASTM F934.

THE BID ITEM SHALL BE "FENCE CHAIN LINK POLYMER-COATED - FT.", L.F.

COMPLETE ANY REQUIRED WELDING OF COMPONENTS BEFORE GALVANIZING.

POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.

BASE PLATES, ANCHOR PLATES AND SHIMS SHALL BE ASTM A709, GRADE 36.

ALL POST SPACINGS ARE MEASURED HORIZONTALLY ALONG THE C/L OF THE POST.

CAULK AROUND PERIMETER OF BASE PLATE AND FILL PORTION OF SLOTTED HOLE AROUND ANCHOR BOLT IN SHIM WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.

ALTERNATE TO DOUBLE CLAMP: USE LINE RAIL CLAMP (BOULEVARD) OR 180° BRACE BAND, WHICH MAY BE USED WHEN THE POSTS ARE EITHER BOLTED TO THE POST SLEEVES OR DIRECTLY WELDED TO THE BASE PLATE.

Δ 1/2" DIA. X 6 3/8" LONG GALVANIZED HEX BOLT WITH NUT & WASHER.

ALTERNATIVE ANCHORAGE: CONCRETE ADHESIVE ANCHORS 1/2"-INCH. EMBED 7" IN CONCRETE. ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.2.12 OF THE STANDARD SPECIFICATIONS.

ATTACH FABRIC TO RAILS, AND TO POSTS WITHOUT TENSION BANDS, WITH THE WIRES (ROUND, 9-GAGE) SPACED AT 1'-0".

BOLT RAIL TO RAIL END TO SECURE OVERHANG SECTION. ALTERNATE IS TO WELD RAIL DIRECTLY TO END POST.

MINIMUM LENGTH OF TOP RAIL BETWEEN SPLICES SHALL BE 20'-0". LOCATE SPLICES NEAR 1/4 POINT OF POST SPACING.

FENCE MEMBER SIZE & WEIGHT



STEEL FENCE MEMBER	OUTSIDE DIAMETER (INCHES)	WEIGHT (LB/FT)
RAILS	1.660	2.27
END POST	2.875	5.80
OVERHANG POST	2.875	5.80
LINE POST	2.375	3.65
POST SLEEVE	4.000	9.12

SECTION THRU FENCE ON PARAPET 'A'

PROTECTIVE SCREENING MAY BE BENT OR STRAIGHT FOR RAISED SIDEWALKS OR SIDEWALKS SEPARATED FROM TRAFFIC BY A BARRIER. SEE BRIDGE MANUAL 30.3 (8) FOR ADDITIONAL GUIDANCE.

∇ $\pm 0.5\%$ CONSTRUCTION TOLERANCE IN SIDEWALK CROSS SLOPE. THE SIDEWALK CROSS SLOPE SHALL NOT EXCEED 2% WITHOUT PRIOR APPROVAL FROM THE ENGINEER.

FENCE PART ELEVATION
(OUTSIDE VIEW OF PARAPET 'A')

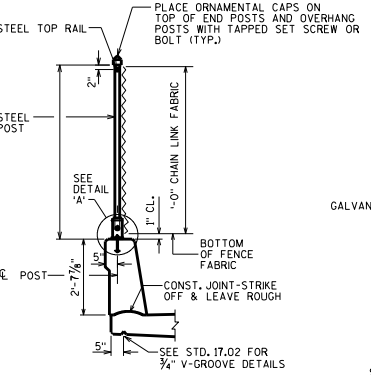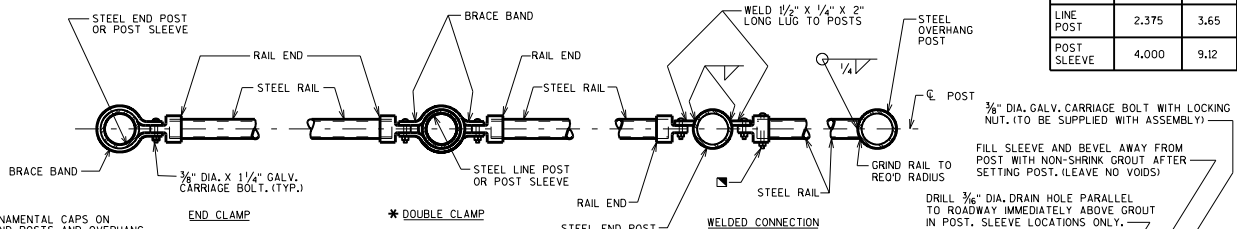


FOR TRAFFIC BARRIER APPLICATION, USE VERTICAL POST (NO BEND)

POST SHIM DETAILS


SHIMS REQUIRED ONLY WHEN END POSTS AND LINE POSTS ARE WELDED TO BASE PLATES. PROVIDE 4 SHIMS PER POST, USE WHERE REQUIRED FOR ALIGNMENT.

ANCHOR PLATE

NOTE: ANCHOR PLATE NOT REQUIRED WHEN ADHESIVE ANCHORS ARE USED.

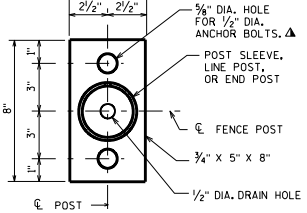

BASE PLATE

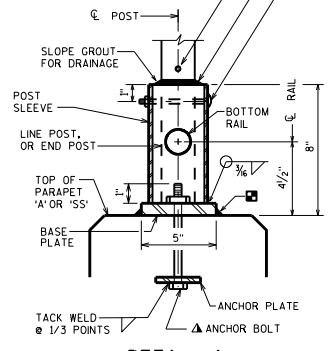

UNIT SHALL BE GALVANIZED AFTER FABRICATION

NOTE: IN LIEU OF USING THE POST SLEEVE, THE FENCE POST MAY BE WELDED TO THE BASE PLATE.

DESIGNER NOTES

THE CHAIN LINK FENCE SYSTEM SELECTED FOR THE STRUCTURE SHALL BE A "METALLIC-COATED FENCE SYSTEM" OR A "POLYMER-COATED FENCE SYSTEM".

A 1" MESH MAY BE USED ON PROTECTIVE SCREENING IN HIGHLY VULNERABLE AREAS, OR AS STATED IN FDM PROCEDURE 11-35-1 FOR PROTECTIVE SCREENING.

PEDESTRIAN RAILING MAY BE USED ON WINDWALL PARAPETS IF CHAIN LINK FENCE DOES NOT CONTINUE BEYOND BRIDGE.


HANDRAILS SHALL BE USED ALONG BRIDGE SIDEWALKS WHERE THE SLOPE OF THE SIDEWALK IS GREATER THAN 5%. TOP OF HANDRAIL GRIPPING SURFACES SHALL BE MOUNTED BETWEEN 30" & 34" ABOVE SIDEWALK SURFACE. USE 30" NEAR SCHOOL ZONES, IF FEASIBLE. HANDRAILS SHALL BE PROVIDED ALONG BOTH SIDES OF SIDEWALK. FOR HANDRAIL DETAILS SEE STANDARD 37.02.

THE DESIGN ENGINEER SHALL DESIGN THE SUPERSTRUCTURE TO ACCOUNT FOR THE MAXIMUM 2% SIDEWALK CROSS SLOPE.


CHAIN LINK FENCE DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

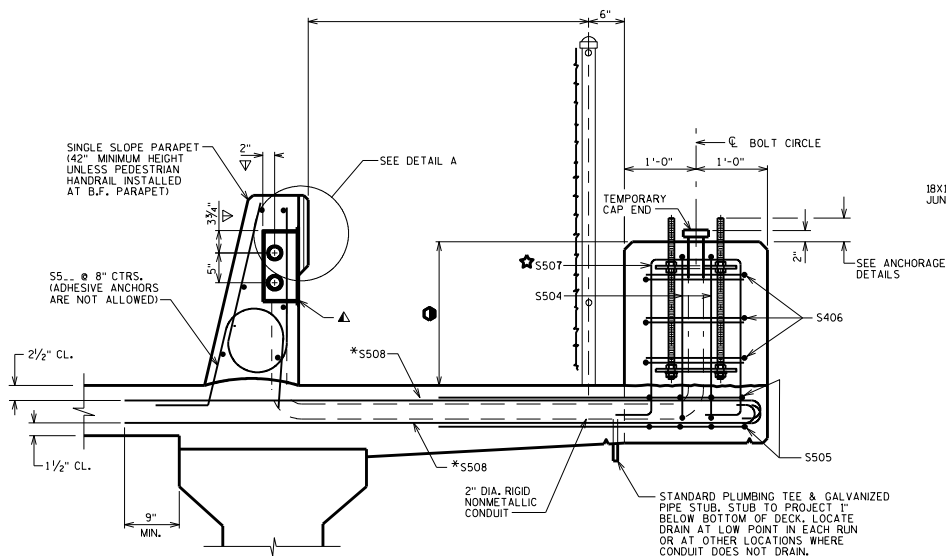

SECTION A-A



DETAIL A
SHOWING B.F. OF PARAPET WITH BLOCK OUT FOR JUNCTION BOX.


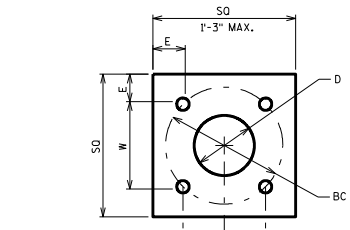



TABLE FOR "TYPE 6 LIGHT POLE"
FROM FACILITIES DEV. MANUAL
WITH 1" DIA. ANCHOR BOLTS.
(ANY OTHER LIGHT POLE TYPE
MUST BE DESIGNED FOR.)

SO	1-1/2"
E	2 1/16"
W	8 1/8"
BC	1 1/2"
D	9 1/2"

W = 0.707 x BC
SO = BC + 2d
d = ANCHOR BOLT DIA.
E = ISO-W/2
D_{MAX} = BC - 2d
D_{MIN} = 2 X CONDUIT DIA. + 1"

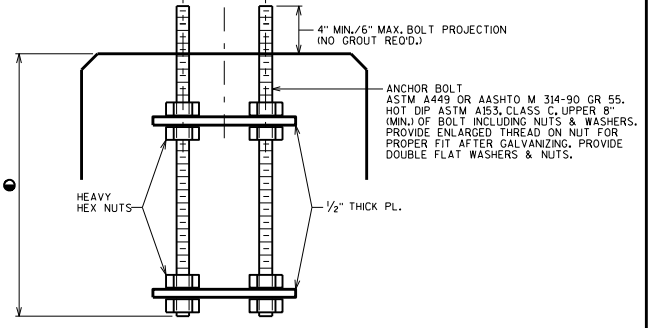

ANCHORAGE DETAIL

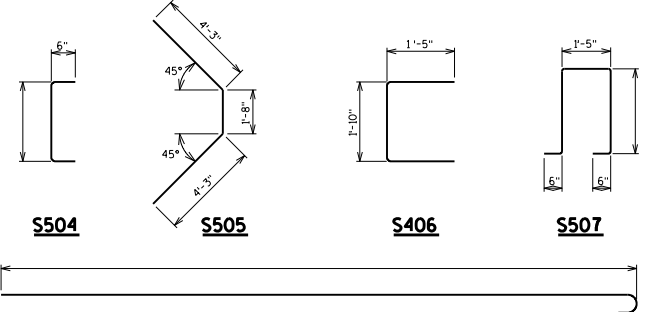

S504

S505

S406

S507

S508

- STAND-ALONE PEDESTAL
- 1" DIA. ANCHOR BOLTS = 2'-0"
- < 1" DIA. ANCHOR BOLTS = 1'-3"
- STAND-ALONE PEDESTAL
- 1" DIA. ANCHOR BOLTS = 1'-11"
- < 1" DIA. ANCHOR BOLTS = 1'-2"

- ▲ PARAPET BLISTER
- SEE STANDARD 30.21
- ▽ CUT OUT ± 1" OF GASKET AT BOTTOM OF JUNCTION BOX COVER TO ALLOW FOR DRAINAGE.
- ▽ LOCATION OF CONDUIT IS MEASURED FROM OUTSIDE EDGE OF JUNCTION BOX.
- ☆ TIE IN PLACE AFTER ANCHOR BOLT ASSEMBLY LOCATED.
- * THESE BARS ARE IN ADDITION TO STANDARD TRANSVERSE BARS IN DECK.


NOTES

BID ITEM SHALL BE "ANCHOR ASSEMBLIES LIGHT POLES" EA.
SEE STD. 30.11 FOR FENCE DETAILS.
SEE STD. 30.21 FOR
- ADDITIONAL NOTES
- END OF BRIDGE DETAILS

THIS STANDARD ACCOMMODATES A MAXIMUM 15" DIA. BOLT HOLE CIRCLE AND A MAXIMUM 15" X 15" SQUARE ANCHOR PLATE WITH (4) - 1" DIA. ANCHOR BOLTS. THIS STANDARD IS BASED ON A 8" MIN. DECK THICKNESS.

BILL OF BARS

BAR MARK	CON'T.	NO. REQ'D.	LENGTH	BENT	LOCATION
S504	X			X	LIGHT STD., VERT.
S505	X	10-2		X	LIGHT STD., HORIZ. IN DECK
S406	X	4-6		X	LIGHT STD., HORIZ.
S507	X			X	LIGHT STD., VERT.
S508	X			X	LIGHT STD., TRANSV. IN DECK

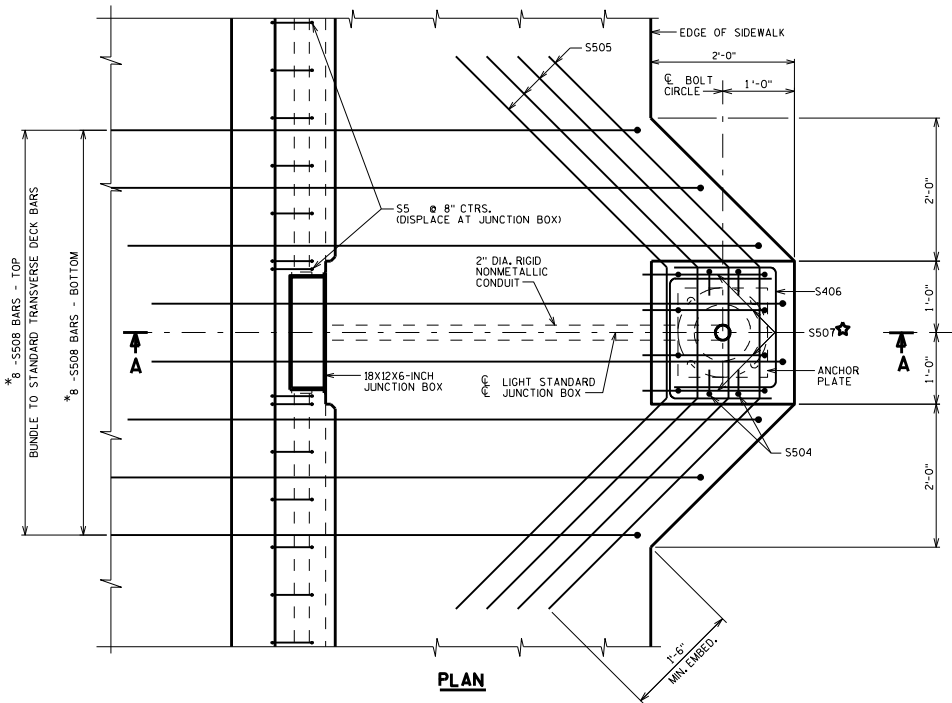


PLAN

LIGHTING DETAIL

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

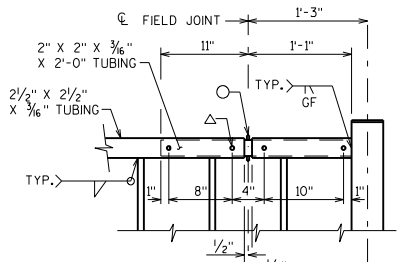


LEGEND
 ○ 5/16" x 3/8" WELDED STUDS
 △ WELD BEAD ON EACH SIDE OF TUBE, GRIND BEADS SO THAT SLEEVE FITS FREELY INSIDE THE 2 1/2" X 2 1/2" TUBE.

RAILING EXPANSION JOINT DETAIL

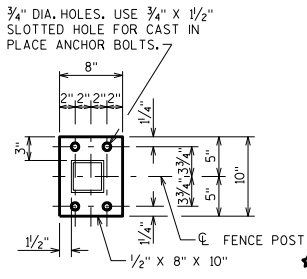


BASE PLATE

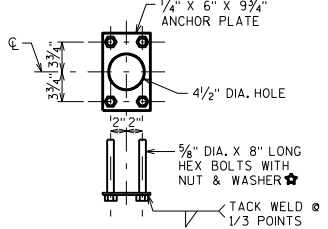

ANCHORAGE DETAIL


★ ALTERNATIVE ANCHORAGE: ADHESIVE ANCHORS 5/8-INCH. EMBED 7" IN CONCRETE. ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.2.12 OF THE STANDARD SPECIFICATIONS.

NOTE: ANCHOR PLATE NOT REQUIRED WHEN ADHESIVE ANCHORS ARE USED.




SHIM PLATE DETAILS


TWO SHIMS OF EACH SIZE REQUIRED PER POST

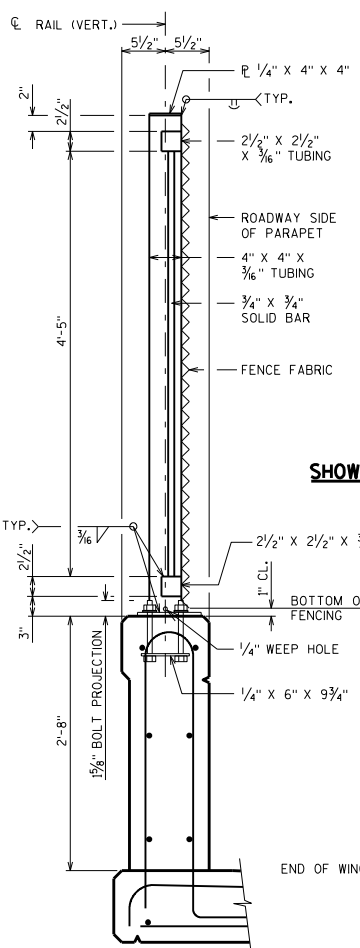


SECTION THRU RAILING

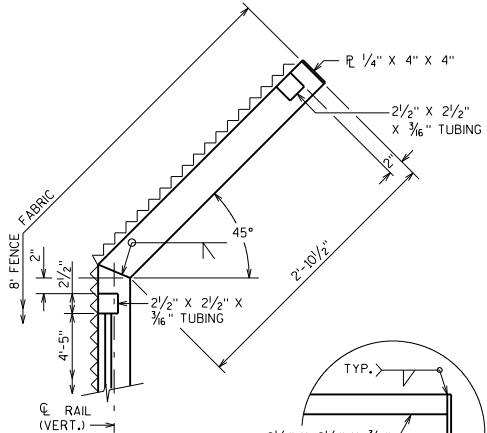

SECTION THRU FENCE SHOWING DETAILS FOR BENT TOP

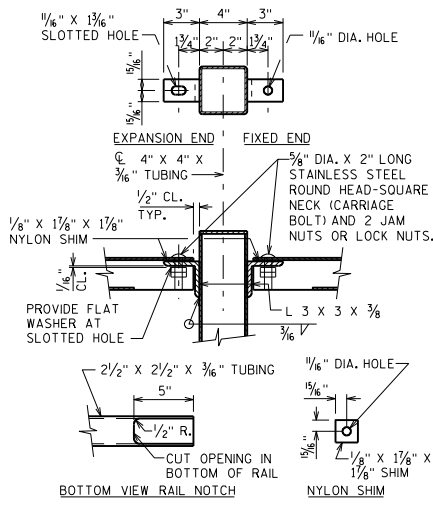


TOP RAIL CONNECTION FOR FENCE W/ BENT TOP

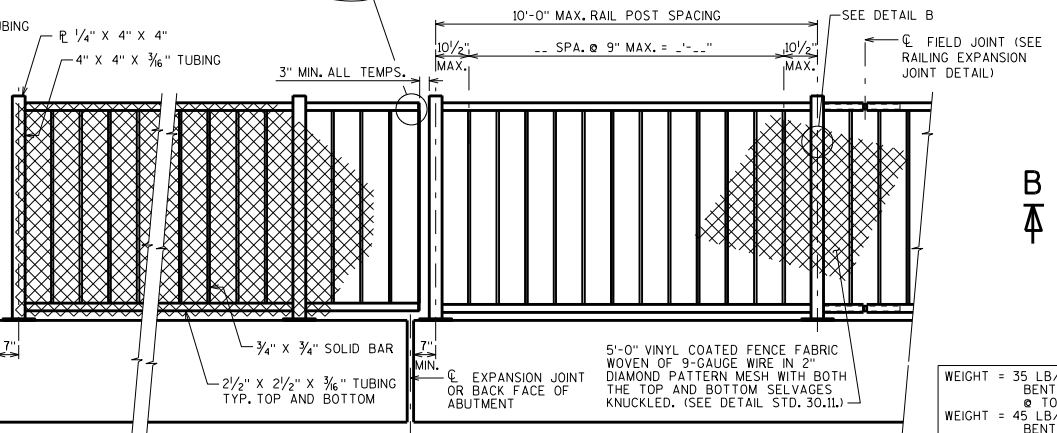

INSIDE ELEVATION OF RAILING

5'-0" VINYL COATED FENCE FABRIC WOVEN OF 9-GAUGE WIRE IN 2" DIAMOND PATTERN MESH WITH BOTH THE TOP AND BOTTOM SELVAGES KNUCKLED. (SEE DETAIL STD. 30.11L)

WEIGHT = 35 LB/FT (W/O BENT SECTION @ TOP)
 WEIGHT = 45 LB/FT (W/ BENT SECTION @ TOP)

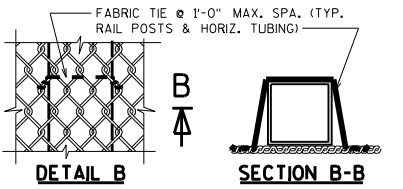

DETAIL B

SECTION B-B

NOTES

POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.

STRUCTURAL TUBING SHALL CONFORM TO ASTM A500, GRADE B. PLATES, ANGLES, BARS AND SHIMS SHALL CONFORM TO ASTM A709, GRADE 36. FENCE FABRIC SHALL CONFORM TO ASTM F668, CLASS 2B.

ANCHORAGES SHALL BE ACCURATELY PLACED TO PROVIDE CORRECT ALIGNMENT OF RAILING. SET POSTS NORMAL TO GRADE.

ALL POST SPACINGS ARE TAKEN HORIZONTAL ALONG CENTERLINE OF RAILING AT BASE OF POST.

STEEL SHIMS SHALL BE PROVIDED & USED UNDER BASE PLATES WHERE REQUIRED FOR ALIGNMENT, AND SHALL BE GALVANIZED.

CAULK AROUND PERIMETER OF BASE PLATES AND FILL PORTION OF SLOTTED HOLES AROUND ANCHOR BOLTS WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.

CUT BOTTOM OF POST TO MAKE VERTICAL IN TRANSVERSE DIRECTION.

ANCHOR BOLTS, NUTS AND WASHERS SHALL BE EITHER STAINLESS STEEL OR ASTM 307. IF 307 IS USED, ANCHOR BOLTS, NUTS, AND WASHERS SHALL BE GALVANIZED.

THE BID ITEM SHALL BE "RAILING TUBULAR SCREENING BENT TOP" WHICH SHALL INCLUDE ALL ITEMS SHOWN.

RAILING SHALL BE FABRICATED IN LENGTHS THAT INCLUDE NOT MORE THAN 3 POSTS.

VENT HOLES SHALL BE DRILLED IN MEMBERS AS REQUIRED TO FACILITATE GALVANIZING AND DRAINAGE.

ALL RAILING MATERIAL SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING THE STEEL RAILING SHALL BE GIVEN A NO. 6 BLAST CLEANING PER SSPC SPECIFICATIONS. PAINT OVER GALVANIZING WITH AN APPROVED THE COAT AND TOP COAT AS SPECIFIED IN THE CONTRACT DOCUMENTS. THE RAILING SHALL BE PAINTED FEDERAL COLOR NO. [] (FILL IN COLOR NAME). FENCE FABRIC AND TIES TO BE VINYL-COATED. COLOR SHALL BE (SPECIFY: DARK GREEN, BROWN OR BLACK) IN ACCORDANCE WITH ASTM F934.

THE END OF THE FABRIC SHALL BE ATTACHED TO THE POST BY MEANS OF A TENSION BAR THREADED THROUGH THE END LOOPS OF THE FABRIC AND SECURED TO THE POST WITH CLAMPS & BOLT. THE FABRIC SHALL BE STRETCHED TO REMOVE ALL SLACK.

DESIGNER NOTES

TUBULAR SCREENING MAY BE USED ON STRUCTURES WITH A 45 M.P.H. DESIGN SPEED OR LESS, OR WHEN THE SIDEWALK IS SEPARATED FROM THE ROADWAY BY A PARAPET.

THIS RAILING MAY BE MOUNTED DIRECTLY TO A BRIDGE SIDEWALK OR RETAINING WALL PROVIDED THE SIDEWALK IS SEPARATED FROM THE ROADWAY BY A TRAFFIC BARRIER. USE 6" CLEAR SPACING BETWEEN VERTICAL MEMBERS IF CHAIN LINK FENCE IS NOT USED.

FENCE HEIGHT, CURVED OR STRAIGHT, MESH SIZE, COATING AND COLOR SHOULD BE COORDINATED WITH THE REGION. SEE BRIDGE MANUAL 30.3 (8) FOR ADDITIONAL GUIDANCE.


FABRIC TIE @ 1'-0" MAX. SPA. (TYP. RAIL POSTS & HORIZ. TUBING)

TUBULAR STEEL RAILING SCREENING


STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*

DATE: 7-16

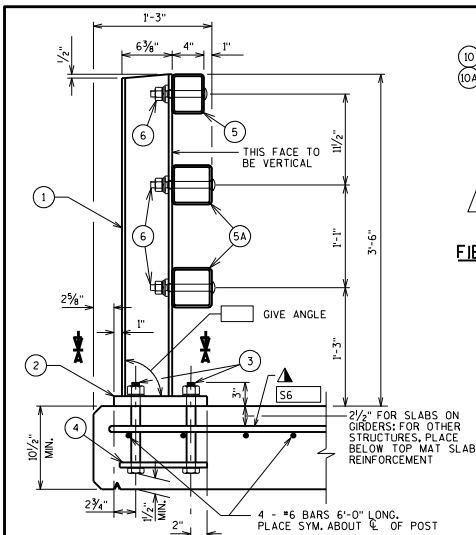


SECTION THRU RAILING ON DECK

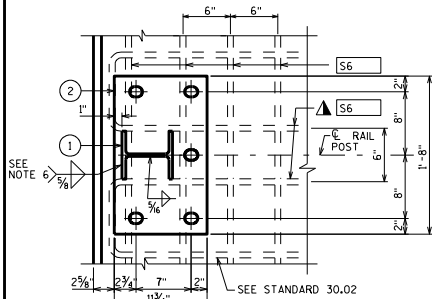


SECTION A-A

▲ TIE TO TOP MAT OF STEEL.


▣ RDWY. OPENING OR 2 1/2" MIN. FOR STRIP SEAL EXP. JOINT & 1/2" OPENING FOR A1 ABUTMENT.

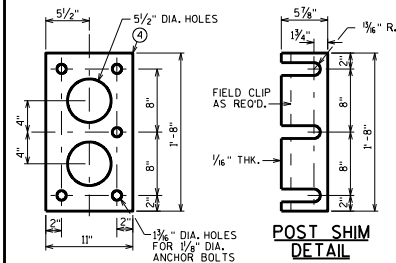

ANCHOR PLATE AT RAIL TO DECK CONNECTION

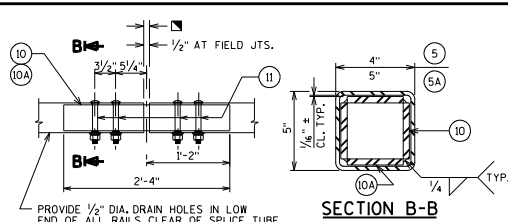


FIELD ERECTION JOINT DETAIL




ANCHOR BOLTS

*FOR ANCHOR BOLTS IN WINGS, TACK WELD MAY BE USED IN FIELD AFTER ANCHOR PLATE IS IN POSITION IF REOD. FOR CONSTRUCTIBILITY.




SHOP RAIL SPLICE DETAIL

(LOCATION MUST BE SHOWN ON SHOP DRAWINGS)

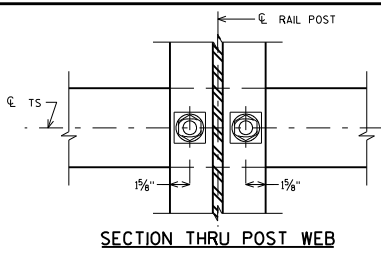


SECTION THRU POST WEB

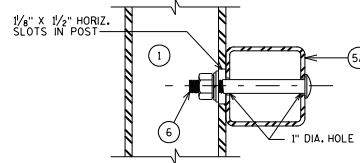


SECTION THRU RAIL

NOTE: CONNECTIONS AT LOWER RAILS SHOWN. CONNECTIONS AT TOP RAIL SIMILAR.


TYPICAL RAIL TO POST CONNECTIONS

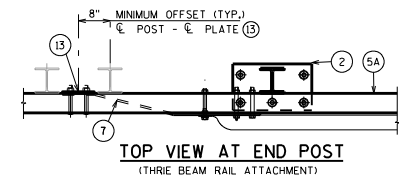


TOP VIEW AT END POST (THREE BEAM RAIL ATTACHMENT)

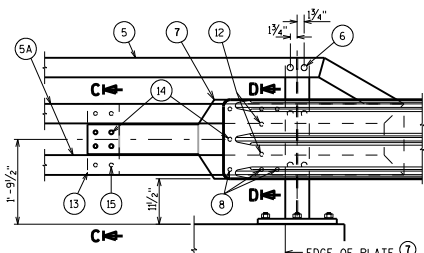


DETAIL AT END POST (THREE BEAM RAIL ATTACHMENT)



SECTION C-C SECTION D-D

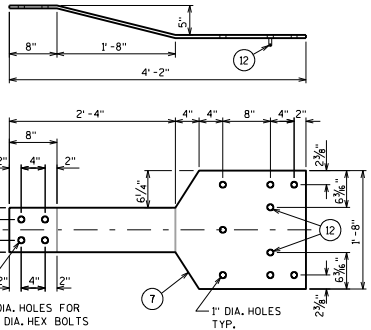

BACK-UP PLATE DETAIL AT BEAM GUARD ATTACHMENT

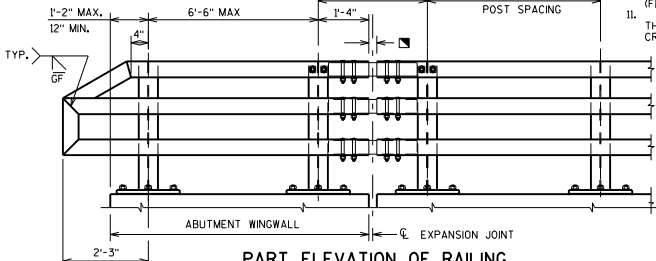

PART ELEVATION OF RAILING

LEGEND


- ① W6 x 25 WITH 1/4" X 1/2" HORIZONTAL SLOTS ON EACH SIDE OF POST FOR BOLT NO. 6. CUT BOTTOM OF POST TO MATCH CROSS SLOPE OF ROADWAY. PLACE POST VERTICAL. PLACE POSTS NORMAL TO GRADE LINE.
- ② PLATE 1/4" X 11 1/4" X 1-8" WITH 1 1/2" X 1 1/2" SLOTTED HOLES FOR ANCHOR BOLTS NO. 3. WELD TO NO. 1A'S SHOWN. SLOTS PARALLEL TO SHORT SIDE OF PLATE.
- ③ ASTM A449 - 1/2" DIA. ANCHOR BOLTS WITH NUT AND HARDENED WASHER (ALL GALVANIZED), 5 REOD. PER POST. THREAD 3" AND PLACE NORMAL TO PLATE NO. 2. CHAMFER TOP OF BOLTS BEFORE THREADING. USE 1-9" LONG IN ABUTMENT WINGS. AT POSTS ON CONCRETE SLAB SUPERSTRUCTURES WHERE THE SLAB THICKNESS IS > 16" USE 1-9" LONG. USE 10 3/4" LONG AT ALL OTHER LOCATIONS. (AN EQUIVALENT THREADED ROD WITH NUTS AND HARDENED WASHERS MAY BE SUBSTITUTED FOR ANCHOR BOLTS IN WINGS IF REOD. FOR CONSTRUCTIBILITY.)
- ④ 3/8" X 11" X 1-8" ANCHOR PLATE (GALVANIZED) WITH 1 1/2" DIA. HOLES FOR ANCHOR BOLTS NO. 3.
- ⑤ TS 5 x 4 x 0.25 STRUCTURAL TUBING. ATTACH TO NO. 1 WITH NO. 6.
- ⑥ TS 5 x 5 x 0.25 STRUCTURAL TUBING. ATTACH TO NO. 1 WITH NO. 6.
- ⑦ 1/4" DIA. A325 SLOTTED ROUND HEAD BOLT WITH NUT, 3/4" X 1 1/2" X 1 1/2" WASHER, AND LOCK WASHER (2 REOD. AT EACH RAIL TO POST LOCATION.)
- ⑧ 1/2" THK. BACK-UP PLATE WITH 2 - 7/8" X 1/2" THREADED SHOP WELDED STUDS (NO. 12). BOLT TO RAIL AS SHOWN IN DETAIL. REQUIRED AT THREE BEAM GUARD RAIL ATTACHMENTS ONLY. PLACE SYMMETRICALLY ABOUT TUBES NO. 5A.
- ⑨ 1" DIA. HOLES IN PLATE NO. 7 & TUBES NO. 5A FOR 7/8" DIA. A325 BOLTS WITH HEX NUTS AND WASHERS. 6 HOLES IN TUBES AND PLATE NO. 7.
- ⑩ SPLICE SLEEVE FABRICATED FROM 1/4" PLATE. PROVIDE "SLIDING FIT".
- ⑪ 3/8" X 3 3/8" X 2'-4" PLATE. 2 PER RAIL. USED IN NO. 5 & 5A.
- ⑫ 3/8" X 2 3/8" X 2'-4" PLATE USED IN NO. 5. 3/8" X 3 3/8" X 2'-4" PLATE USED IN NO. 5A. 2 PER RAIL.
- ⑬ 7/8" DIA. A325 ROUND HEAD BOLT WITH NUT, WASHER, AND LOCK WASHER. USE 1 1/2" X 1 1/2" LONG. SLOTTED HOLES AT EXP. JOINTS IN PLATE NO. 10A.
- ⑭ 7/8" DIA. X 1 1/2" LONG THREADED SHOP WELDED STUDS (2 REOD.).
- ⑮ 3/4" X 8" X 1-6" PLATE. BOLT TO RAIL AS SHOWN IN DETAIL. REQUIRED AT THREE BEAM GUARD RAIL ATTACHMENTS ONLY. PLACE SYMMETRICALLY ABOUT TUBES NO. 5A.
- ⑯ 7/8" DIA. X 2" LONG A325 HEX BOLT WITH NUT AND WASHER (5 REOD.).
- ⑰ 1" DIA. HOLES IN TUBES NO. 5A FOR 7/8" DIA. A325 ROUND HEAD BOLT WITH NUT, WASHER, AND LOCK WASHER (4 REOD.). 4 HOLES IN TUBES.

NOTES


1. BID ITEM SHALL BE "RAILING TUBULAR TYPE M B-1-1" WHICH INCLUDES ALL ITEMS SHOWN.
2. RAIL POST AND BASE PLATES SHALL CONFORM TO THE REQUIREMENTS OF ASTM A709 GRADE 50. HOLLOW RAILING STRUCTURAL TUBING SHALL CONFORM TO THE REQUIREMENTS OF ASTM A500 GRADE B OR C WITH A CERTIFIED F_y = 50 KSI. ANCHOR PLATES, AND SPLICE TUBE PLATES SHALL CONFORM TO THE REQUIREMENTS OF ASTM A709 GRADE 36.
3. THE NUT SECURING THE POST BASE PLATE TO THE CONCRETE SHALL BE TIGHTENED TO A SNUG FIT AND GIVEN AN ADDITIONAL 1/8 TURN.
4. RAILS SHALL BE CONTINUOUS OVER A MINIMUM OF THREE (3) POSTS WITHOUT SPLICES WHERE POSSIBLE. RAILS SHALL BE SPLICED IN A PANEL OVER EXPANSION JOINTS.
5. ENDS OF TUBE SECTIONS SHALL BE SAWED. GRIND SMOOTH EXPOSED EDGES. ALL CUT ENDS SHALL BE TRUE AND SMOOTH.
6. WELD IS THE SAME ON BOTH FLANGES. FLANGE WELD DOES NOT REQUIRE MAGNETIC PARTICLE TESTING.
7. FILL BOLT SLOT OPENINGS IN POST SHIMS AND PLATE NO. 2 AND CAULK AROUND PERIMETER OF PLATE NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER. STEEL POST SHIMS MAY BE USED UNDER POSTS WHERE REOD. FOR ALIGNMENT.
8. POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.
9. ALL MATERIAL SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING, ALL STEEL RAILING POSTS & STEEL TUBING SHALL BE GIVEN A NO. 6 BLAST CLEANING BY SSPC SPECIFICATIONS.
10. WHEN PAINTING IS REQUIRED, ALL MATERIAL EXCEPT ANCHORAGE DETAIL (NO. 3 & 4) SHALL BE PAINTED OVER GALVANIZING WITH AN APPROVED TIE COAT AND TOP COAT AS SPECIFIED IN THE CONTRACT DOCUMENTS. THE RAILING SHALL BE PAINTED FEDERAL COLOR NO. [] . (FILL IN COLOR NAME).
11. THIS RAILING MEETS NCHRP REPORT 350 EVALUATION CRITERIA FOR TEST LEVEL 4 (TL-4).

RAILING WEIGHT = 75 LB/FT (BASED ON 6'-6" POST SPACING.)


TUBULAR STEEL RAILING TYPE 'M'	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

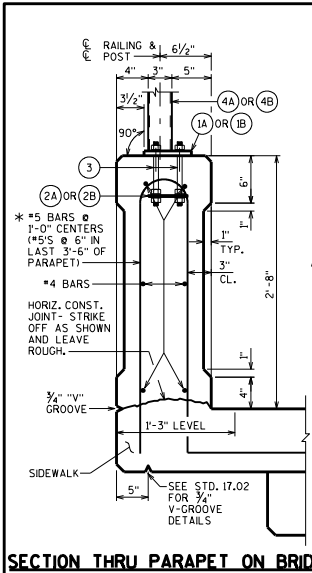


SECTION THRU PARAPET ON BRIDGE
 *ADJUST LOCATIONS OF BARS TO ALLOW PLACEMENT OF ANCHOR ASSEMBLY FOR RAILING AND BEAM GUARD (WHEN REQ'D.).




ANCHORAGE FOR END RAIL
 NOTE: USE 8\"/>

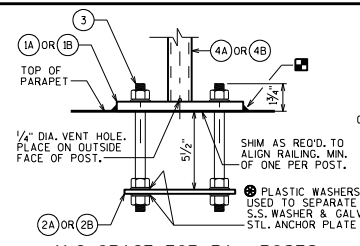


ANCHORAGE FOR RAIL POSTS
 NOTE: ANCHOR PLATE NOT REQUIRED WHEN ADHESIVE ANCHORS ARE USED.

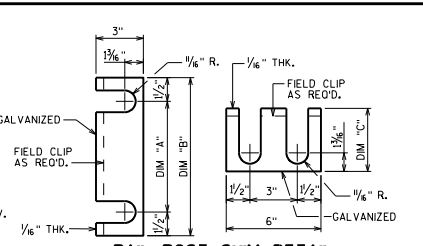


RAIL POST SHIM DETAIL
 6\"/>



SHOP RAIL SPLICE DETAIL
 (LOCATION MUST BE SHOWN ON SHOP DRAWINGS)

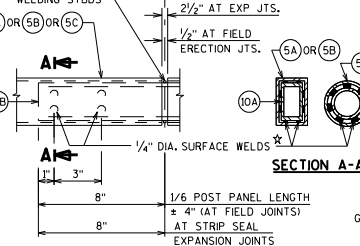


FIELD ERECTION JOINT DETAIL
 *MIN. 3/8\"/>

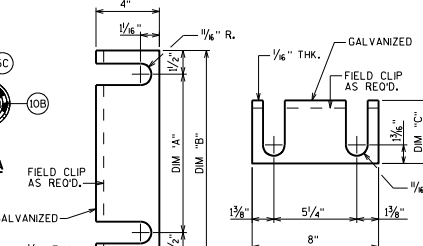


END RAIL SHIM DETAIL
 8\"/>


- LEGEND**
- 1A PLATE 3/4\"/>
 - 1B PLATE 3/8\"/>
 - 1C PLATE 3/8\"/>
 - 1D PLATE 3/8\"/>
 - 1E PLATE 3/8\"/>
 - 2A 1/4\"/>
 - 2B 1/4\"/>
 - 2C 3/8\"/>
 - 2D 1/4\"/>
 - 2E 1/4\"/>
 - 3A STRUCTURAL TUBING 3\"/>
 - 3B STRUCTURAL TUBING 3\"/>
 - 3C STRUCTURAL TUBING 3\"/>
 - 3D STRUCTURAL TUBING 3\"/>
 - 3E STRUCTURAL TUBING 2 1/2\"/>
 - 3F BAR 1\"/>
 - 3G BAR 1\"/>
 - 3H STRUCTURAL TUBING 5\"/>
 - 3I RECTANGULAR SLEEVE FABRICATED FROM 3/8\"/>
 - 3J CIRCULAR SLEEVE FABRICATED FROM STRUCTURAL TUBING 2\"/>
 - 3K BAR 2 1/2\"/>
 - 3L STRUCTURAL TUBING 2\"/>
 - 3M 1/2\"/>

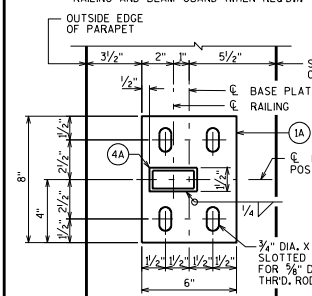


TYPICAL RAIL POST BASE PLATE
 FOR 3\"/>




ANCHOR PLATE
 FOR 3\"/>

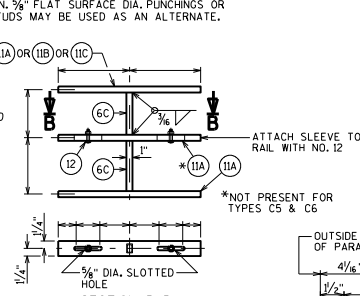


MODULAR JOINT SLEEVE DETAIL

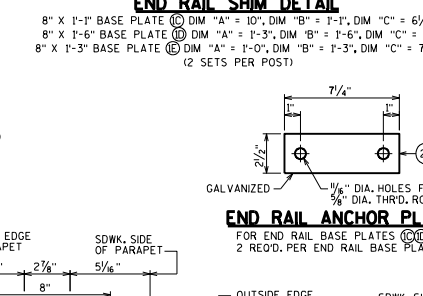


END RAIL ANCHOR PLATE
 FOR END RAIL BASE PLATES (1A)(1B)(1C)
 2 REQ'D. PER END RAIL BASE PLATE

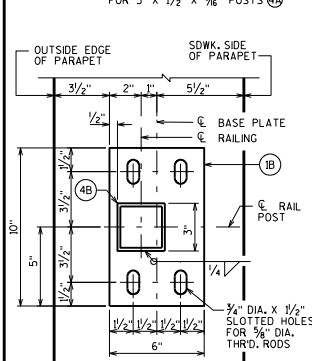


TYPICAL RAIL POST BASE PLATE
 FOR 3\"/>

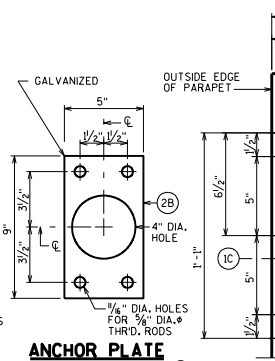


ANCHOR PLATE
 FOR 3\"/>

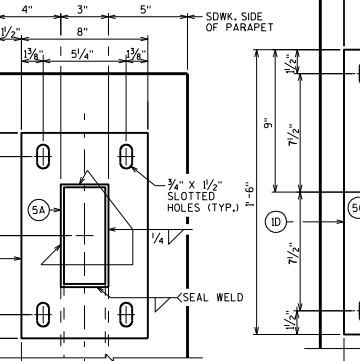

END RAIL BASE PLATE
 FOR 3\"/>

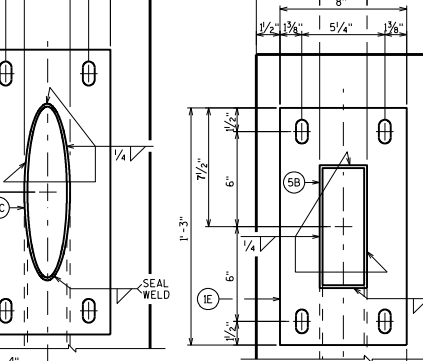


END RAIL BASE PLATE
 FOR 2 1/2\"/>

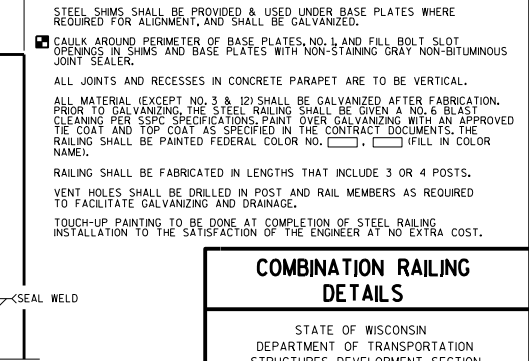


END RAIL BASE PLATE
 FOR 3\"/>

- NOTES**
- BID ITEM SHALL BE "RAILING STEEL TYPE (C11-6) B-...", WHICH SHALL INCLUDE ALL STEEL ITEMS SHOWN.
 - POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS.
 - ALL PLATES, BARS, AND RECTANGULAR SLEEVES SHALL CONFORM TO ASTM A709 GRADE 36. ALL STRUCTURAL TUBING SHALL CONFORM TO ASTM A500 GRADE B.
 - ANCHORAGES SHALL BE ACCURATELY PLACED TO PROVIDE CORRECT ALIGNMENT OF RAILING. SET NORMAL TO GRADE.
 - CUT BOTTOM OF POST TO MAKE POST VERTICAL IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTION.
 - STEEL SHIMS SHALL BE PROVIDED & USED UNDER BASE PLATES WHERE REQUIRED FOR ALIGNMENT, AND SHALL BE GALVANIZED.
 - CAULK AROUND PERIMETER OF BASE PLATES, NO. 1, AND FILL BOLT SLOT OPENINGS IN SHIMS AND BASE PLATES WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.
 - ALL JOINTS AND RECESSES IN CONCRETE PARAPET ARE TO BE VERTICAL.
 - ALL MATERIAL (EXCEPT NO. 3 & 12) SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING, THE STEEL RAILING SHALL BE GIVEN A NO. 6 BLAS CLEANING PER SSPC SPECIFICATIONS, PAINT OVER GALVANIZING WITH AN APPROVED PRIMER COAT AND TOP COAT AS SPECIFIED IN THE CONTRACT DOCUMENTS. THE RAILING SHALL BE PAINTED FEDERAL COLOR NO. [] (FILL IN COLOR NAME).
 - RAILING SHALL BE FABRICATED IN LENGTHS THAT INCLUDE 3 OR 4 POSTS.
 - VENT HOLES SHALL BE DRILLED IN POST AND RAIL MEMBERS AS REQUIRED TO FACILITATE GALVANIZING AND DRAINAGE.
 - TOUCH-UP PAINTING TO BE DONE AT COMPLETION OF STEEL RAILING INSTALLATION TO THE SATISFACTION OF THE ENGINEER AT NO EXTRA COST.

COMBINATION RAILING DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

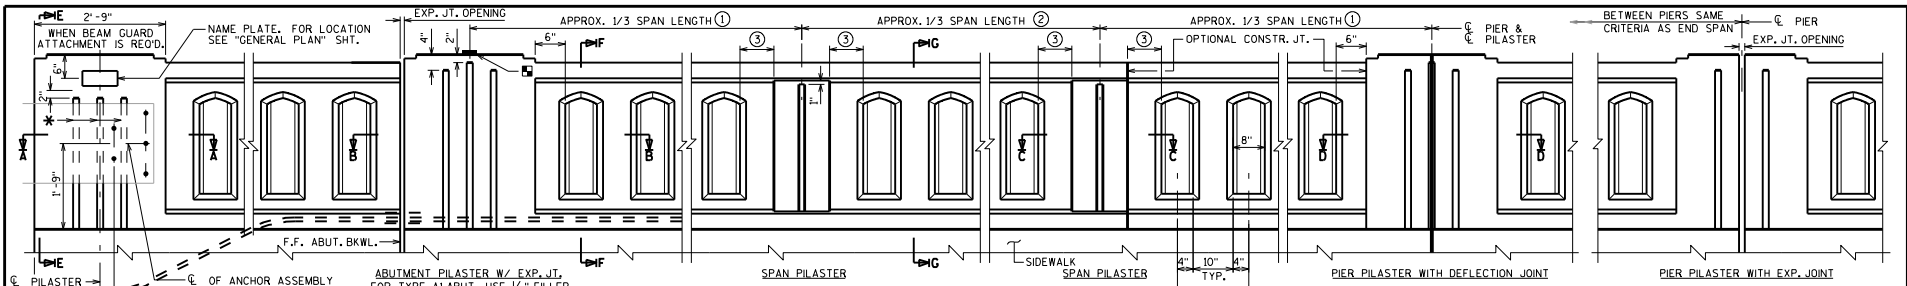

INSIDE ELEVATION

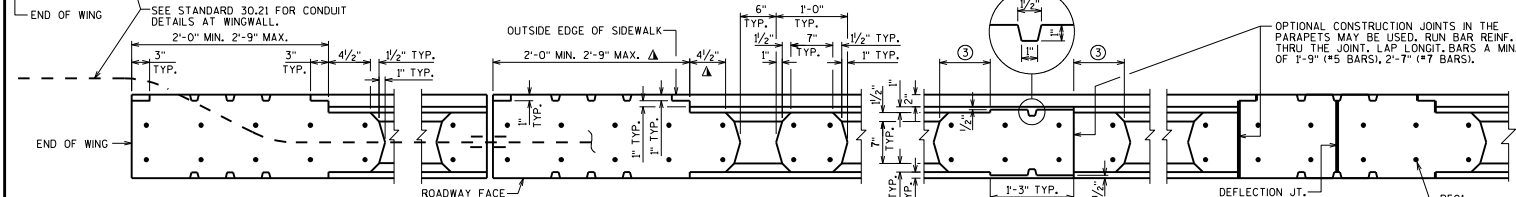

- ① NUMBER OF WINDOWS SHALL BE EQUAL.
- ② NUMBER OF WINDOWS SHALL NOT BE LESS THAN THE AMOUNT IN Δ SPAN PILASTERS MAY BE SPACED AT 1/5 POINTS IN LONG SPANS.
- ③ DIMENSION SHALL BE THE SAME FOR ALL POSTS ADJACENT TO SPAN PILASTERS IN A SPAN. DIMENSION MAY VARY FROM SPAN TO SPAN. MIN. = 3". MAX. = 7/2".


NOTES

BID ITEM SHALL BE "PARAPET CONCRETE TYPE 'TX'", WHICH SHALL INCLUDE ALL ITEMS SHOWN.


WHEN PARAPETS ARE POURED CONTINUOUSLY FROM END TO END, THEY SHALL BE SEPARATED AT THE DEFLECTION JOINTS BY A PIECE OF 1/8" ZINC OR PLASTIC PLATE CUT AS SHOWN ON STANDARD 30.07. IF CONSTRUCTION JOINTS IN PARAPETS ARE USED AT THE DEFLECTION JOINTS, ONE SIDE OF JOINT SHALL BE COATED WITH BITUMINOUS PAINT AND PLATE SEPARATORS MAY BE OMITTED.

SEE STD. 30.07 FOR
 - DEFLECTION JOINT DETAILS
 - ANCHOR ASSEMBLY DETAILS
 - SIDEWALK REINFORCEMENT AND DETAILS


- Δ LOCATION OF CONDUIT IS MEASURED FROM OUTSIDE EDGE OF JUNCTION BOX.
- Δ VALUE APPLIES TO PIER PILASTER ALSO.
- CONST. JOINT - STRIKE OFF AS SHOWN AND LEAVE ROUGH.
- * WHEN BEAM GUARD ATTACHMENT IS NOT REQ'D, BUT NAME PLATE IS PRESENT, USE RUSTICATIONS AS SHOWN. (AT ENDS W/O NAME PLATE AND BEAM GUARD ATTACHMENT USE RUSTICATION DETAILS AS SHOWN FOR ABUTMENT PILASTER.

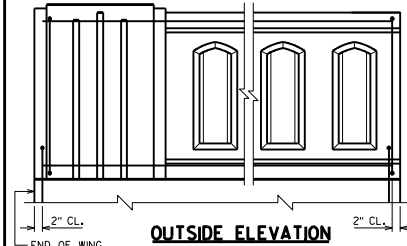

OUTSIDE ELEVATION

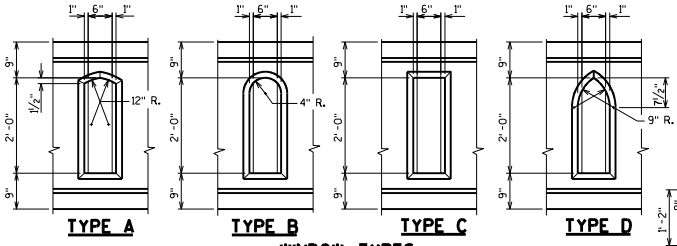

WINDOW TYPES

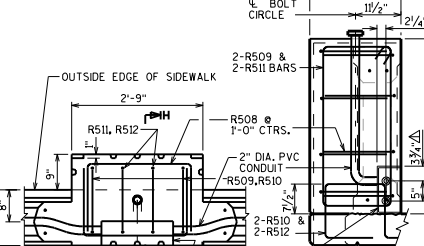

LIGHT STANDARD




SEE STANDARD 30.14 FOR CONDUIT AND ANCHORAGE DETAILS.
 FOR ELECTRICAL REQUIREMENTS FOR LIGHTING SEE "NOTES" ON STANDARD 30.2L.

WEIGHT = 350 LB/FT (EXCLUDING PILASTERS.)

■ BENCH MARK CAP (WHEN SUPPLIED), AVOID PLACING A BENCH MARK CAP BELOW A RAIL OR FENCE SYSTEM THAT IS ATTACHED TO THE TOP OF THE PARAPET.

BILL OF BARS


BAR MARK	CO ₂	NO. REQ'D.	LENGTH	BEVY	LOCATION
R501	X	8-6	X		PARAPET VERT.
R502	X	3-4	X		PARAPET VERT.
R503	X				PARAPET HORIZ. BOT.
R704	X				PARAPET HORIZ. TOP
R505	X	4-4	X		PARAPET VERT. @ WINGS
R506	X				PARAPET HORIZ. BOT. @ WINGS
R707	X				PARAPET HORIZ. TOP @ WING
R508	X	4-9	X		PARAPET HORIZ. @ LIGHT STD.
R509	X	9-6	X		PARAPET VERT. @ LIGHT STD.
R510	X	4-9	X		PARAPET VERT. @ LIGHT STD.
R511	X	7-7	X		PARAPET VERT. @ LIGHT STD.
R512	X	4-3	X		PARAPET VERT. @ LIGHT STD.

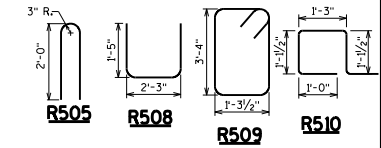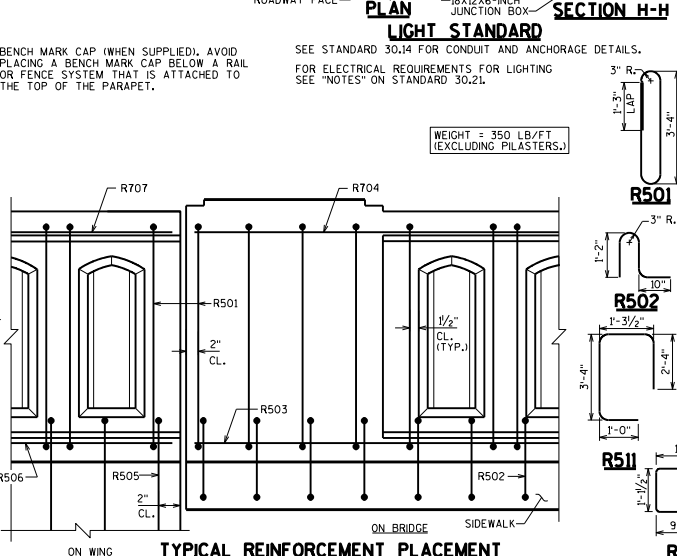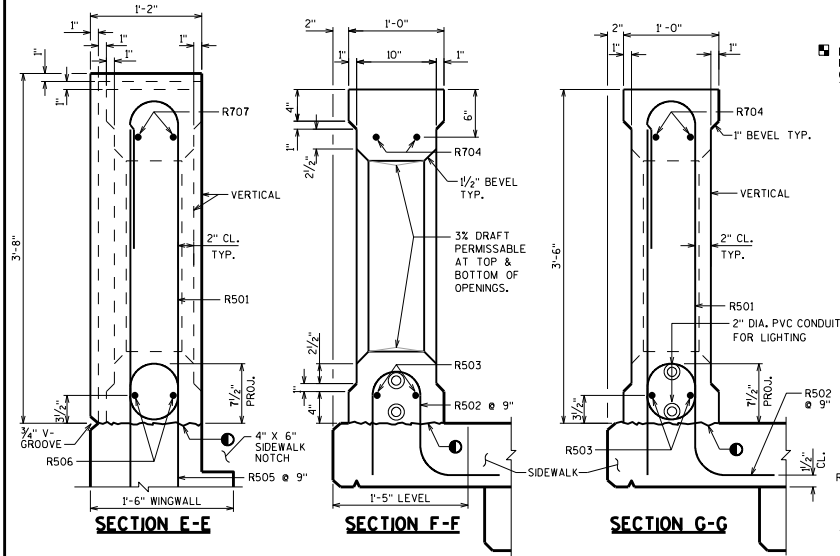


VERTICAL FACE PARAPET 'TX'

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva DATE: 7-16

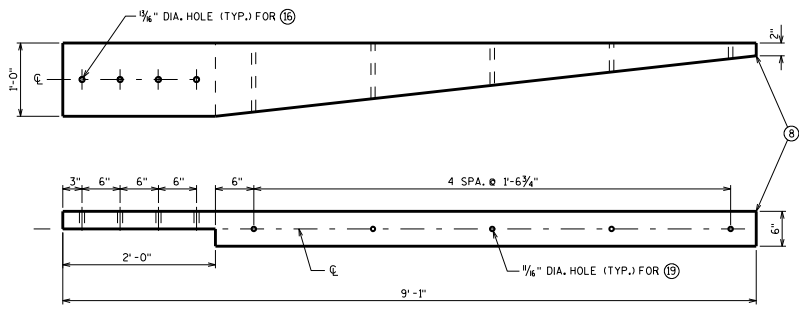


CURB TRANSITION

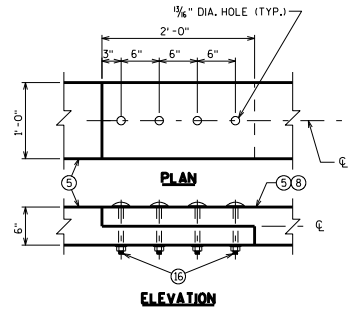


CURB SPLICE DETAIL

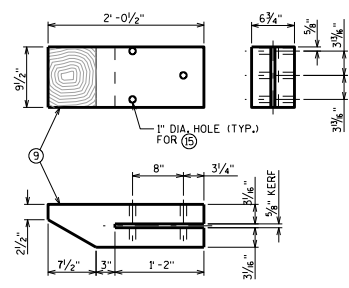

TRANSITION BLOCK

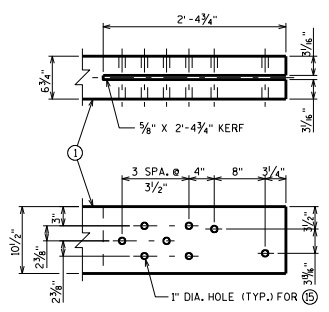

TRANSITION GLULAM RAIL BORING DETAIL

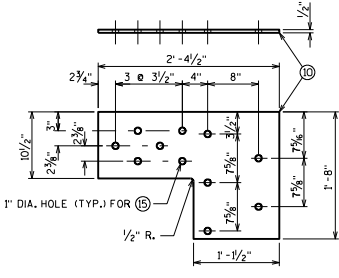


STEEL TRANSITION PLATE

LEGEND


- ① GLULAM RAIL 6 3/4" X 10 1/2"
- ② RAIL SPACER BLOCK 8" X 4 3/4" X 10 1/2"
- ③ SCUPPER BLOCK 6" X 12" X 3'-0"
- ④ RAIL POST @ STRUCTURE 8" X 8" X 3'-8"
- ⑤ CURB 6" X 12"
- ⑥ RAIL POST @ BEAM GUARD 8" X 8"
- ⑦ RAIL SPACER BLOCK @ BEAM GUARD 8" X 10 1/2" X 1'-10 1/2"
- ⑧ CURB TRANSITION @ BEAM GUARD
- ⑨ TRANSITION BLOCK @ BEAM GUARD
- ⑩ STEEL TRANSITION PLATE, ASTM A36.
- ⑪ STEEL SPLICE PLATE, ASTM A36.
- ⑫ 3/4" DIA. X 1'-10" LONG ASTM A307, GRADE 2, DOME-HEAD BOLT W/ 1-PLATE WASHER PER BOLT. (2 REOD. @ EACH RAIL TO POST CONNECTION, 4 REOD. @ EACH RAIL SPLICE).
- ⑬ 1/4" DIA. X 1'-10" LONG ASTM A325, DOME-HEAD BOLT W/ 2 - 5/2" X 5/2" X 1/4" PLATE WASHERS, W/ 1/8" DIA. HOLE. (1 REOD. @ EACH CURB TO POST CONNECTION.)
- ⑭ 3/4" DIA. X 1'-11" LONG ASTM A325 BOLT. 1 - 4" X 4" X 3/8" PLATE WASHER REOD. AT CURB TO SLAB CONNECTION. 1 - 4" X 4" X 3/8" PLATE WASHER REOD. AT POST TO SLAB CONNECTION.
- ⑮ 3/4" DIA. X 9" LONG ASTM A307, GRADE 2, DOME HEAD BOLT AT RAIL SPLICE DETAIL AND AT BEAM GUARD ATTACHMENT.
- ⑯ 3/4" DIA. X 8" LONG ASTM A307, GRADE 2, DOME-HEAD BOLT (4 REOD. @ EACH CURB SPLICE DETAIL.)
- ⑰ 4" DIA. SHEAR PLATE (8 REOD. @ EACH CURB TO SCUPPER CONNECTION, 4 REOD. @ EACH SCUPPER TO SLAB CONNECTION AND 1 REOD. @ EACH POST TO SLAB CONNECTION). MALLEABLE IRON MEETING REQUIREMENTS OF ASTM A47, GRADE 32510.
- ⑱ 2" X 2'-6" X 5/8" ANCHOR PLATE WITH 4 - 1/2" DIA. HOLES FOR ANCHOR BOLTS NO. 14 (CURB TO SLAB CONNECTION).
- ⑲ 3/4" DIA. ASTM A325 DOME-HEAD BOLT W/ 1-PLATE WASHER PER BOLT. (1 REOD. @ EACH THREE BEAM POST TO CURB TRANSITION CONNECTION.)

NOTES


1. BID ITEM SHALL BE "TREATED LUMBER AND TIMBER" WHICH INCLUDES ALL ITEMS SHOWN EXCEPT ITEMS NO. 6, 7 AND THREE BEAM TERMINAL CONNECTOR..
2. DIMENSIONS GIVEN FOR GLUED-LAMINATED (GLULAM) TIMBER RAILS ARE ACTUAL DIMENSIONS.
3. DIMENSIONS FOR WOOD POSTS, CURBS AND SCUPPERS ARE GIVEN AS NOMINAL DIMENSIONS. ACTUAL DIMENSIONS MAY BE A MAXIMUM OF 1/2" INCH LESS THAN THE STATED NOMINAL DIMENSIONS. DIMENSION FOR SPACER BLOCK DEPTH ARE ACTUAL DIMENSIONS.
4. CURB AND RAIL SPLICES SHALL BE LOCATED SO THAT CURB AND RAIL MEMBERS ARE CONTINUOUS OVER NOT LESS THAN TWO POSTS. CURB SPLICES SHALL BE LOCATED A MINIMUM OF 15 POST SPACINGS AWAY FROM RAIL SPLICES. IT IS RECOMMENDED THAT GLULAM RAILS BE CONTINUOUS OVER THE LENGTH OF THE BRIDGE.
5. SAWN LUMBER AND GLULAM SHALL COMPLY WITH THE REQUIREMENTS OF AASHTO M168 AND SHALL BE PRESSURE TREATED WITH WOOD PRESERVATIVES IN ACCORDANCE WITH AASHTO M133 AND STANDARD SPECIFICATIONS.
6. BRIDGE RAIL SHALL BE HORIZONTALLY LAMINATED GLULAM, VISUALLY GRADED WESTERN SPECIES COMBINATION NO. 2, OR VISUALLY GRADED SOUTHERN PINE COMBINATION NO. 48. OTHER SPECIES AND GRADES OF GLULAM MAY BE USED, PROVIDED THE MINIMUM TABULATED VALUES ARE NOT LESS THAN THE FOLLOWING:
 $F_{b,y} = 1,800 \text{ LB/IN}^2$ $E = 1,800,000 \text{ LB/IN}^2$
7. POSTS, CURBS, SCUPPERS, TRANSITION BLOCKS AND SPACER BLOCKS MAY BE SAWN LUMBER OR GLULAM. WHEN SAWN LUMBER IS USED, MATERIAL SHALL BE VISUALLY GRADED NO. 1 SOUTHERN PINE OR VISUALLY GRADED NO. 1 DOUGLAS FIR-LARCH, GLULAM AND OTHER SPECIES AND GRADES OF SAWN LUMBER MAY BE USED, PROVIDED THE MINIMUM TABULATED VALUES ARE NO LESS THAN THE FOLLOWING:
 $F_b = 1,350 \text{ LB/IN}^2$ $E = 1,500,000 \text{ LB/IN}^2$
8. ALL STEEL COMPONENTS AND FASTENERS SHALL BE GALVANIZED IN ACCORDANCE WITH AASHTO M113 OR M232.
9. TO THE EXTENT POSSIBLE, ALL WOOD SHALL BE CUT, DRILLED, AND COMPLETELY FABRICATED PRIOR TO PRESSURE TREATMENT WITH PRESERVATIVES. WHEN FIELD FABRICATION OF WOOD IS REQUIRED OR IF WOOD IS DAMAGED, ALL CUTS, BORE HOLES, AND DAMAGE SHALL BE IMMEDIATELY TREATED WITH WOOD PRESERVATIVE IN ACCORDANCE WITH AASHTO M133 AND STANDARD SPECIFICATIONS.
10. UNLESS NOTED, MALLEABLE IRON WASHERS SHALL BE PROVIDED UNDER BOLT HEADS AND UNDER NUTS THAT ARE IN CONTACT WITH WOOD. WHEN THE SIZE AND STRENGTH OF THE HEAD ARE SUFFICIENT TO DEVELOP CONNECTION STRENGTH WITHOUT WOOD CRUSHING, WASHERS MAY BE OMITTED UNDER HEADS OF DOME-HEAD TIMBER BOLTS.
11. TOPS OF RAIL POSTS AND TOP OF THE RAIL SPLICE PLATE KERF SHALL BE SEALED WITH ROOFING CEMENT OR OTHERWISE PROTECTED FROM DIRECT EXPOSURE TO WEATHER.
12. DESTROY THREADS ON ALL BOLTS WITH A CENTER PUNCH AFTER TIGHTENING NUT. EXPOSED BOLT PROJECTION OVER 1" SHALL BE CUT OFF. REPAIR END OF BOLT BY PAINTING WITH ZINC RICH PRIMER.
13. WHEN PLACING OVERLAY (FWS) ON TOP OF EXISTING SLAB, THE THICKNESS OF THE OVERLAY MUST BE TAPERED NEAR THE VICINITY OF THE RAILING TO MAINTAIN THE REOD. (CRASH TESTED) DISTANCE FROM TOP OF SLAB TO TOP OF RAIL TO 32 INCHES.
14. THIS RAILING MEETS NCHRP REPORT 350 EVALUATION CRITERIA FOR TEST LEVEL 2 (TL-2).



ELEVATION

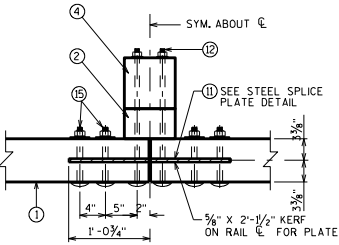

PLAN VIEW



STEEL SPLICE PLATE

RAIL SPLICE DETAILS

BILL OF TREATED LUMBER

ITEM	NO. REOD.	SIZE	LENGTH	MBM
GLULAM RAIL		6 3/4" X 10 1/2"		
RAIL SPACER BLOCK		8" X 4 3/4" X 10 1/2"		
SCUPPER BLOCK		6" X 12" X 3'-0"		
RAIL POST		8" X 8"		
CURB		6" X 12"		
CURB TRANSITION				
TRANSITION BLOCK				
TOTAL MBM				









THESE RAILING DETAILS MAY BE USED WITH CONCRETE SLAB SUPERSTRUCTURE (SLAB DEPTH > 14") THAT HAVE ABUTMENTS WITH WINGS PARALLEL TO C.E. OF ABUTMENT OR HAVE AS ABUTMENTS.

TIMBER RAILING ATTACHED TO CONCRETE SLAB DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

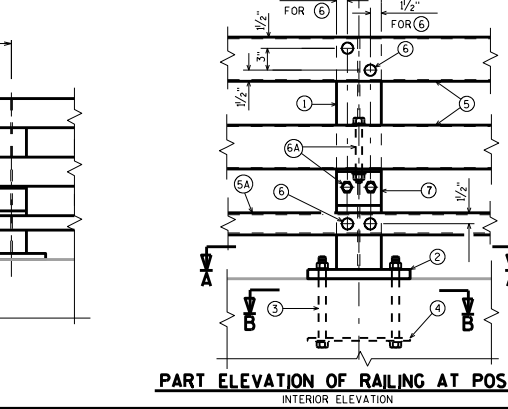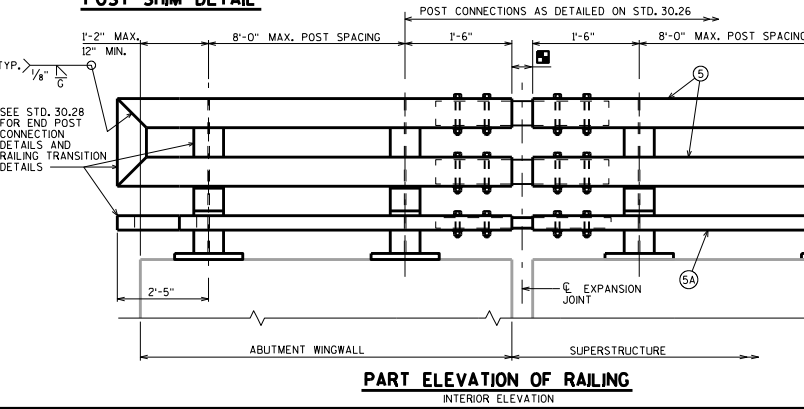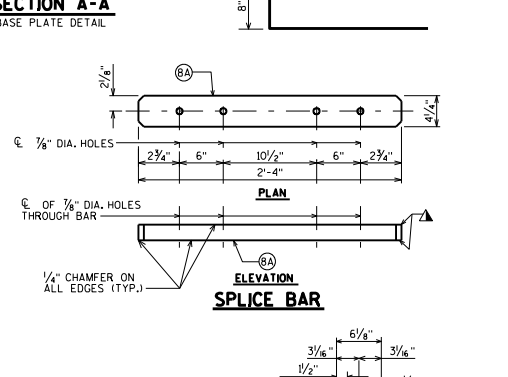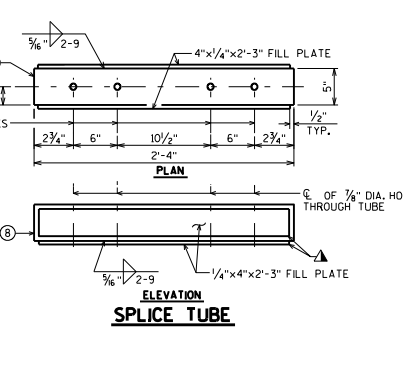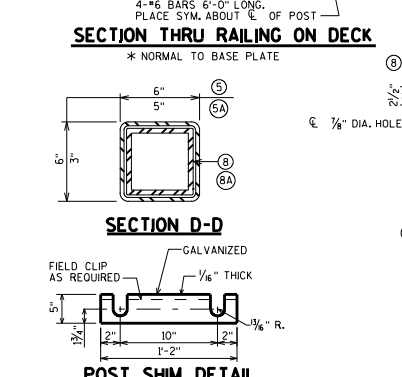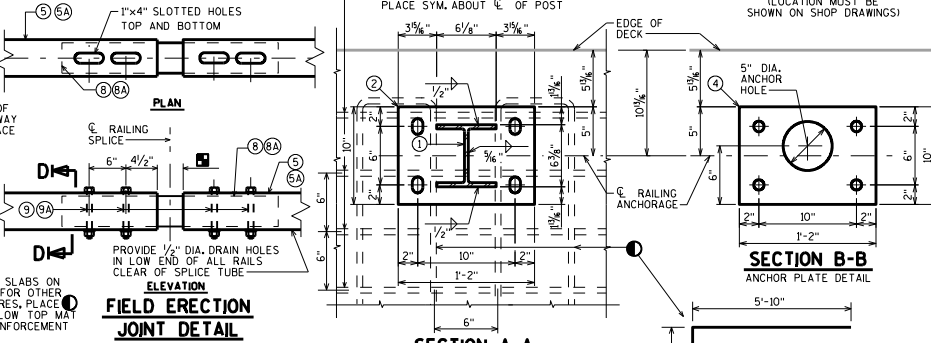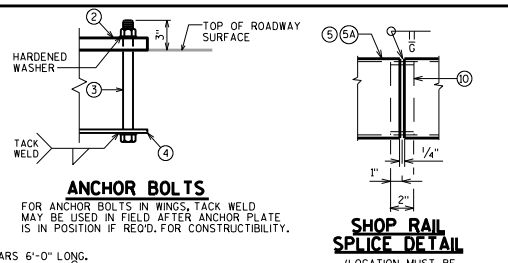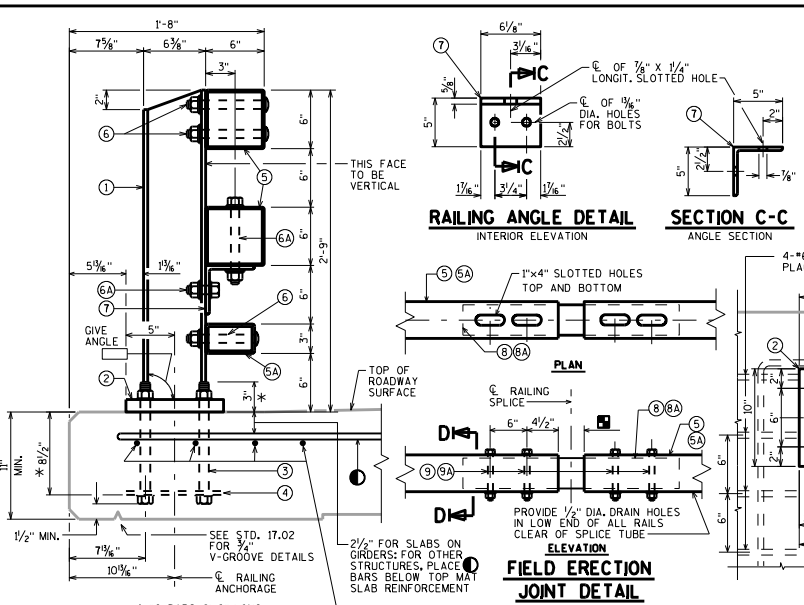












LEGEND

- ① W6 x 25 with 1/4" x 1 1/2" HORIZONTAL SLOTTED HOLES ON EACH SIDE OF POST FOR BOLT NO. 6 AT NO. 5. USE 1" DIA. HOLES FOR BOLT NO. 6 AT NO. 5A AND FOR BOLT NO. 6A AT NO. 7. CUT BOTTOM OF POST TO MATCH CROSS SLOPE OF ROADWAY. PLACE POST VERTICAL. PLACE POSTS NORMAL TO GRADE LINE.
 - ② PLATE 1/2" x 10" x 1'-2" WITH 1/8" x 1 1/2" SLOTTED HOLES FOR ANCHOR BOLTS NO. 3 AS SHOWN. SLOTS PARALLEL TO SHORT SIDE OF PLATE.
 - ③ ASTM A449 - 1" DIA. ANCHOR BOLTS WITH HEAVY HEX NUT AND 2" O.D. HARDENED WASHER (ALL GALVANIZED). 4 REQUIRED PER POST TO THREAD 3" AND PLACE NORMAL TO PLATE NO. 2. CHAMFER TOP OF BOLTS BEFORE THREADING. USE 1/2" LONG BOLT FOR CONCRETE DECKS. ON CONCRETE SLAB SUPERSTRUCTURES, USE 1'-3" LONG BOLT FOR SLAB THICKNESS > 16" AND 1 1/2" LONG FOR THICKNESS ≤ 16". USE 1'-9" LONG IN ABUTMENT WINGS. (AN EQUIVALENT THREADED ROD WITH HEAVY HEX NUTS AND HARDENED WASHERS MAY BE SUBSTITUTED FOR ANCHOR BOLTS IN WINGS IF REQUIRED FOR CONSTRUCTIBILITY.)
 - ④ 3/8" x 10" x 1'-2" ANCHOR PLATE (GALVANIZED WITH 1/16" DIA. HOLES FOR ANCHOR BOLTS NO. 3).
 - ⑤ TS 6 x 6 x 3/8" STRUCTURAL TUBING. USE 1" DIA. HOLES FOR BOLT NO. 6 (FRONT & BACK) & 3/8" DIA. HOLES FOR BOLT NO. 6A (TOP & BOTTOM).
 - ⑥A TS 5 x 3 x 1/4" STRUCTURAL TUBING. USE 1 1/4" x 1 1/2" HORIZONTAL SLOTTED HOLES FOR BOLT NO. 6 (FRONT & BACK) AND A 2" O.D. WASHER UNDER BOLT HEAD.
 - ⑥ 7/8" DIA. A325 SLOTTED ROD HEAD BOLT WITH HEX NUT, 3/8" x 1 1/4" x 1 1/4" WASHER, AND SPRING LOCK WASHER (2 REQUIRED AT RAIL TO POST LOCATIONS SHOWN).
 - ⑥A 7/8" DIA. A325 BOLT WITH HEX NUT & SPRING LOCK WASHER (1 REQUIRED AT RAIL TO ANGLE & 2 REQUIRED AT ANGLE TO POST LOCATIONS SHOWN WITH 3/8" x 1 1/4" x 1 1/4" WASHER).
 - ⑦ L 5 x 5 x 5/8" STRUCTURAL ANGLE. ATTACH TO NO. 1 AND NO. 5 AS SHOWN.
 - ⑧ TS 5 x 5 x 3/8" x 2'-4" LONG SPLICE TUBE. 1 PER RAIL. USED IN NO. 5.
 - ⑧A 4/4" x 2/8" x 2'-4" LONG SPLICE BAR. 1 PER RAIL. USED IN NO. 5A.
 - ③A 3/4" DIA. A325 FULLY THREADED BOLTS, 7/2" LONG, WITH 2 WASHERS AND HEAVY HEX NUT ON EACH BOLT. NUT TO BE FINGER TIGHT. (4 REQUIRED PER SPLICE). USE 1" x 4" SLOTTED HOLES IN TOP AND BOTTOM OF NO. 5.
 - ③A 3/4" DIA. A325 FULLY THREADED BOLTS, 4/4" LONG, WITH 2 WASHERS AND HEAVY HEX NUT ON EACH BOLT. NUT TO BE FINGER TIGHT. (4 REQUIRED PER SPLICE). USE 1" x 4" SLOTTED HOLES IN TOP AND BOTTOM OF NO. 5A.
 - ⑩ SPLICE SLEEVE FABRICATED FROM 1/4" PLATE. PROVIDE "SLIDING FIT".
- ▣ ROADWAY OPENING OR 2 1/2" MIN. FOR STRIP SEAL EXP. JOINT & 1/2" OPENING FOR A1 ABUTMENT. 1/2" AT FIXED JOINTS. SPLICES ARE REQUIRED IN ANY RAILING SPAN BETWEEN POSTS THAT CONTAINS A SUPERSTRUCTURE EXPANSION JOINT.
- ▲ PROTRUSIONS CAUSED BY WELDING OR GALVANIZING ARE NOT PERMITTED ON THE ADJOINING SURFACES OF THE RAILS, SPLICE TUBES AND TOP PLATES.
- ① #6 BARS X 12'-0" LONG. BEND AS SHOWN. TIE TO MAT OF STEEL. (DESIGNER TO PLACE THESE BARS IN BILL OF BARS FOR SUPERSTRUCTURE.)

NOTES

- BID ITEM SHALL BE "RAILING STEEL TYPE NY3 B-...", WHICH INCLUDES ALL ITEMS SHOWN.
- RAILING SHALL BE CONTINUOUS OVER A MINIMUM OF THREE (3) POSTS WITHOUT SPLICES WHERE POSSIBLE.
- POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT, AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.
- ALL MATERIAL SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING, ALL STEEL RAILING POSTS, ANGLES, SPLICE TUBES, SPLICE BARS AND STEEL TUBING SHALL BE GIVEN A NO. 6 BLAST CLEANING PER SSPC SPECIFICATIONS.
- WHEN PAINTING IS REQUIRED, ALL MATERIAL EXCEPT ANCHORAGE DETAIL (NO. 3 & NO. 4) SHALL BE PAINTED OVER GALVANIZING WITH AN APPROVED TIE COAT AND TOP COAT AS SPECIFIED IN THE CONTRACT DOCUMENTS. THE RAILING SHALL BE PAINTED FEDERAL COLOR NO. [] (FILL IN COLOR NAME).
- RAIL POST, BASE PLATES, SPLICE BAR, ANGLES AND SPLICE PLATES SHALL CONFORM TO THE REQUIREMENTS OF ASTM A709 GRADE 50. STRUCTURAL TUBING SHALL CONFORM TO THE REQUIREMENTS OF ASTM A500 GRADE B OR C WITH A CERTIFIED T_y ≥ 50 KSI. ANCHOR PLATES & SHIMS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A709 GRADE 50.
- THE NUT SECURING THE POST BASE PLATE TO THE CONCRETE SHALL BE TIGHTENED TO A SNUG FIT AND GIVEN AN ADDITIONAL 1/8" TURN.
- FILL BOLT SLOT OPENINGS IN POST SHIMS AND PLATE NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER. CAULK AROUND PERIMETER OF NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.
- STEEL SHIMS SHALL BE PROVIDED & USED UNDER PLATE NO. 2 WHERE REQUIRED FOR ALIGNMENT, AND SHALL BE GALVANIZED.
- THIS RAILING MEETS NCHRP REPORT 350 EVALUATION CRITERIA FOR TEST LEVEL 4 (TL-4).
- SEE BRIDGE MANUAL 30.2 FOR ALLOWED USE.
- RAILING WEIGHT = 60 LB/LF (BASED ON 8'-0" POST SPACING)

TUBULAR STEEL RAILING TYPE NY3	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

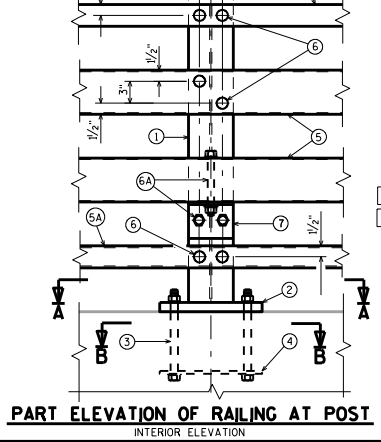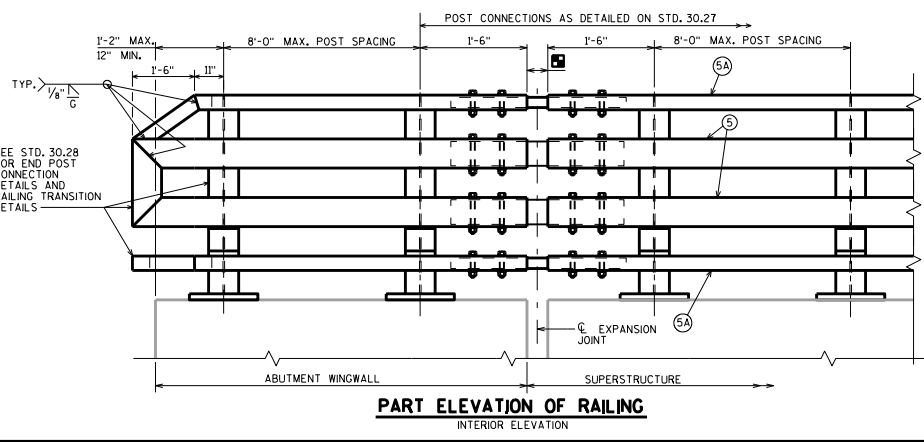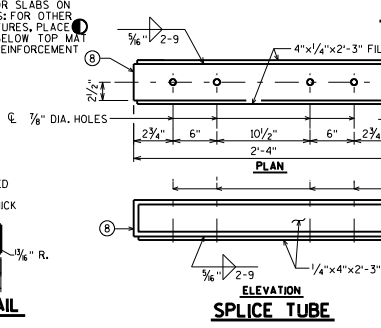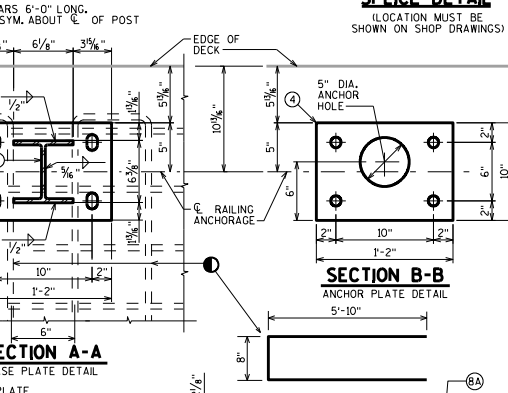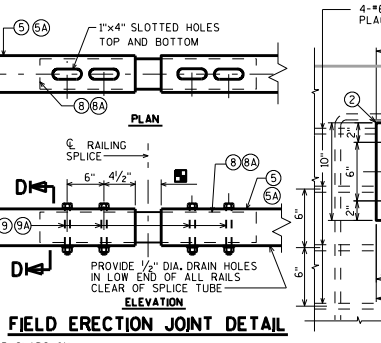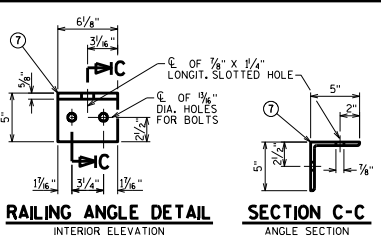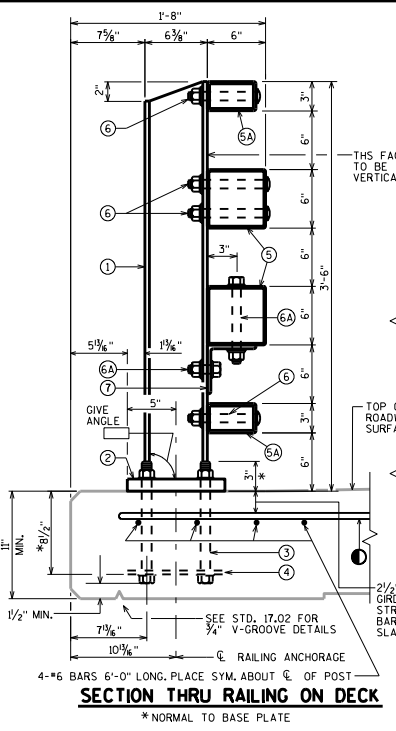


LEGEND

- ① W6 X 25 WITH 1/8" X 1 1/2" HORIZONTAL SLOTTED HOLES ON EACH SIDE OF POST FOR BOLT NO. 6 AT TOP TWO RAILS, USE 1" DIA. HOLES FOR BOLT NO. 6 AT BOTTOM NO. 5A & FOR BOLT NO. 6A AT NO. 7. CUT BOTTOM OF POST TO MATCH CROSS SLOPE OF ROADWAY, PLACE POST VERTICAL, PLACE POSTS NORMAL TO GRADE LINE.
- ② PLATE 1/2" X 10" X 1'-2" WITH 1/8" X 1 1/2" SLOTTED HOLES FOR ANCHOR BOLTS NO. 3, WELD TO NO. 1 AS SHOWN, SLOTS PARALLEL TO SHORT SIDE OF PLATE.
- ③ ASTM A449 - 1" DIA. ANCHOR BOLTS WITH HEAVY HEX NUT AND 2" O.D. HARDENED WASHER (ALL GALVANIZED), 4 REQUIRED PER POST, THREAD 3" AND PLACE NORMAL TO PLATE NO. 2, CHAMFER TOP OF BOLTS BEFORE THREADING, USE 1 1/2" LONG BOLT FOR CONCRETE DECKS, ON CONCRETE SLAB SUPERSTRUCTURES, USE 1'-3" LONG BOLT FOR SLAB THICKNESS > 16" AND 1 1/2" LONG FOR THICKNESS ≤ 16", USE 1'-9" LONG IN ABUTMENT WINGS, (AN EQUIVALENT THREADED ROD WITH HEAVY HEX NUTS AND HARDENED WASHERS MAY BE SUBSTITUTED FOR ANCHOR BOLTS IN WINGS IF REQUIRED FOR CONSTRUCTIBILITY.)
- ④ 3/8" X 10" X 1'-2" ANCHOR PLATE (GALVANIZED) WITH 1/16" DIA. HOLES FOR ANCHOR BOLTS NO. 3.
- ⑤ TS 6 X 6 X 3/16" STRUCTURAL TUBING, USE 1" DIA. HOLES FOR BOLT NO. 6 (FRONT & BACK) & 7/8" DIA. HOLES FOR BOLT NO. 6A (TOP & BOTTOM).
- ⑥ TS 5 X 3 X 1/4" STRUCTURAL TUBING, USE 1" DIA. HOLES FOR BOLT NO. 6 IN TOP RAIL (FRONT & BACK), USE 1/2" X 1 3/4" HORIZONTAL SLOTTED HOLES FOR BOLT NO. 6 IN BOTTOM RAIL (FRONT & BACK) AND A 2" O.D. WASHER UNDER BOLT HEAD.
- ⑦ 7/8" DIA. A325 SLOTTED ROUND HEAD BOLT WITH HEX NUT, 3/8" X 1 3/4" X 1 3/4" WASHER, AND SPRING LOCK WASHER (2 REQUIRED AT RAIL TO POST LOCATIONS SHOWN).
- ⑧ 7/8" DIA. A325 BOLT WITH HEX NUT AND SPRING LOCK WASHER (1 REQUIRED AT RAIL TO ANGLE AND 2 REQUIRED AT ANGLE TO POST LOCATIONS SHOWN WITH 3/8" X 1 3/4" X 1 3/4" WASHER).
- ⑨ L 5 X 5 X 3/8" STRUCTURAL ANGLE, ATTACH TO NO. 1 AND NO. 5 AS SHOWN.
- ⑩ TS 5 X 5 X 3/8" X 2'-4" LONG SPLICE TUBE, 1 PER RAIL, USED IN NO. 5.
- ⑪ 4/4" X 2/8" X 2'-4" LONG SPLICE BAR, 1 PER RAIL, USED IN NO. 5A.
- ⑫ 3/4" DIA. A325 FULLY THREADED BOLTS, 7/2" LONG, WITH 2 WASHERS AND HEAVY HEX NUT ON EACH BOLT, NUT TO BE FINGER TIGHT, (4 REQUIRED PER SPLICE), USE 1" X 4" SLOTTED HOLES IN TOP AND BOTTOM OF NO. 5.
- ⑬ 3/4" DIA. A325 FULLY THREADED BOLTS, 4/2" LONG, WITH 2 WASHERS AND HEAVY HEX NUT ON EACH BOLT, NUT TO BE FINGER TIGHT, (4 REQUIRED PER SPLICE), USE 1" X 4" SLOTTED HOLES IN TOP AND BOTTOM OF NO. 5A.
- ⑭ SPLICE SLEEVE FABRICATED FROM 1/4" PLATE, PROVIDE "SLD. FIT".
- Ⓜ ROADWAY OPENING OR 2 1/2" MIN. FOR STRIP SEAL EXP. JOINT & 1/2" OPENING FOR AT ABUTMENT, 1/2" AT FIXED JOINTS, SPLICES ARE REQUIRED IN ANY RAILING SPAN BETWEEN POSTS THAT CONTAINS A SUPERSTRUCTURE EXPANSION JOINT.
- Ⓜ PROTRUSIONS CAUSED BY WELDING OR GALVANIZING ARE NOT PERMITTED ON THE ADJOINING SURFACES OF THE RAILS, SPLICE TUBES AND FILL PLATES.
- Ⓜ 6 BARS X 12'-0" LONG, BEND AS SHOWN, TIE TO TOP MAT OF STEEL (DESIGNER TO PLACE THESE BARS IN BILL OF BARS FOR SUPERSTRUCTURE.)


NOTES

- BID ITEM SHALL BE "RAILING STEEL TYPE NY4 B--", WHICH INCLUDES ALL ITEMS SHOWN.
- RAILING SHALL BE CONTINUOUS OVER A MINIMUM OF THREE (3) POSTS WITHOUT SPLICES WHERE POSSIBLE.
- POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT, AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.
- ALL MATERIAL SHALL BE GALVANIZED AFTER FABRICATION, PRIOR TO GALVANIZING, ALL STEEL RAILING POSTS, ANGLES, SPLICE TUBES, SPLICE BARS AND STEEL TUBING SHALL BE GIVEN A NO. 6 BLAST CLEANING PER SSPC SPECIFICATIONS.
- WHEN PAINTING IS REQUIRED, ALL MATERIAL EXCEPT ANCHORAGE DETAIL (NO. 3 & NO. 4) SHALL BE PAINTED OVER GALVANIZING WITH AN APPROVED THE COAT AND TOP COAT AS SPECIFIED IN THE CONTRACT DOCUMENTS. THE RAILING SHALL BE PAINTED FEDERAL COLOR NO. [] (FILL IN COLOR NAME).
- RAIL POST, BASE PLATES, SPLICE BAR, ANGLES AND SPLICE PLATES SHALL CONFORM TO THE REQUIREMENTS OF ASTM A709 GRADE 50. STRUCTURAL TUBING SHALL CONFORM TO THE REQUIREMENTS OF ASTM A500 GRADE B OR C WITH A CERTIFIED 150 KSI ANCHOR PLATES & SHIMS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A709 GRADE 36.
- THE NUT SECURING THE POST BASE PLATE TO THE CONCRETE SHALL BE TIGHTENED TO A SNUG FIT AND GIVEN AN ADDITIONAL 1/8 TURN.
- FILL BOLT SLOT OPENINGS IN POST SHIMS AND PLATE NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER, CAULK AROUND PERIMETER OF NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.
- STEEL SHIMS SHALL BE PROVIDED & USED UNDER PLATE NO. 2 WHERE REQUIRED FOR ALIGNMENT, AND SHALL BE GALVANIZED.
- THIS RAILING MEETS NCHRP REPORT 350 EVALUATION CRITERIA FOR TEST LEVEL 4 (TL-4).
- SEE BRIDGE MANUAL 30.2 FOR ALLOWED USE.
- RAILING WEIGHT = 75 LB/LF (BASED ON 8'-0" POST SPACING)

TUBULAR STEEL RAILING TYPE NY4	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

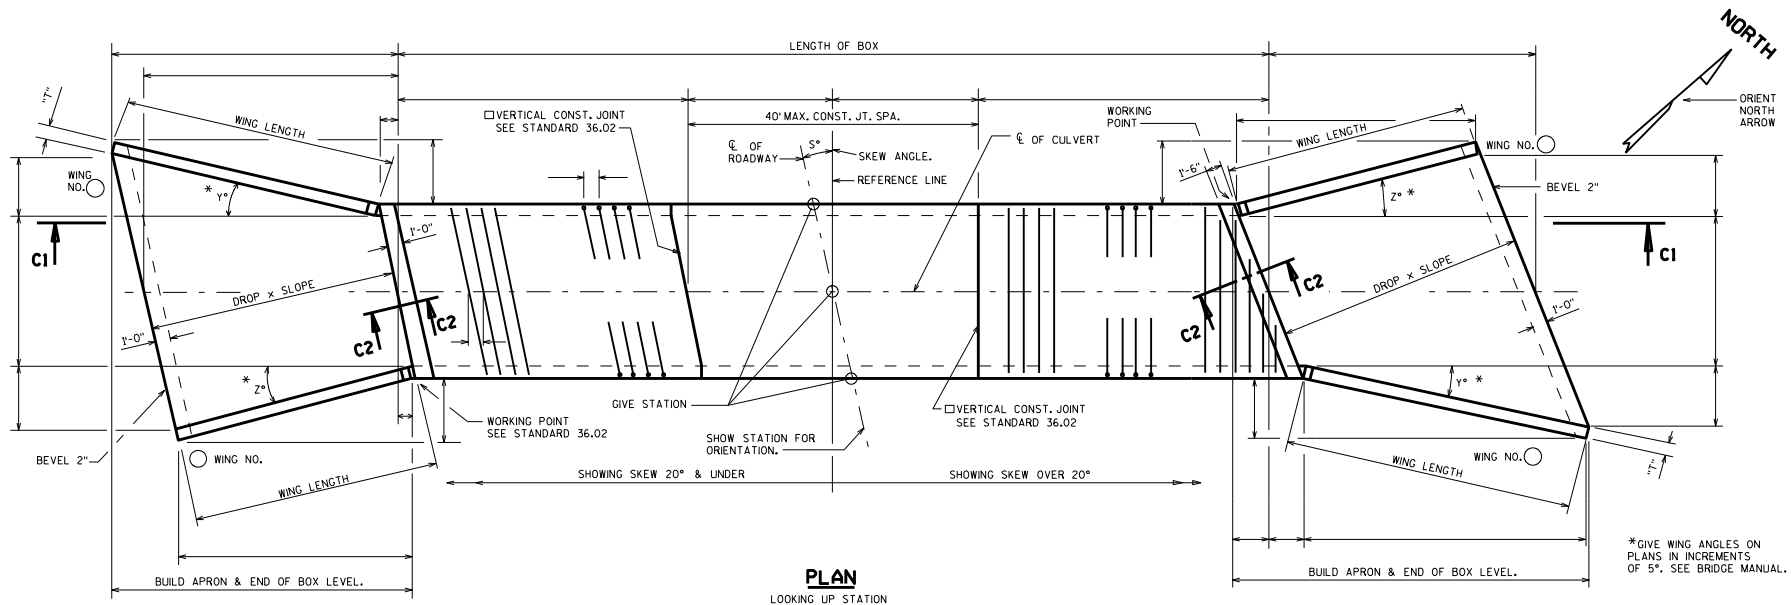

*GIVE WING ANGLES ON PLANS IN INCREMENTS OF 5°. SEE BRIDGE MANUAL.

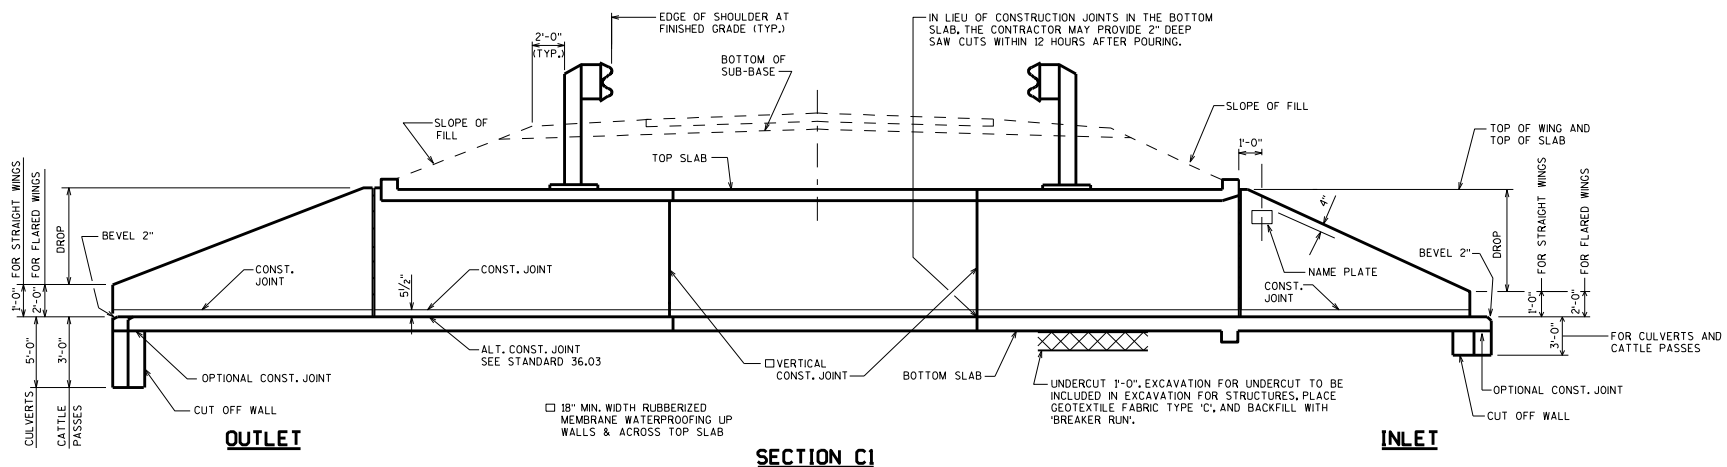

DESIGN DATA

LIVE LOAD:
 DESIGN LOADING: HL-93
 INVENTORY RATING FACTOR: RF=L05
 OPERATING RATING FACTOR: RF=L35
 WISCONSIN STANDARD PERMIT VEHICLE (WIS.-SPV): 255 (KIPS)


** **EARTH LOAD:** DESIGNED FOR FILL HEIGHT RANGE OF ___ TO ___ FEET

MATERIAL PROPERTIES:
 CONCRETE MASONRY ————— $f'_c = 3.5$ K.S.I.
 BAR STEEL REINFORCEMENT ————— $f_y = 60.0$ K.S.I.


DESIGNER NOTES

TYPICAL UNDERCUT SHOWN. SEE STANDARD 9.01 FOR ALTERNATIVES AND ADDITIONAL NOTES.
 FOR SECTION C2 SEE STANDARD 36.03
 ** SEE SECTION 36.5 FOR DESIGN RANGE OF FILL HEIGHTS.
 HEIGHT TO BE TO THE NEAREST 0.5 FEET ON FILLS UNDER 4 FEET AND TO THE NEAREST FOOT ON FILLS OVER 4 FEET.

BOX CULVERT LAYOUT	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

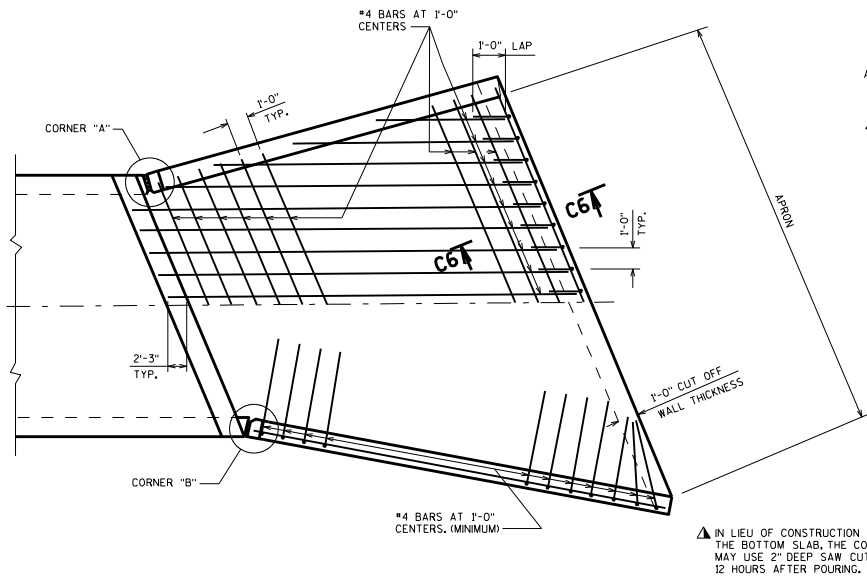

APRON DETAIL

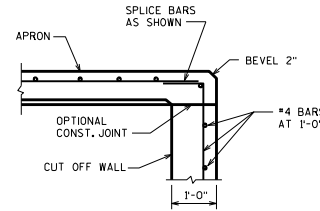

SECTION C6


"H" (FT.)	"L" (FT.)
≤ 5'-0"	3'-8"
> 5'-0" - 7'-0"	5'-2"
> 7'-0" - 8'-0"	6'-1"
> 8'-0" - 9'-0"	6'-9"
> 9'-0" - 10'-0"	7'-4"
> 10'-0" - 11'-0"	7'-8"
> 11'-0" - 12'-0"	8'-0"
> 12'-0" - 13'-0"	8'-4"
> 13'-0" - 14'-0"	8'-6"

"H" IS MAX. WING WALL HEIGHT

THE AREA OF REINFORCING STEEL NOT IDENTIFIED IN SECTIONS SHALL CONFORM TO THE FOLLOWING TEMPERATURE AND SHRINKAGE REQUIREMENTS:


THICKNESS	T&S REINF.
≤ 12"	#4 @ 18"
> 12" - 18"	#4 @ 12"

▲ IN LIEU OF CONSTRUCTION JOINTS IN THE BOTTOM SLAB, THE CONTRACTOR MAY USE 2" DEEP SAW CUTS WITHIN 12 HOURS AFTER POURING.

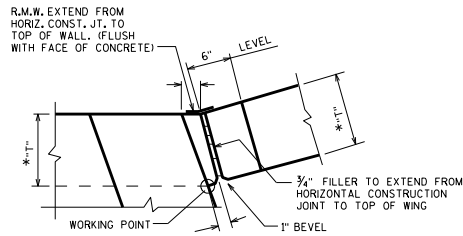


CORNER "A"


* DIMENSION "T" TO BE DETERMINED FROM BARREL DESIGN

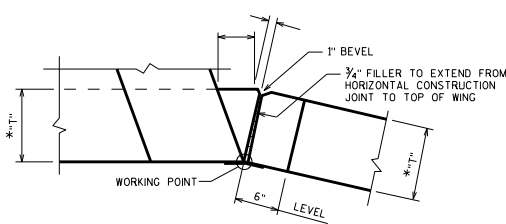


CORNER "B"

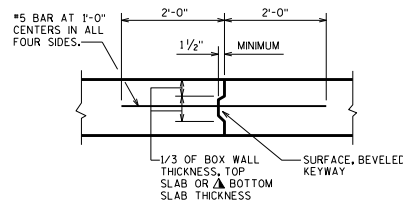

VERTICAL CONSTRUCTION JOINT

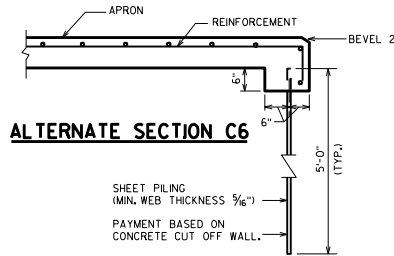

ALTERNATE CUTOFF WALL

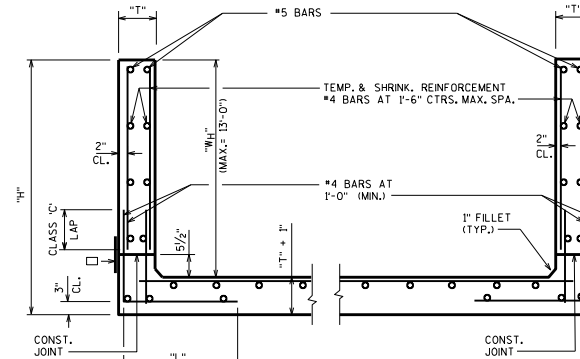

SECTION THRU WINGWALLS

BOX CULVERT APRON DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*

DATE:
7-16

NOTES

BAR STEEL REINFORCEMENT SHALL BE EMBEDDED 2" CLEAR UNLESS OTHERWISE SHOWN OR NOTED.

THE CONCRETE IN THE CUT OFF WALL MAY BE PLACED UNDERWATER IF THE EXCAVATION CANNOT BE DEWATERED.

THE ALTERNATE CUT OFF WALL MAY BE USED IN LIEU OF THE CAST-IN-PLACE CONCRETE CUT OFF WALLS, PAYMENT SHALL BE BASED ON CONCRETE CUT OFF WALLS.

LOCATE NAME PLATE ON NEAREST RIGHT WING TRAVELING UP STATION, FACE NAME PLATE UP STATION.

THE CONTRACTOR MAY FURNISH A PRECAST CONCRETE BOX CULVERT IN LIEU OF THE CAST-IN-PLACE BOX CULVERT WITH THE ACCEPTANCE OF THE SHOP DRAWINGS BY THE STRUCTURES DESIGN SECTION. THE PRECAST CONCRETE BOX CULVERT SHALL CONFORM TO PRECAST DETAILS IN CHAPTER 36 STANDARDS OF THE CURRENT WISCONSIN DOT BRIDGE MANUAL. PAYMENT FOR THE PRECAST CULVERT SHALL BE BASED ON THE QUANTITIES AND PRICES BID FOR THE ITEMS LISTED IN THE "TOTAL ESTIMATED QUANTITIES".


DESIGNER NOTES

SEE STANDARD 9.01 FOR ADDITIONAL NOTES.


ALL BAR STEEL FOR CAST-IN-PLACE CONCRETE BOX CULVERTS SHALL BE UNCOATED, EXCEPT WHEN THERE IS NO FILL OVER THE CULVERT. EPOXY COATED BARS SHALL BE USED FOR THE TOP AND BOTTOM BARS IN THE TOP SLAB.

BAR STEEL FOR CAST-IN-PLACE CONCRETE APRONS SHALL BE UNCOATED AND BAR STEEL FOR WINGWALL DOWELS AND ALL WINGWALL BARS SHALL BE EPOXY COATED.

FOR "B" DESIGNATED CONCRETE BOX CULVERTS HAVING THEIR TOP SURFACE AT GRADE, HAND HELD FINISHING MACHINES MAY BE USED. NOTE THIS ON PLANS WHEN APPLICABLE.

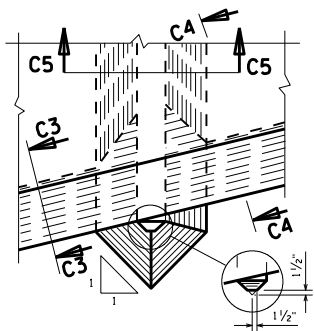


PLAN

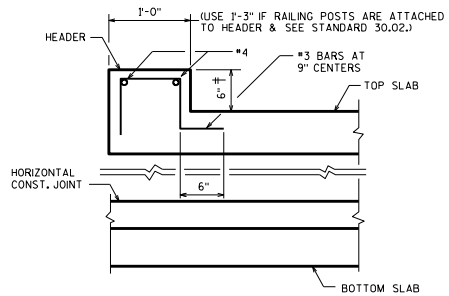


SECTION C2 FOR SKEW OF 20° AND UNDER

OUTLET HEADERS SHOWN

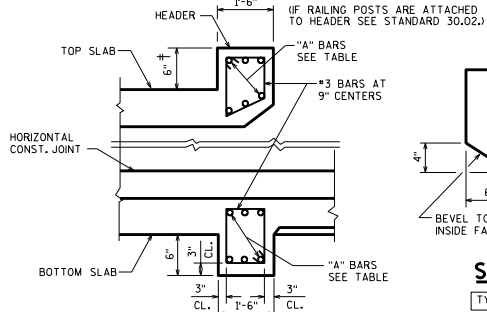

SECTION C2 FOR SKEW OVER 20°

† IF RAILING POSTS ARE ATTACHED TO HEADER THIS DIMENSION MAY BE INCREASED IF NECESSARY TO KEEP RAILING PARALLEL TO ROADWAY. INCREASE WING HEIGHT IF NECESSARY.




SECTION C3

TYPICAL ALL INLETS


* HEADER LENGTH	"A" BARS
TO 11'-0"	6 - #7
OVER 11'-0" - 14'-0"	6 - #8
OVER 14'-0" - 17'-0"	6 - #9
OVER 17'-0" - 20'-0"	6 - #10

* HEADER LENGTH EQUALS THE DISTANCE BETWEEN C. OF WALLS IN ONE CELL MEASURED ALONG THE SKEW.




ELEVATION

INLET NOSE CENTERWALL DETAILS




SECTION C4

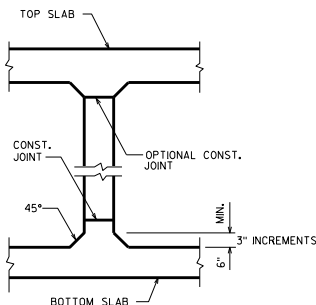

SECTION C5

NOTE:
FOR MULTI-CELL CULVERTS, IN THE TOP OF THE TOP SLAB USE A MINIMUM OF #4 BARS AT 1'-0" IN THE LONGITUDINAL DIRECTION AND A MIN. OF #4 BARS AT 1'-0" IN THE TRANSVERSE DIRECTION WHEN THE TOP SLAB HAS NO FILL PLACED ON IT.

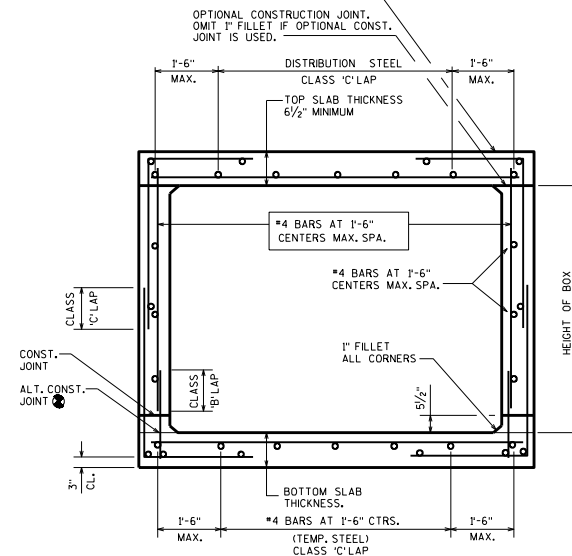

SECTION THRU BOX

DESIGNER NOTE


Ⓢ DETAIL NOT ALLOWED FOR INTERIOR WALLS OR FOR PEDESTRAIN UNDERPASSES. OMIT 1" FILLET IF ALTERNATIVE CONSTRUCTION JOINT IS USED.

BOX CULVERT DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

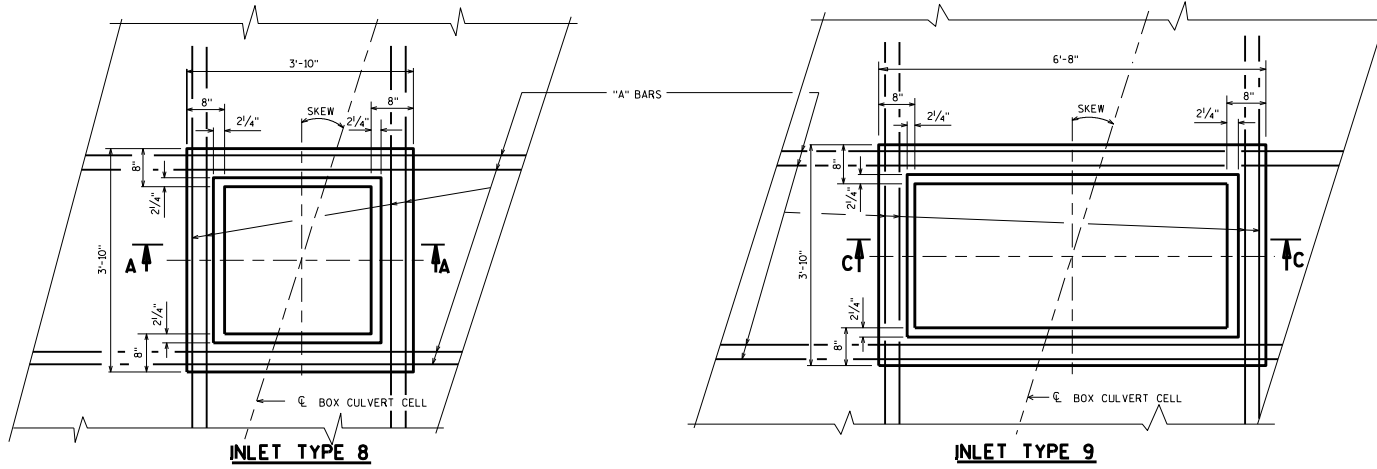

MEDIAN INLET PLAN
(INLET COVER NOT SHOWN)

NOTES





FIELD CUT BAR STEEL REINFORCEMENT IN TOP SLAB TO CLEAR THE OPENING PROVIDED FOR MEDIAN INLET.
ADJUSTMENT OF THE COVER TO GRADE MAY BE ACCOMPLISHED BY THE USE OF MORTAR AND BRICK. MAXIMUM ADJUSTMENT SHALL BE 8".

DESIGN NOTES


SIZE AND LENGTH OF "A" BARS TO BE DETERMINED BY THE DESIGNER.

STEEL SHOWN IS ADEQUATE TO DEPTHS UP TO 15'-6" FOR INLET TYPE 9 AND 44'-0" FOR INLET TYPE 8, ASSUMING A COEFFICIENT OF LATERAL EARTH PRESSURE OF 0.5 AND A UNIT WEIGHT OF SOIL OF 0.120 KCF.


VERTICAL STEEL ADEQUATE FOR DEPTH UP TO 25'-0" ASSUMING WIND LOAD OF 50*/50. FT..

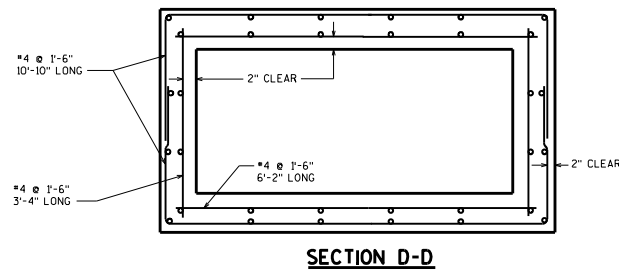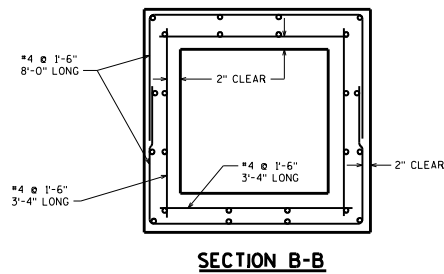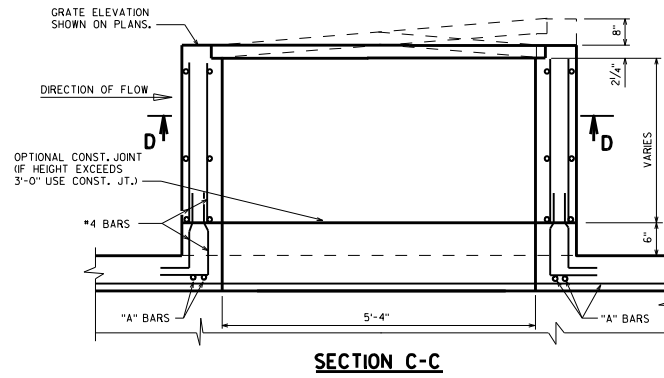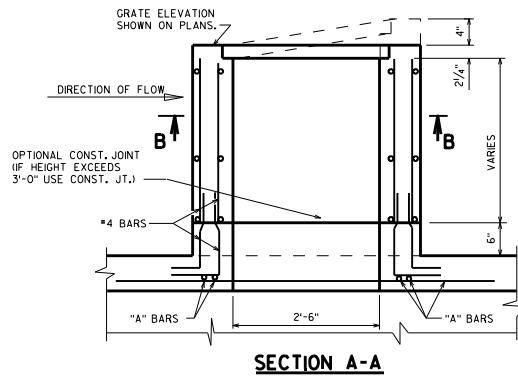

BOX CULVERT MANHOLE FOR INLET TYPE 8 & 9	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <i>Bill Oliva</i>	DATE: 7-16

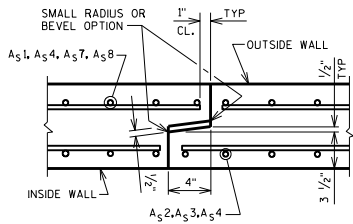


JOINT DETAIL

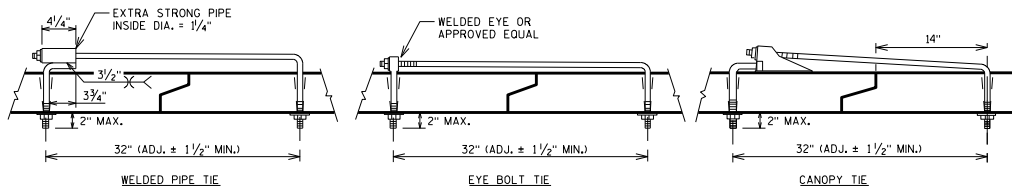


JOINT TIES

NOTES:
EITHER EYE BOLT TIES, WELDED PIPE TIES, OR CANOPY TIES MAY BE USED. THREADS MAY BE CUT OR ROLLED. TIE NUTS SHALL BE TIGHTENED AS DIRECTED BY THE ENGINEER. (2 TIES REQ'D. PER JOINT.) (TIES TO BE GALVANIZED.)




ALTERNATE DETAIL OPTION

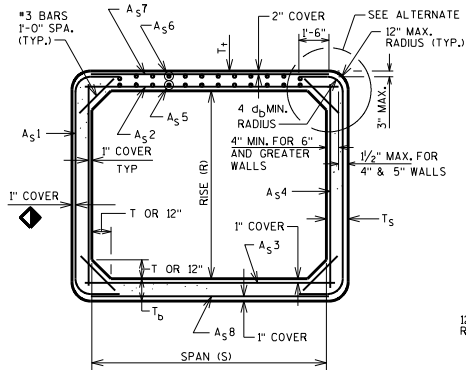


SECTION THRU BARREL
FOR LESS THAN 2 FEET OF COVER


1" OR 3 x WIRE DIAMETER, WHICHEVER IS GREATER

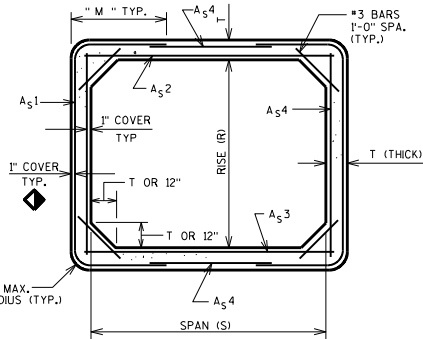

SECTION THRU BARREL
FOR 2'-0" OR MORE OF COVER

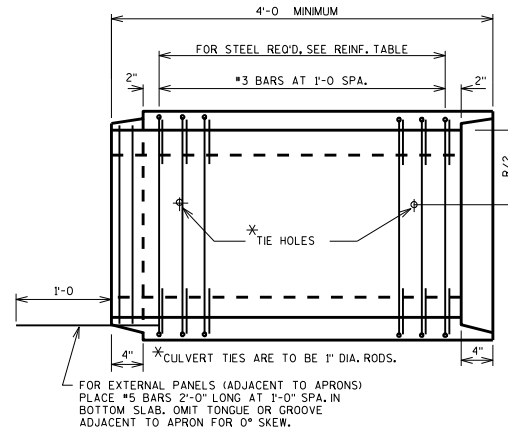

LONGITUDINAL SECTION

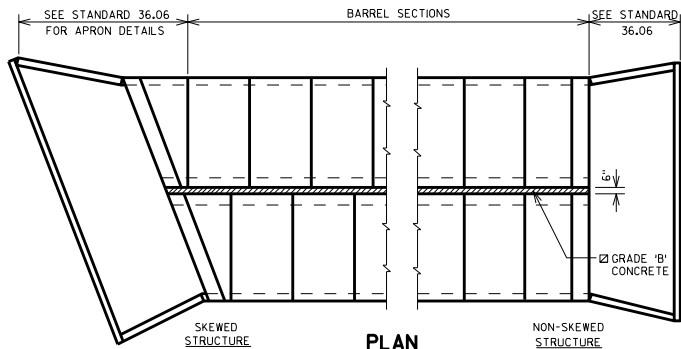

PLAN
MULTICELL INSTALLATION

BOX CULVERT DATA

S (FT.)	DIMENSIONS				EARTH COVER (FT.)					
	RIFT.)	T OR T _G , T _D , T _F (IN.)								
REINFORCEMENT		AREA/FT.	LENGTH	M	AREA/FT.	LENGTH	M	AREA/FT.	LENGTH	M
A _S 1										
A _S 2										
A _S 3										
A _S 4										
A _S 5										
A _S 6										
A _S 7										
A _S 8										
TOTAL BARREL OR PANEL LENGTH										

NOTES

DETAILS FOR MATERIALS, FABRICATION, CONSTRUCTION AND DESIGN OF PRECAST BOX CULVERTS NOT SHOWN OR STATED ON THIS DRAWING SHALL BE IN ACCORDANCE WITH THE CURRENT ASTM SPECIFICATION, C1577; AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS; WISCONSIN DOT BRIDGE MANUAL; WISCONSIN DOT STANDARD SPECIFICATIONS & APPLICABLE SPECIAL PROVISIONS, EXCEPT THAT THE CONCRETE MIXTURE SHALL CONTAIN NOT LESS THAN 565 LBS. OF CEMENTITIOUS MATERIALS PER CUBIC YARD.

THE DESIGN OF PRECAST BOX CULVERTS WITH ALL FILL HEIGHTS SHALL BE AS STATED IN ASTM C1577.

ALL PRECAST BOX SECTIONS SHALL BE PLACED ON A BEDDING OF "STRUCTURE BACKFILL" OF 6" MINIMUM DEPTH.

THE COVER OF CONCRETE OVER THE REINFORCEMENT SHALL BE 1 INCH OR 2 INCHES AS SHOWN WITH AN ALLOWABLE VARIATION OF -3/8" TO +1/2 INCH.

THE SPACING CTR. TO CTR. OF THE CIRCUMFERENTIAL WIRES SHALL NOT BE LESS THAN 2 INCHES NOR MORE THAN 4 INCHES. THE SPACING CTR. TO CTR. OF THE LONGIT. WIRES SHALL NOT BE MORE THAN 8 INCHES.

NOT MORE THAN FOUR (4) HOLES MAY BE CAST, DRILLED OR OTHERWISE NEATLY MADE IN THE SHELL OF EACH PIECE OF BOX SECTION FOR HANDLING. THE HOLES SHALL BE TAPERED UNLESS DRILLED. HOLES SHALL BE FILLED WITH PORTLAND CEMENT MORTAR EXCEPT TAPERED HOLES MAY BE FILLED WITH CONCRETE PLUS SECURED WITH PORTLAND CEMENT MORTAR OR OTHER APPROVED ADHESIVE.

THE JOINT ON THE BOTTOM OF THE CULVERT & THE SIDES OF THE CULVERT FROM THE BOTTOM TO A POINT 1'-0" FROM THE CEILING SHALL BE SEALED WITH A PREFORMED MASTIC. PREFORMED MASTIC MUST CONFORM TO AASHTO MATERIALS SPEC. M198, TYPE B. A 2'-0" STRIP OF GEOTEXTILE FABRIC SHALL BE PLACED OVER THE JOINTS ON THE TOP AND ON THE SIDES OF THE CULVERT. THE GEOTEXTILE FABRIC SHALL COMPLY WITH REQUIREMENTS OF STANDARD SPECIFICATION 645.2.4, SCHEDULE A. (FABRIC NOT REQUIRED OVER INSIDE WALL JOINTS OF MULTICELL INSTALLATION.)


WHEN TWO OR MORE BARRELS ARE UTILIZED IN PARALLEL FOR MULTICELL INSTALLATIONS THE CLEAR SPACING BETWEEN BARRELS SHALL BE 6 INCHES AND THE SPACE BETWEEN ADJACENT BARRELS FROM TOP OF BEDDING TO TOP OF TOP SLAB SHALL BE FILLED WITH GRADE "B" CONCRETE.

PRECAST CONCRETE BOX CULVERT BARREL DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*


DATE:
7-16

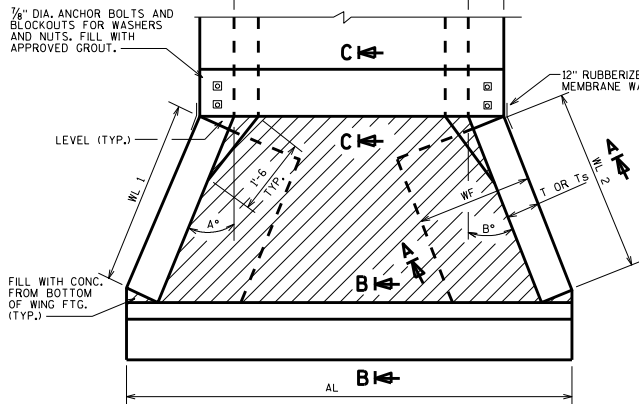

APRON PLAN
(NON-SKEWED STRUCTURE)

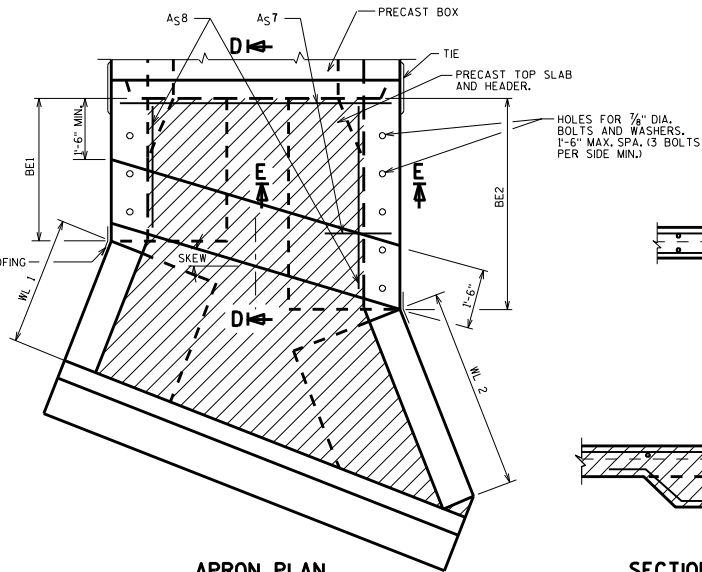

APRON PLAN
(SKEWED STRUCTURE)

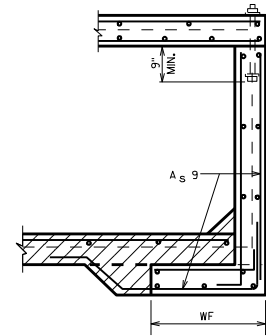

SECTION E

NOTES

CONCRETE COVER ON ALL REINFORCEMENT IN THE PRECAST ELEMENTS SHALL BE 2" UNLESS SHOWN OR NOTED OTHERWISE.

STEEL REINFORCEMENT MAY BE EITHER GRADE 60 DEFORMED BARS (FY = 60,000 P.S.I.) OR WELDED DEFORMED - WIRE FABRIC OF EQUIVALENT AREA, (FY = 65,000 P.S.I.)

THE ULTIMATE COMPRESSIVE STRENGTH OF THE FIELD POURED CONCRETE SHALL BE 3,500 P.S.I.

ALTERNATE DETAILS OF EQUAL STRENGTH AND HYDRAULIC CAPACITY TO THE DETAILS SHOWN ON THIS SHEET MAY BE SUBMITTED TO THE ENGINEER FOR APPROVAL.

THE ULTIMATE COMPRESSIVE STRENGTH OF THE CONCRETE IN THE PRECAST ELEMENTS SHALL BE 4,000 P.S.I.

THE PRECAST ELEMENTS SHALL BE PROVIDED WITH SUITABLE LIFTING DEVICES FOR HANDLING AND PLACEMENT OF THE ELEMENTS.

VERTICAL CONSTRUCTION JOINTS THRU THE WALLS AND FOOTING WILL BE ALLOWED ONLY WITH THE APPROVAL OF THE ENGINEER. DETAILS MUST BE SHOWN ON THE SHOP DRAWINGS FOR APPROVAL.

THE AREA OF REINFORCING STEEL NOT IDENTIFIED IN SECTIONS SHALL CONFORM TO THE FOLLOWING TEMPERATURE AND SHRINKAGE REQUIREMENTS:

THICKNESS T&S REINF.	
≤ 12"	#4 @ 18"
> 12" - 18"	#4 @ 12"

THE MAXIMUM BAR SIZE OF GRADE 60 DEFORMED BARS, OTHER THAN THE A 10 BARS, SHALL BE #5.


THE 7/8" DIA. ANCHOR BOLTS SHALL BE GALVANIZED AND CONFORM TO THE REQUIREMENTS OF A.S.T.M. A575.

ALL EXPOSED CORNERS SHALL BE BEVELED 3/4" ON THE SIDES OR TOOL EDGED WITH A 1/2" MINIMUM RADIUS EDGER.


PRECAST CUT OFF WALLS MAY BE FIELD SPLICED BY EXTENDING THE REINFORCING STEEL FROM BOTH SEGMENTS TO BE SPLICED 1'-6" INTO THE SPLICE ZONE, LAPPING THE STEEL ± 1'-6" AND FIELD POURING A SECTION OF CUT OFF WALL 1'-6" LONG.

PRECAST ELEMENTS MAY BE POURED IN PLACE AT THE OPTION OF THE CONTRACTOR.

APRON SHALL BE POURED AND CURED PRIOR TO BACKFILLING WINGWALLS.

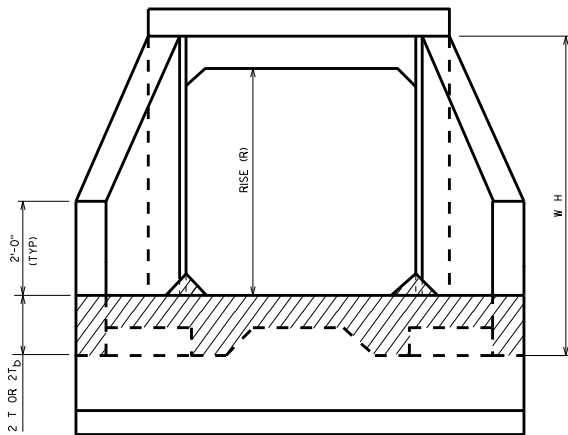

END VIEW

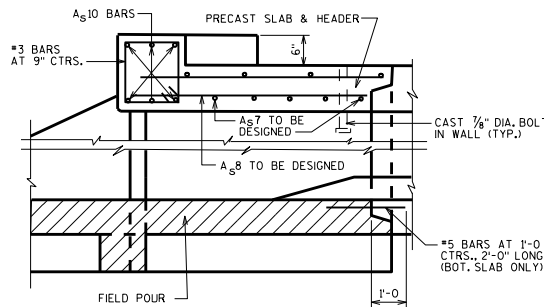


SECTION D


(SIFT.)	R.(FT.)	T OR T8 (IN)	SKEW	ANGLE A	ANGLE B	WL 1	WL 2	AL	AH	WH	BE1	BE2
INLET												
OUTLET												

SPAN (S)	A 5 10 BARS		
	0°-15°	16°-30°	31°-45°
6'-0"	6 #6	6 #6	6 #6
7'-0"	6 #6	6 #6	6 #7
8'-0"	6 #6	6 #7	6 #8
10'-0"	6 #7	6 #8	6 #8


RISE (R)	A 5 9 IN. 2/FT	WF
4'-0"	.19	2'-6"
6'-0"	.24	3'-6"
8'-0"	.31	4'-0"
10'-0"	.34	4'-9"

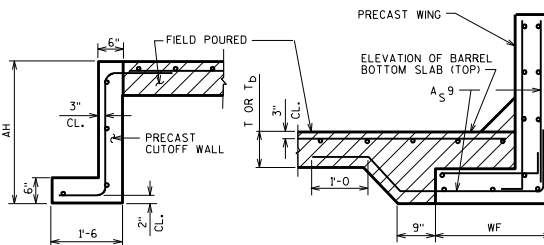

SECTION B



SECTION A

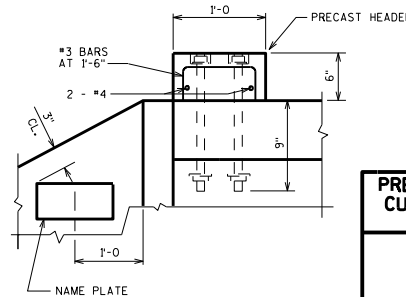

SECTION C


PRECAST WINGS, HEADERS, AND CUTOFF WALLS FOR PRECAST CONCRETE BOX CULVERT

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16


* WELDING IS TO BE COMPLETED USING THE GAS-METAL ARC WELDING (GMAW) PROCESS WITH ER70S-3 WELDING WIRE AND ARGON-OXYGEN OR CO₂ COVER GAS.

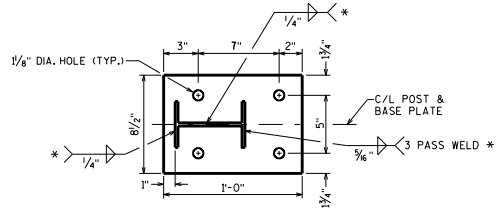


SECTION A-A
POST & BASE PLATE

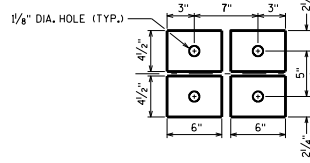

SECTION B-B
(4)-BOTTOM PLATES




SECTION C-C
HOLE IN POST FLANGE ON APPROACHING TRAFFIC SIDE

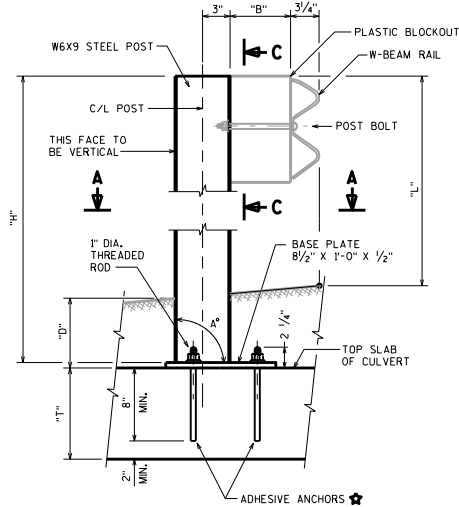

ELEVATION
GUARDRAIL POST ANCHORS TYPE 1

USE FOR THICKNESS "T" OF 10 INCHES OR MORE AND MINIMUM CONCRETE STRENGTH (f'_c) OF 4,000 PSI

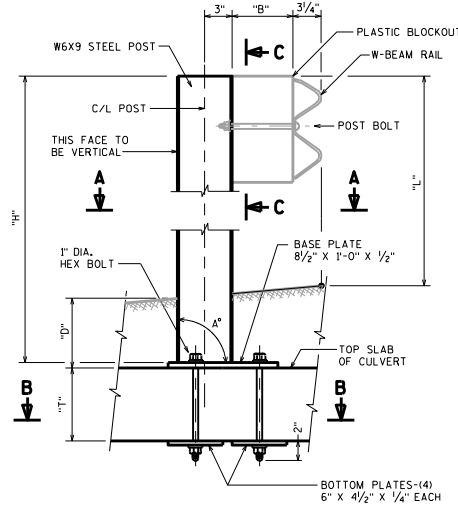

ELEVATION
GUARDRAIL POST ANCHORS TYPE 2


USE FOR THICKNESS "T" OF 8 INCHES OR MORE AND MINIMUM CONCRETE STRENGTH (f'_c) OF 3,500 PSI

GUARDRAIL POST ANCHORAGE SYSTEM

CRITERIA:

USE FOR POSTS WITH "D" EMBEDMENT LESS THAN OR EQUAL TO 4'-0" AND GREATER THAN OR EQUAL TO 3'. NOT REQ'D FOR POSTS WITH "D" EMBEDMENT MORE THAN 4'-0". NOT ALLOWED FOR POSTS WITH "D" EMBEDMENT LESS THAN 9".

	"L"	"B"	"X"	"Y"
CLASS "A" GUARDRAIL	2'-4 3/8"	8"	7"	1 3/8"
MGS GUARDRAIL	2'-7 1/8"	12"	7 1/8"	3/4"



STEEL SHIM DETAIL
4 PER POST

NOTES

DETAILS SHOWN FOR POSTS, PLATES, ANCHORAGE SYSTEM AND INSTALLATION, BLOCKS, AND GUARD RAIL ARE NOT PART OF THE STRUCTURE CONTRACT, BUT ARE BID PER THE ROADWAY DESIGN PLANS.

POST BASE PLATES (AND BOTTOM PLATES IF USED) SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS.

CUT BOTTOM OF POST SO THAT POST WILL BE VERTICAL WHEN POST ASSEMBLY IS PLACED ON TOP OF THE CULVERT. ALONG THE ROADWAY THE POST WILL BE NORMAL TO GRADE LINE. HEX BOLTS AND THREADED RODS ARE TO BE PLACED PERPENDICULAR TO THE BASE PLATE.

POST, BASE PLATE (AND BOTTOM PLATE IF USED), AND SHIMS SHALL BE GALVANIZED AFTER FABRICATION.

PRIOR TO GALVANIZING, ALL STEEL POSTS AND PLATES SHALL BE GIVEN A NO. 6 COMMERCIAL BLAST CLEANING BY SSPC SPECS.

ALL MATERIAL USED IN POSTS AND PLATES SHALL BE MADE FROM MATERIAL CONFORMING TO ASTM DESIGNATION A709 GRADE 50 OR 50S.

HEX BOLTS, THREADED RODS, HEX NUTS AND WASHERS SHALL CONFORM TO THE REQUIREMENTS OF ASTM F1554 GRADE 36, AND SHALL BE GALVANIZED. RODS ARE TO BE FULLY THREADED AND BOLTS TO BE THREADED 3". CHAMFER TOP OF BOLTS AND RODS BEFORE THREADING.

★ ADHESIVE ANCHORS 1-INCH, EMBED IN CONCRETE AS DETAILED. CHARACTERISTIC BOND STRENGTH SHALL MEET OR EXCEED 1305 PSI FOR UNCRACKED CONCRETE.

STEEL SHIMS MAY BE USED BETWEEN PLATES AND SLAB WHERE REQUIRED FOR ALIGNMENT.

DESIGNER NOTES

CHECK CRITERIA TO SEE IF POST ANCHORAGE SYSTEM IS REQUIRED BASED ON FILL HEIGHT "D" AT POSTS. IF REQUIRED, THEN SELECT WHICH TYPE OF ANCHORAGE (TYPE 1 OR TYPE 2) SHOULD BE USED.

CONTACT THE ROADWAY DESIGN SECTION TO VERIFY IF CLASS "A" OR "MGS" GUARDRAIL SYSTEM WILL BE USED.

POST SPACING IS 3'-1 1/2" PER FDM SDD 14 B 51-1. SEE FDM SDD 14 B 51-1 FOR MINIMUM CLEARANCES FROM EDGES OR OBSTRUCTIONS TO ANCHORAGE SYSTEM. FOR TYPE 2 ANCHORAGE, MAKE SURE BOTTOM PLATE IS NOT PLACED AT THE SLOPED HAUNCH BETWEEN THE WALL AND TOP SLAB. SHIFT LOCATION OF POSTS (LONGITUDINALLY ALONG C/L OF POSTS) IF REQUIRED TO MEET SPACING AND CLEARANCE REQUIREMENTS.

SHOW DETAILS AND PERTINENT NOTES FOUND ON THIS STANDARD ON THE STRUCTURE PLANS FOR THE CHOSEN ANCHOR TYPE.

SHOW LOCATION OF POSTS AND SPACING ALONG C/L OF POST IN PLAN VIEW OF STRUCTURE PLANS. LABEL EACH POST (#1, P2, ETC.). SHOW A TABLE PROVIDING THE ESTIMATED LENGTH "H" OF EACH POST, AND THE ANGLE "A" BETWEEN BASE PLATE AND POST.

IN THE TOP SLAB PROVIDE A MINIMUM OF #4 BARS AT 1'-0" IN EACH DIRECTION WHEN TYPE 1 OR TYPE 2 DETAILS ARE USED.

THIS RAILING AND ANCHORAGE SYSTEM MEET NCHRP 350 EVALUATION CRITERIA FOR TEST LEVEL 3 (TL-3).

GUARDRAIL POST ANCHORAGE SYSTEM	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

DESIGNER NOTES FOR PRECAST CONCRETE STRUCTURE

BID ITEM SHALL BE "THREE-SIDED PRECAST CONCRETE STRUCTURE".

PRECAST BRIDGES WILL BE LIMITED TO SPANS NOT TO EXCEED 42'-0".

SECURE WISDOT BOS AND GEOTECHNICAL (SOILS) ENGINEER'S APPROVAL BEFORE INCORPORATING PRECAST BRIDGES IN ANY PROJECT.

CHECK FOUNDATION PRESSURE, SCOUR AND SETTLEMENT TO ENSURE THAT NO FOUNDATION FAILURE OCCURS. PREFERABLY, PROVIDE FOOTING ON NON-YIELDING FOUNDATION MATERIAL. HOWEVER, ALLOWABLE DIFFERENTIAL SETTLEMENT FOR FOOTING ON SOIL SUPPORTING THE STRUCTURE = 0.002 FT. PER FT. (MAX.) OF THE SPAN. DESIGN STRUCTURE COMPONENTS TO RESIST FORCES CAUSED BY THIS DIFFERENTIAL SETTLEMENT. ADEQUATELY REINFORCE THE ENTIRE FOOTING AS REQUIRED BY THE DESIGN.

WHEN BEAM GUARD POSTS ARE TO BE EMBEDDED IN FILL ABOVE THE PRECAST ARCH UNIT, PROVIDE A DEPTH OF FILL, MEASURED FROM TOP OF ARCH CROWN TO TOP OF ROADWAY, AT LEAST EQUAL TO THE MINIMUM EMBEDMENT DEPTH SHOWN ON S.D.D. 14 B 15-6 PLUS 6".

FOR SHORTER SPAN CULVERTS, WHERE BEAM GUARD CROSSES THE LENGTH OF THE STRUCTURE, CONSIDERATION SHALL BE GIVEN TO THE DETAILS SHOWN ON S.D.D. 14 B 43-3 PROVIDED ALL REQUIREMENTS ON THIS STANDARD CAN BE MET.

WHEN A CONCRETE BARRIER (SINGLE SLOPE) CROSSES THE LENGTH OF THE STRUCTURE, THE FILL DEPTH MUST BE ADEQUATE TO ACCOMMODATE THE REQUIRED FOOTING DEPTH. SEE S.D.D. 14 B 32-1 AND S.D.D. 14 B 34-1 FOR CONCRETE BARRIER DETAILS.

PROVIDE A SUITABLE DRAINAGE PIPE ALONG THE CULVERT AND WINGWALLS TO RELEASE HYDROSTATIC PRESSURE. WHERE SIGNIFICANT SEEPAGE OR RELATIVELY RAPID ACCUMULATION OF WATER IS ANTICIPATED BEHIND THE WALL, INCORPORATE PIPE UNDERDRAIN WRAPPED AS SPECIFIED, INTO THE BACKFILL STRUCTURE, BEHIND THE WALL TO IMPROVE DRAINAGE CONDITIONS, DIRECT SEEPAGE FROM DRAINAGE PIPE TO WEEP HOLES ALONG THE EXTERIOR FACE OF THE WALL OR TO THE STORM WATER CONVEYANCES.


PLACE FOOTINGS BELOW SCOUR AND FROST DEPTHS. PLACE BOTTOM OF FOOTING AT A MINIMUM DEPTH EQUAL TO PREVAILING FROST DEPTH OR SCOUR DEPTH BUT NOT LESS THAN 4'-0" BELOW GROUND ELEVATION UNLESS CONSTRUCTED ON ROCK FOUNDATION OR OTHERWISE INDICATED.

PROVIDE DUCTILE JOINT SYSTEM BETWEEN VERTICAL LEG OF THE PRECAST SEGMENT AND FOOTER AS INDICATED ON THE STANDARD DETAIL DRAWINGS.


BENDING OF REINFORCEMENT FOR PRECAST BRIDGE UNITS - THE OUTSIDE AND INSIDE CIRCUMFERENTIAL REINFORCING STEEL FOR THE CORNERS OF THE BRIDGE SHALL BE BENT TO SUCH AN ANGLE THAT IS APPROXIMATELY EQUAL TO THE CONFIGURATION OF THE BRIDGE'S OUTSIDE CORNER.

LRFD DESIGN LOADS


LIVE LOAD: HL-93
 HORIZONTAL EARTH PRESSURE: UNIT WEIGHT = 125 PCF
 VERTICAL EARTH PRESSURE: UNIT WEIGHT = 120 PCF

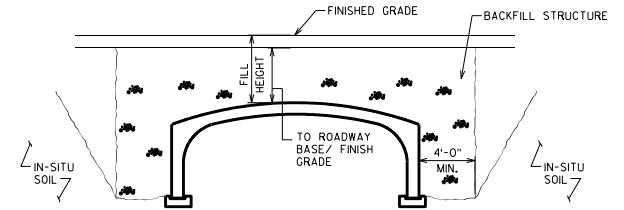

BACKFILL REQUIREMENTS

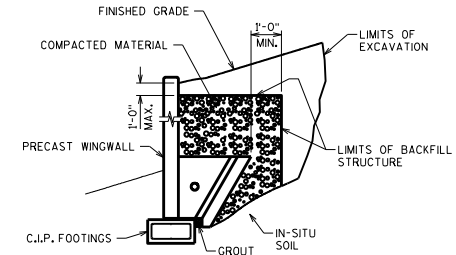


WALL BACKFILL REQUIREMENTS




APPROXIMATE/GUIDELINE NUMBER OF ANCHORS PER WALL	
LENGTH OF WALL	NO. ANCHORS
L = 14'-0"	2
L = 20'-0"	3
L = 24'-0"	4
24'-0" < L	MULTIPLE-PIECE WINGWALL*

*NOTE: ADJACENT SEGMENTS SHALL BE ATTACHED TO EACH OTHER TO KEEP FRONT FACES IN ALIGNMENT. PLACE A FILLER AT THESE JOINTS WITH A MEMBRANE ALONG THE JOINT AT THE BACK FACE.

PRECAST THREE-SIDED BOX CULVERT DESIGN NOTES	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

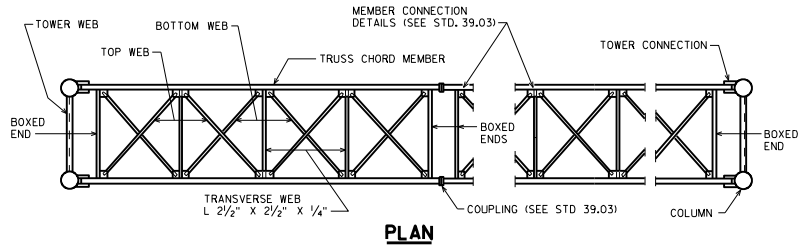


PLAN

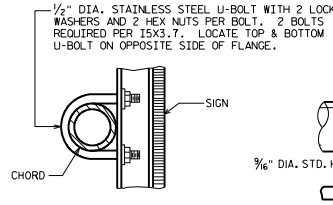


SECTION B-B

TYPICAL SIGN CONNECTION
USE FOR TYPE I AND II SIGNS ONLY

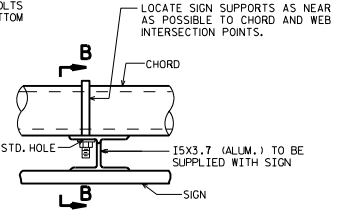


CHORD SPLICE

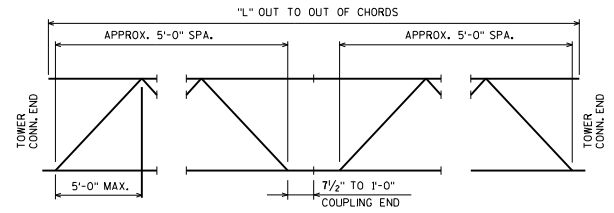


TRUSS ARRANGEMENT

FABRICATOR MAY MAKE TRUSSES ANY LENGTH KEEPING A SECTION A MINIMUM OF 20'-0" & A MULTIPLE OF 5'-0". CHORD FIELD SPLICES SHALL BE MADE WITH COUPLINGS. CHORD SHOP SPLICE SHALL BE THE WELDED SPLICE SHOWN ABOVE.

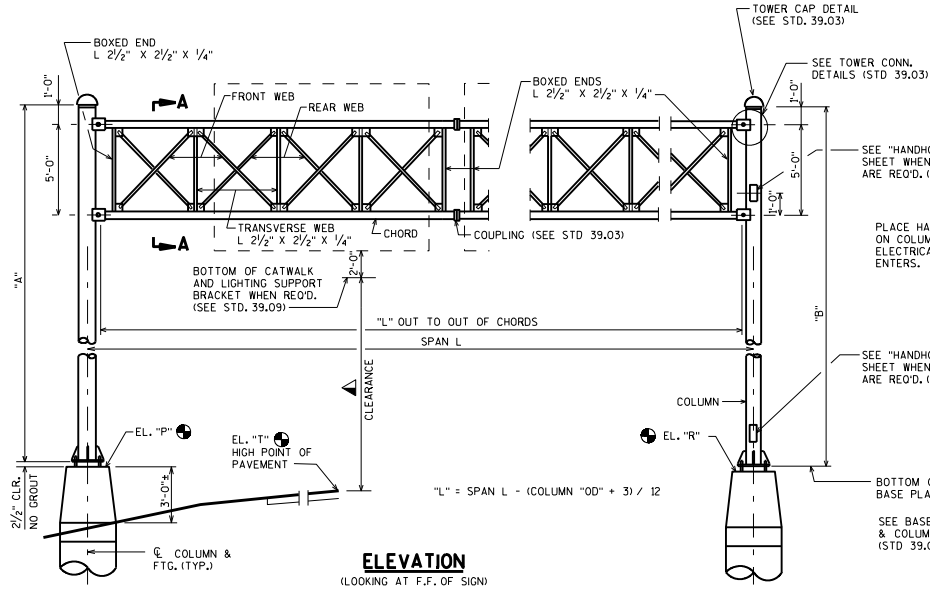

ELEVATION

(LOOKING AT F.F. OF SIGN)

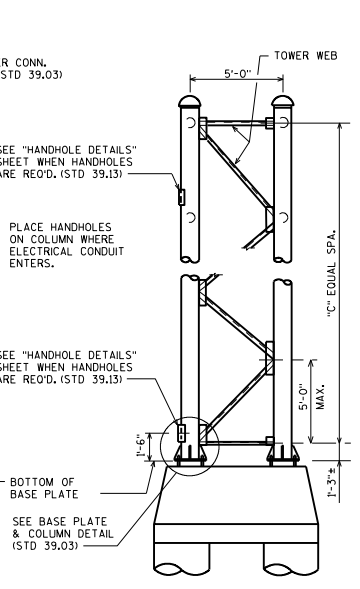

END VIEW

NOTES

- DRAWINGS SHALL NOT BE SCALED.
- STEEL COLUMN AND CHORD PIPES SHALL BE API SPEC. 5L GRADE X42 Fy = 42,000 PSI**
- PLATES, BARS & STRUCTURAL ANGLES SHALL BE ASTM A709 GRADE 36 Fy = 36,000 PSI
- STEEL ANCHOR RODS SHALL MEET THE REQUIREMENTS OF ASTM F1554 GRADE 55, ASTM A563A HEAVY HEX NUTS, AND ASTM F436 WASHERS.
- UNLESS DETAILED OTHERWISE IN THE PLANS, ALL U.S. BOLTED CONNECTIONS SHALL BE MADE WITH 3/4" DIA. A325 GALVANIZED BOLTS. FIELD CONNECTIONS SHALL BE INSTALLED WITH DTI WASHERS.
- ALL STRUCTURAL STEEL MEMBERS, PLATES, ANCHOR RODS, H.S. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED PER SECTION 641 OF THE WISDOT STANDARD SPECIFICATIONS.
- WELDED CONNECTIONS CAN BE USED IN LIEU OF BOLTED CONNECTIONS, IF A TRUSS UNIT CAN BE GALVANIZED IN ONE PIECE.
- WELD TEST AS PER AWS D11.
- EXACT LOCATION OF SIGN BRIDGE SHALL BE DETERMINED BY THE REGION TRAFFIC ENGINEER.
- SEE SIGN PLATE NO. A4-6 OF THE SIGN PLATE MANUAL FOR INSTRUCTION ON CENTERING SIGN VERTICALLY ON TRUSS.
- ** SEE WISDOT BRIDGE MANUAL SECTION 39.3 FOR ACCEPTABLE ALTERNATE MATERIAL.


⊕ ELEVATIONS TO BE SHOWN ON "GENERAL LAYOUT" SHEET.

▲ 20'-0" MIN. FOR OSOW HIGH CLEARANCE ROUTE, 18'-3" MIN. FOR ALL OTHERS.

DESIGN DATA


DEAD LOAD - 3 PSF OF SIGN, WT. OF SUPPORTING STRUCTURE, CATWALK, LIGHTS AND RAILINGS.
 ICE LOAD - 3 PSF TO 1 FACE OF SIGN & AROUND SURFACE OF MEMBERS.
 WIND PRESSURE - 90 MPH (3-SECOND GUST SPEED) TO SIGN AREA & EXPOSED MEMBERS.
 FATIGUE GROUP LOAD IS APPLIED PER SECTION 39.4.2 OF THE WISDOT BRIDGE MANUAL.
 DESIGNED ACCORDING TO THE 6TH EDITION OF AASHTO "STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS."

STANDARDS 39.03, 39.09, AND 39.13 DETAILS ARE USED WITH THIS STANDARD TO DETAIL A "4-CHORD GALVANIZED STEEL SIGN BRIDGE" FOR TYPE I AND II SIGNS ONLY.

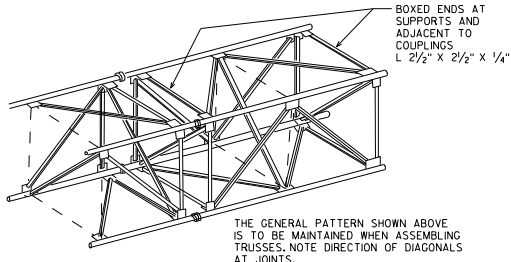


TYPICAL TRUSS SECTION

THE GENERAL PATTERN SHOWN ABOVE IS TO BE MAINTAINED WHEN ASSEMBLING TRUSSES. NOTE DIRECTION OF DIAGONALS AT JOINTS.

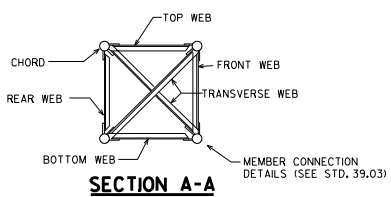

SECTION A-A


4-CHORD GALVANIZED STEEL SIGN BRIDGE	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

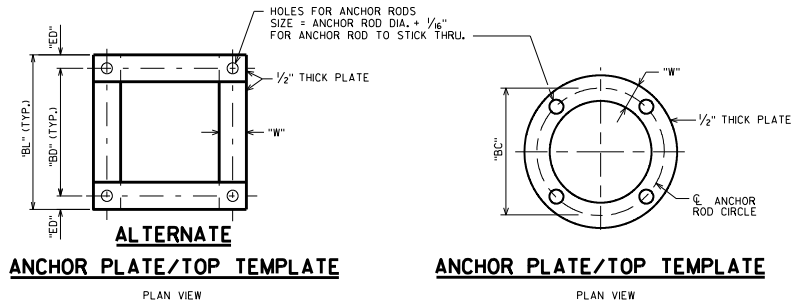


ALTERNATE ANCHOR PLATE/TOP TEMPLATE

ANCHOR PLATE/TOP TEMPLATE


CAP FABRICATED FROM STEEL PLATES (MIN. THICKNESS = 3/16") WILL BE ACCEPTABLE, SUBJECT TO APPROVAL BY THE ENGINEER.

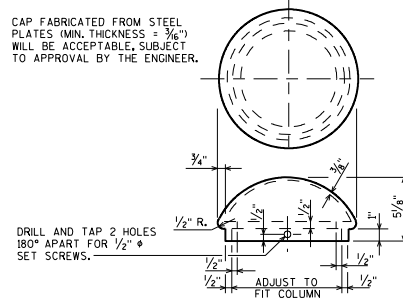

TOWER CAP DETAIL

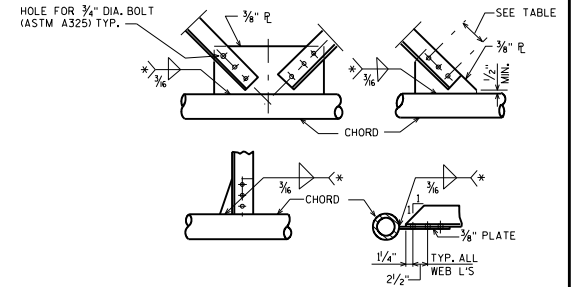


TYPICAL TRUSS CONNECTION DETAILS

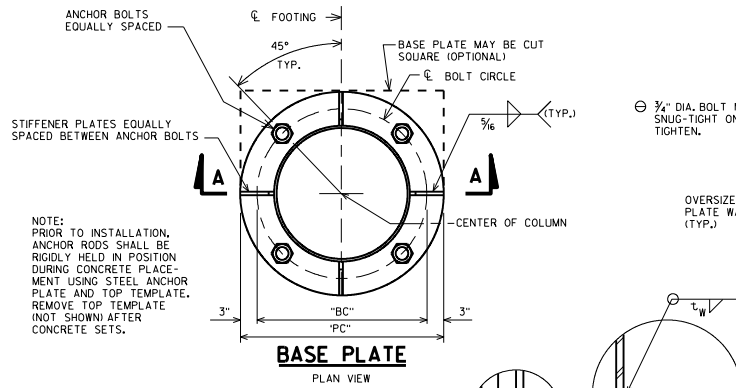

BASE PLATE


3/4" DIA. BOLT MAY BE ASTM A449. SNUG-TIGHT ONLY, DO NOT OVER TIGHTEN.

OVERSIZED, OR PLATE WASHER. (TYP.)

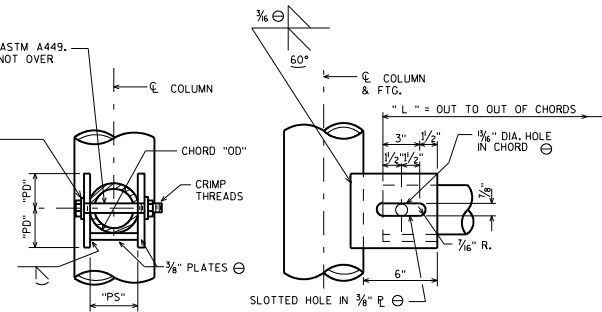

TOWER CONNECTION DETAIL

⊖ BOLT, PLATE & HOLE DETAILS SHOWN ARE MIN.



TYPICAL WELDED ALTERNATE

DESIGN DATA


WEB MEMBERS & BOXED ENDS

ANGLE SIZE	*WELD LENGTH	NO. OF BOLTS
● 2 1/2" x 2 1/2" x 1/4"	11"	3
3" x 3" x 3/16"	10"	3
3" x 3" x 1/4"	13"	4
3" x 3" x 3/16"	16 1/2"	5
3" x 3" x 3/8"	19 1/2"	6
4" x 4" x 1/4"	18"	5
4" x 4" x 3/16"	22"	6
4" x 4" x 3/8"	26"	8
4" x 4" x 1/2"	30"	9
4" x 4" x 1/2"	34"	10

● ONLY USED FOR BOXED ENDS AND TRANSVERSE WEBS.


OTHER DATA

- *BC = COLUMN "OD" + 6"
- *PC = COLUMN "OD" + 1'-0"
- *W = 2 x (ANCHOR ROD DIA.)
- *BD = "BC" x COS(45°)
- *ED = "W"/2
- *BL = "BD" + "W"
- *PD = (CHORD "OD")/2 + 3/4"
- *PS = CHORD "OD" + 3/16"

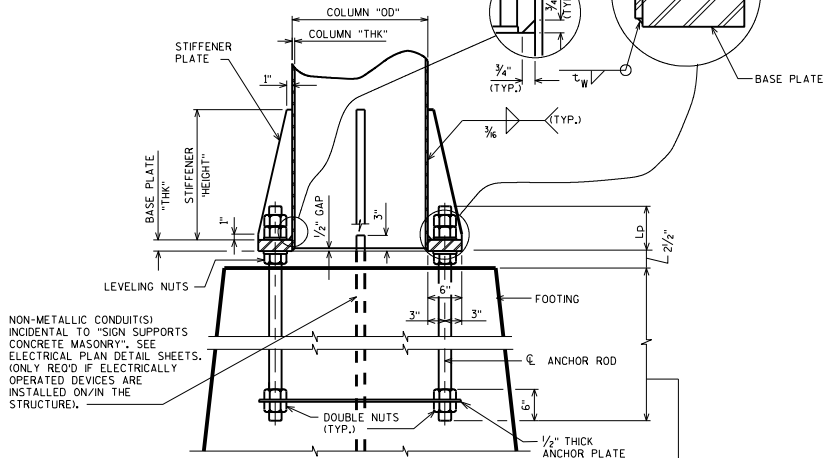

SECTION A-A


Lo FOR 1/4" ANCHOR ROD DIA.
Lo FOR 1/2" ANCHOR ROD DIA.
Lo FOR 3/4" ANCHOR ROD DIA.

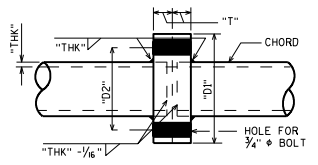







COUPLING DETAIL

CONTRACTOR SHALL PROVIDE #16 GALV. GALVANIZED STEEL SHIMS, AS REQUIRED TO PROVIDE FOR CAMBER



4-CHORD SIGN BRIDGE DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16




NOTE:
CATWALK SHALL MEET AASHTO "STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS" 6TH EDITION, 1500 LB. DISTRIBUTED OVER 2'-0" TRANSVERSELY WITH THE BASIC ALLOWABLE UNIT STRESS INCREASED 25%. MAX. SPAN IS 8'-0". CATWALK SHALL ALSO MEET THE MOST RECENT ISSUE OF OSHA STD'S FOR WALKING-WORKING SURFACES.

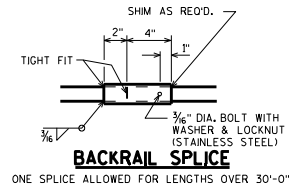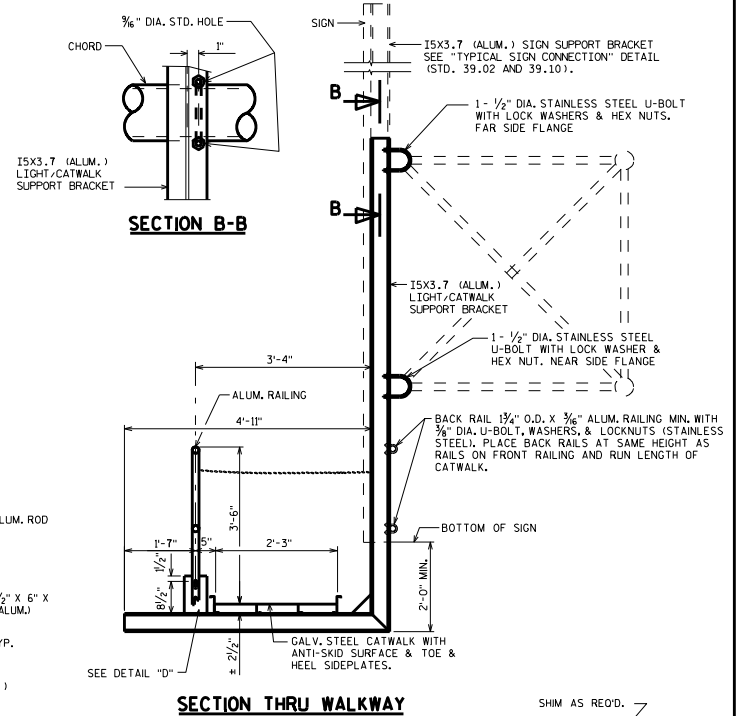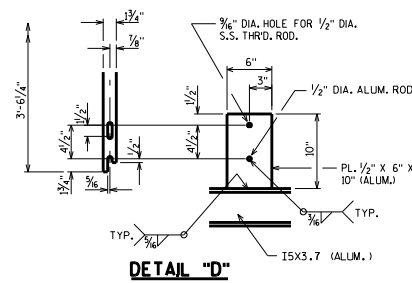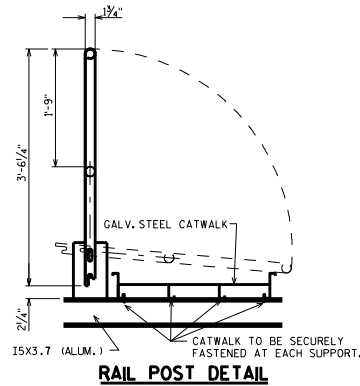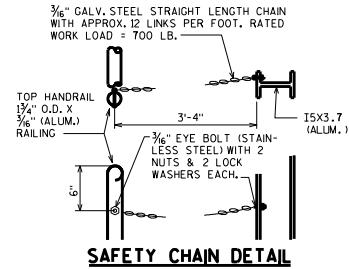

ONE SPLICE ALLOWED FOR LENGTHS OVER 30'-0"

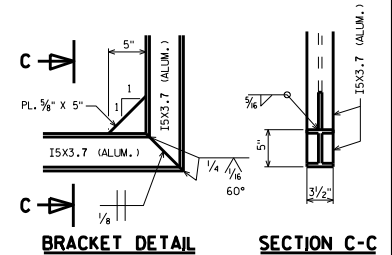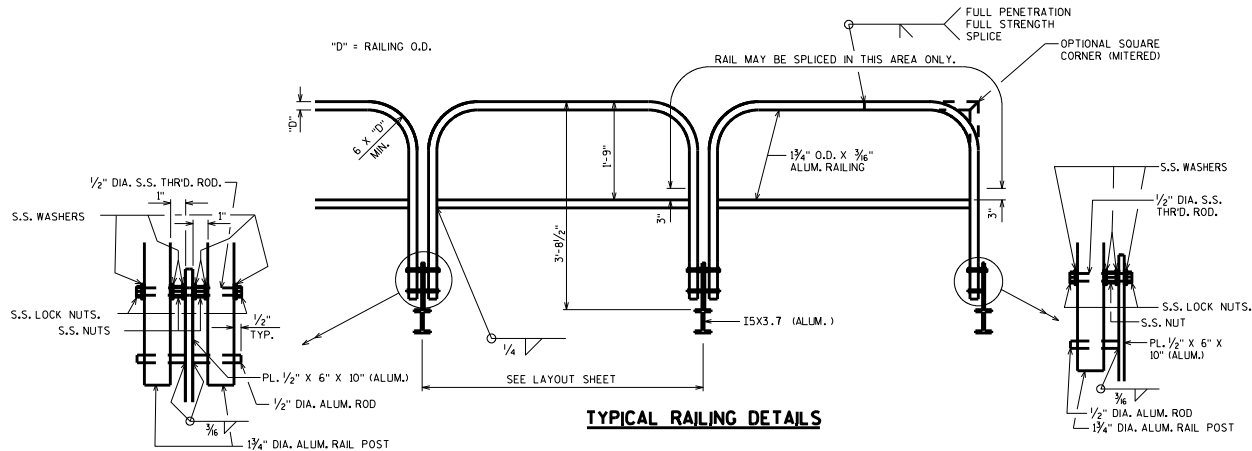

SIGN BRIDGE CATWALK FOR TYPE I AND II SIGNS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

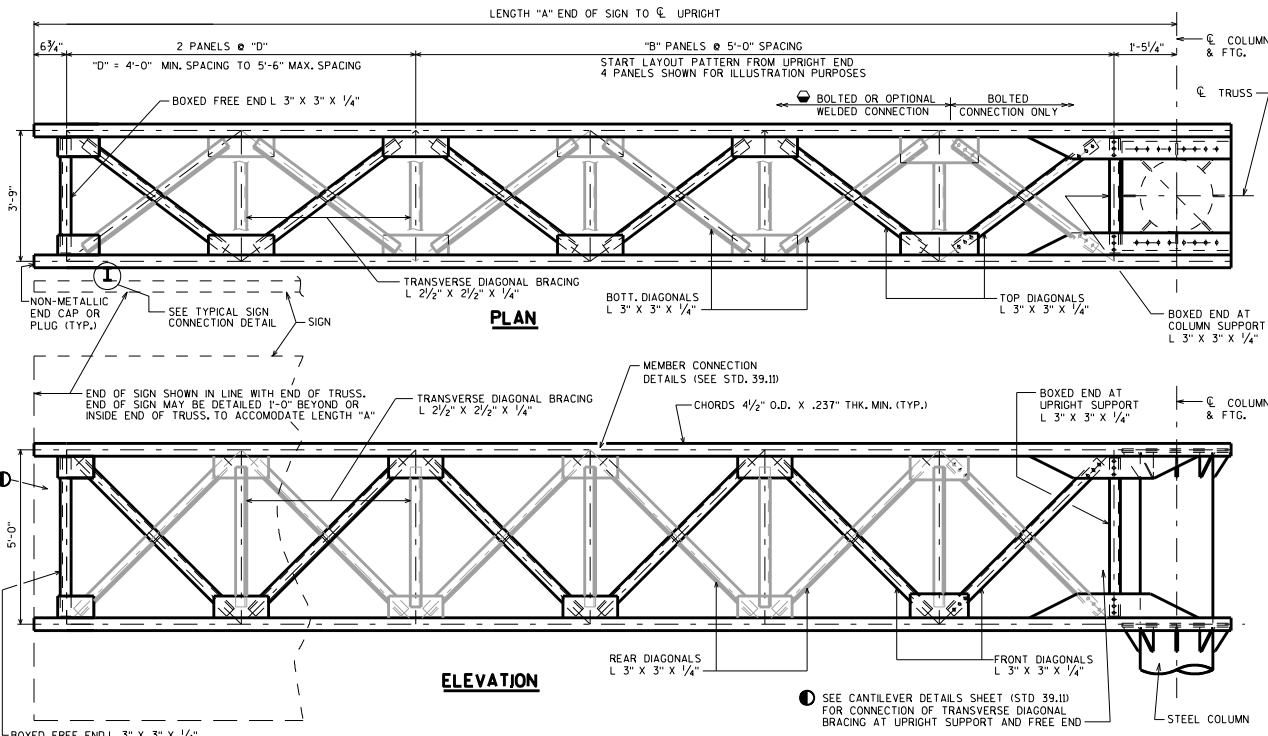

NOTES

- DRAWINGS SHALL NOT BE SCALED.
- STEEL COLUMN AND CHORD PIPES SHALL BE API SPEC. 5L GRADE X42, PSL-2, $F_y = 42,000$ PSI**
- PLATES, BARS & STRUCTURAL ANGLES SHALL BE ASTM A709 GRADE 36, $F_y = 36,000$ PSI
- STEEL ANCHOR RODS SHALL MEET THE REQUIREMENTS OF ASTM F1554 GRADE 55, ASTM A563A HEAVY HEX NUTS, AND ASTM F436 WASHERS.
- UNLESS DETAILED OTHERWISE IN THE PLANS, ALL H.S. BOLTED CONNECTIONS SHALL BE MADE WITH 3/4" DIA. A325 GALVANIZED BOLTS. FIELD CONNECTIONS SHALL BE INSTALLED WITH DTI WASHERS.
- ALL STRUCTURAL STEEL MEMBERS, PLATES, ANCHOR RODS, H.S. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED PER SECTION 641 OF THE WISDOT STANDARD SPECIFICATIONS.
- WELD TEST AS PER AWS D11.
- EXACT LOCATION OF SIGN BRIDGE SHALL BE DETERMINED BY THE REGION TRAFFIC ENGINEER.
- PREFABRICATE CAMBER INTO THE HORIZONTAL SUPPORT PROVIDING AN AMOUNT "Y" AT END OF TRUSS SHOWN IN "CAMBER DIAGRAM". DO NOT RAKE VERTICAL UPRIGHT BY ADJUSTMENT OF LEVELING NUTS.
- SEE SIGN PLATE NO. A4-6 OF THE SIGN PLATE MANUAL FOR INSTRUCTION ON CENTERING SIGN VERTICALLY ON TRUSS.
- ** SEE WISDOT BRIDGE MANUAL SECTION 39.3 FOR ACCEPTABLE ALTERNATE MATERIAL. STEEL WITH YIELD STRENGTH BELOW 42,000 PSI REQUIRES A COMPLETE ANALYSIS OF THE STRUCTURE.
- WELDED CONNECTIONS MAY BE USED IF UNIT CAN BE GALVANIZED IN ONE PIECE.
- ELEVATIONS TO BE SHOWN ON "GENERAL LAYOUT" SHEET.
- 20'-0" MIN. FOR OSOW HIGH CLEARANCE ROUTE, 18'-3" MIN. FOR ALL OTHERS.

DESIGN DATA



DEAD LOAD - 3 PSF OF SIGN, WT. OF SUPPORTING STRUCTURE, CATWALK, LIGHTS AND RAILINGS.
 ICE LOAD - 3 PSF TO 1FACE OF SIGN & AROUND SURFACE OF MEMBERS.
 WIND PRESSURE - 90 MPH (3-SECOND GUST SPEED) TO SIGN AREA & EXPOSED MEMBERS.
 FATIGUE CATEGORY I WITHOUT GALLOPING WIND EFFECTS.

DESIGNED ACCORDING TO THE 4TH EDITION AND INTERIM REVISIONS OF AASHTO "STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS."


DESIGNER NOTES

CAMBER VALUES						
"Y" (IN.)						
"L"	"A"	32	30	28	26	24
30	4 1/8	3 1/2	2 7/8	2 3/8	2 1/8	1 7/8
28	3 3/4	3 1/4	2 3/4	2 1/4	1 3/4	1 3/4
26	3 3/8	3	2 1/2	2 1/8	1 3/4	1 3/4
24	3 3/8	2 7/8	2 3/8	2	1 3/4	1 3/4
22	3 1/8	2 5/8	2 1/4	1 7/8	1 1/2	1 1/2


"A" & "L" IN FT.
 INTERPOLATE FOR VALUES NOT SHOWN
 TABLES REFLECT CATWALK LOADING. FOR CAMBER VALUES WITHOUT CATWALK LOADING, MULTIPLY TABLE VALUES ABOVE AS FOLLOWS:
 MULTIPLY "Y" BY .72

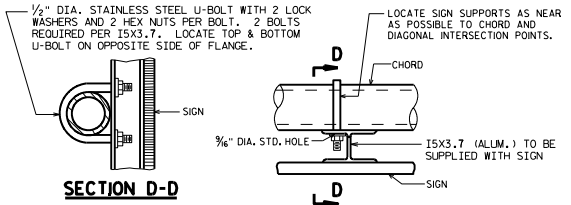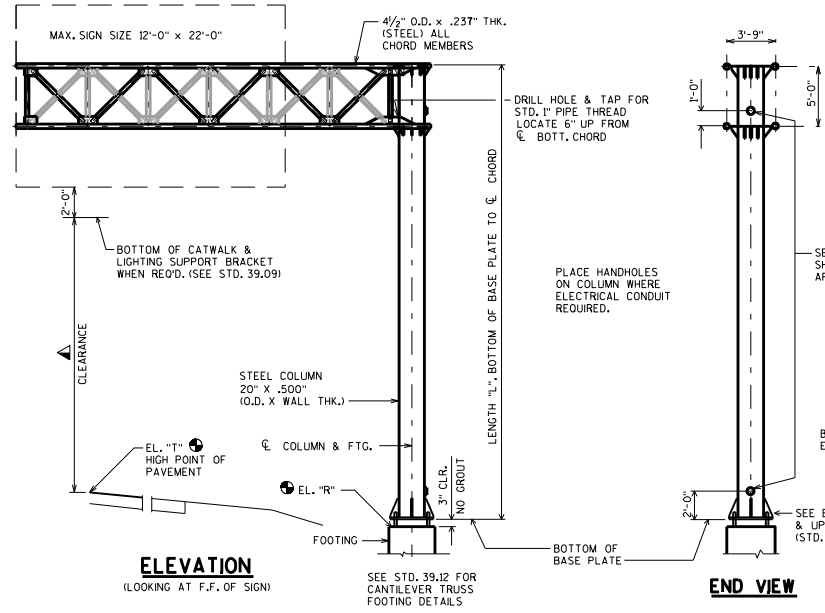

USE FOR TYPE I AND II SIGNS ONLY

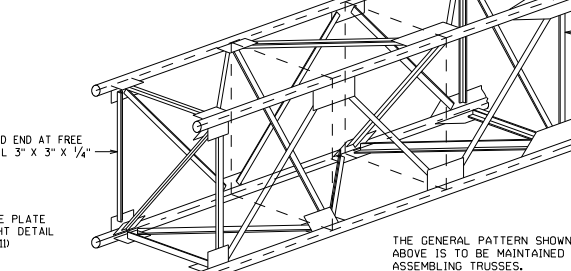

THE GENERAL PATTERN SHOWN ABOVE IS TO BE MAINTAINED WHEN ASSEMBLING TRUSSES.



STANDARDS 39.9, 39.11, 39.12 AND 39.13 DETAILS ARE USED WITH THIS STANDARD TO DETAIL A "GALVANIZED STEEL CANTILEVER SIGN TRUSS" FOR TYPE I AND II SIGNS ONLY.


GALVANIZED STEEL CANTILEVER SIGN TRUSS

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva DATE: 7-16

TOP DIAGONAL
L 3" x 3" x 1/4"


ANGLE SIZE	*WELD LENGTH (MIN.)
L 2 1/2" x 2 1/2" x 1/4"	7"
L 3" x 3" x 1/4"	8"

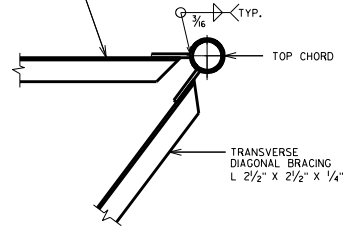

SECTION B-B

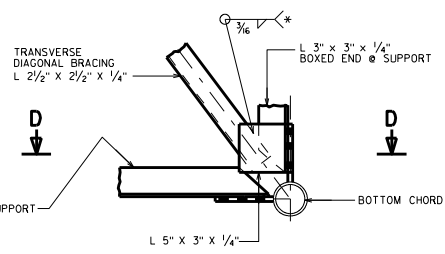

SECTION C-C

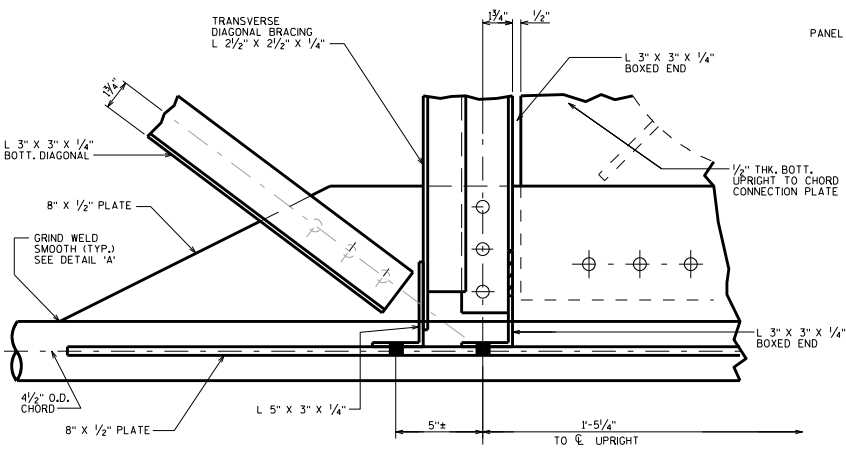


SECTION D-D


(LOOKING DOWN @ BOTT. HORIZ. PLANE @ FRONT CHORD)

← BOLTED OR OPTIONAL WELDED CONNECTION → BOLTED CONNECTION ONLY →


WELDED CONNECTIONS MAY BE USED IF UNIT CAN BE GALVANIZED IN ONE PIECE.

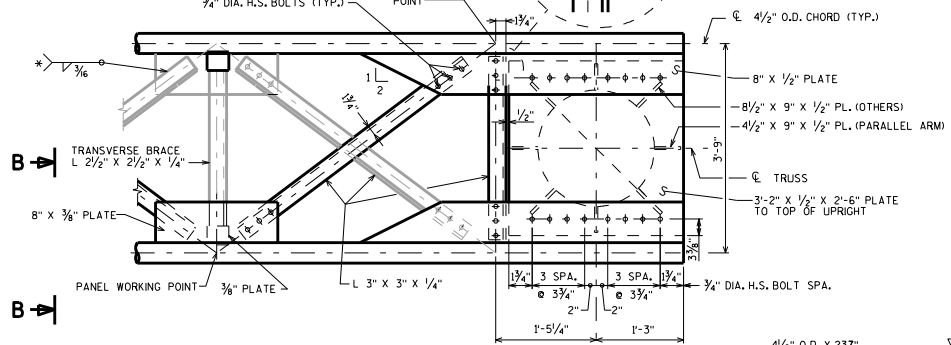



PLAN TRUSS TO UPRIGHT

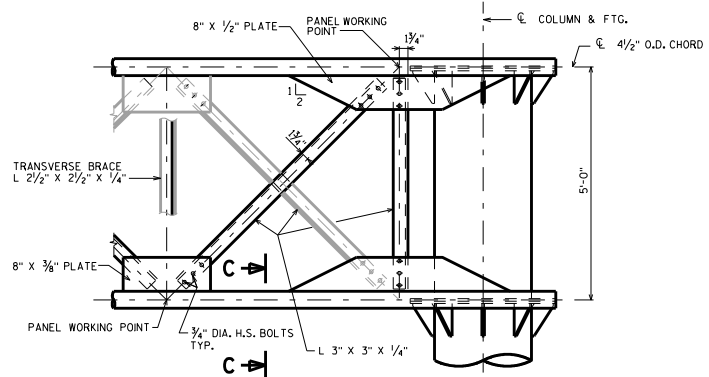

ELEVATION TRUSS TO UPRIGHT

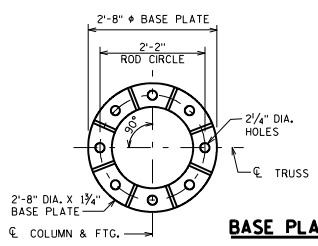


BASE PLATE DETAILS

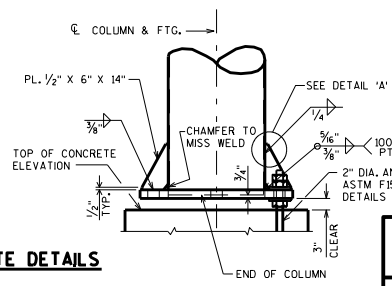


DETAIL 'A'

SEPARATE OPTIONAL SPLICE FROM GUSSET PLATES BY 6" MIN.



OPTIONAL COLUMN OR CHORD SPLICE DETAIL

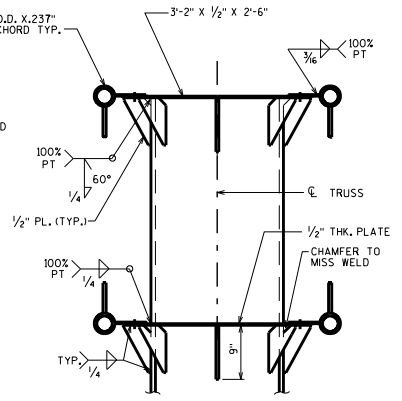


END VIEW TRUSS TO UPRIGHT

GALVANIZED STEEL CANTILEVER SIGN TRUSS DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

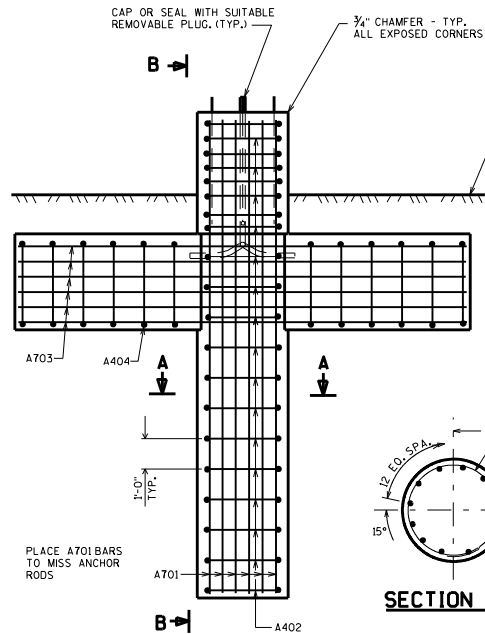

ELEVATION




SECTION A-A

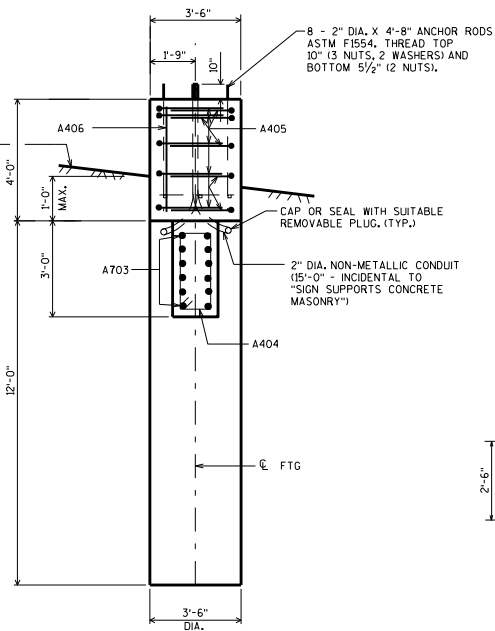


SECTION B-B



(SHOWING WING AND CAP STEEL ONLY)

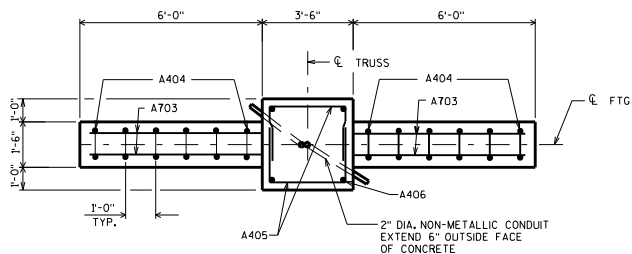

PLAN




TOP VIEW OF TOP & BOTTOM TEMPLATES

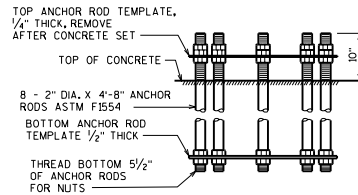


ANCHOR ROD DETAILS

BILL OF BARS


BAR MARK	Coat	NO. REQ'D	LENGTH	BEND	CUT. DIAG.	BUN. DLE	LOCATION
A701	X	12	15'-6"				FOOTING - COLUMN/TOP
A402	X	16	11'-2"	X			FOOTING - COLUMN/TOP
A703	X	12	15'-0"				FOOTING - WINGS
A404	X	12	7'-6"	X			FOOTING - WINGS
A405	X	10	7'-11"	X			FOOTING - TOP
A406	X	4	3'-6"				FOOTING - TOP - COLUMNS



A405



A402



A404
(STIRRUP)

NOTES

- DRAWINGS SHALL NOT BE SCALED.
- THE FIRST OR FIRST TWO DIGITS OF THE BAR MARK SIGNIFIES THE BAR SIZE.
- BAR STEEL REINFORCEMENT SHALL BE EMBEDDED 3" CLEAR UNLESS DETAILED OTHERWISE.
- BENDING DIMENSIONS ARE OUT TO OUT OF BAR.
- CENTER ANCHOR ROD ASSEMBLY TO MISS BAR STEEL REINFORCEMENT AND MAKE SURE IT IS PLUMB, MAINTAIN ANCHOR ROD PROJECTION ABOVE FOOTING AS DETAILED ON PLAN. ANCHOR ROD ASSEMBLY SHALL BE RIGIDLY SECURE IN POSITION DURING AND AFTER CONCRETE PLACEMENT. DO NOT WELD THE ANCHOR ROD.

ULTIMATE DESIGN STRESSES

- CONCRETE MASONRY $f'_c=3,500$ PSI
- BAR STEEL REINFORCEMENT, GRADE 60 $f_y=60,000$ PSI
- ANCHOR BOLTS ASTM F1554 $f_y=55,000$ PSI


FOUNDATION DATA

ALLOWABLE SOIL BEARING PRESSURE = 2T/5F


TOTAL ESTIMATED QUANTITIES (1 FTG.)

- SIGN SUPPORTS CONCRETE MASONRY 8 CY
- SIGN SUPPORTS STEEL REINFORCEMENT HS 990 LB

CANTILEVER TRUSS FOOTING	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

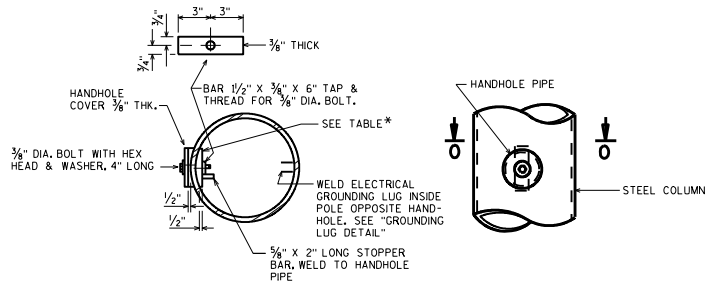


SECTION 0-0 HANDHOLE DETAILS

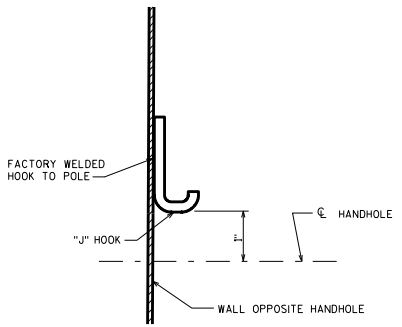

TYPICAL "J" HOOK LOCATION

THE "J" HOOK SHALL BE FACTORY WELDED TO THE INSIDE OF ALL COLUMNS CONTAINING ELECTRICAL WIRING. THE "J" HOOK SHALL BE ATTACHED ABOVE THE CENTERLINE OF THE UPPER HANDHOLE AND MOUNTED DIRECTLY OPPOSITE THE HANDHOLE AS SHOWN IN THE DRAWING.

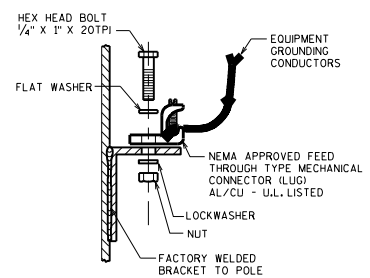

GROUNDING LUG DETAIL


NUT, BOLT AND WASHERS SHALL BE STAINLESS STEEL.

HANDHOLE NOTES

HANDHOLES SHALL BE LOCATED IN ONE COLUMN OF THE SIGN BRIDGE STRUCTURE IF ELECTRICALLY OPERATED DEVICES ARE INSTALLED ON/IN THE STRUCTURE. COLUMNS WITH HANDHOLES SHALL BE NEAR THE ELECTRICAL SERVICE. THE CONTRACTOR SHALL VERIFY THE LOCATION OF THE ELECTRICAL SERVICE ENTRANCE WITH THE REGION TRAFFIC SECTION PRIOR TO FABRICATION OF THE SIGN BRIDGE COLUMNS AND MEMBERS. CONDUIT (AS REQ'D) SHALL BE LOCATED, PLACED AND SIZED AS SHOWN ON THE ELECTRICAL PLAN DETAIL SHEETS.

UNLESS NOTED OTHERWISE, ALL HANDHOLE ELEMENTS TO BE GALVANIZED PER SECTION 641 OF THE WISDOT STANDARD SPECIFICATIONS.


* COLUMN SIZE O.D. X THK.	HANDHOLE PIPE O.D. X MIN. THK.
UP TO AND INCLUDING 16" X 0.375"	5.562" X 0.500"
GREATER THAN 16" X 0.375" TO AND INCLUDING 24" X 0.562"	6.625" X 0.562"

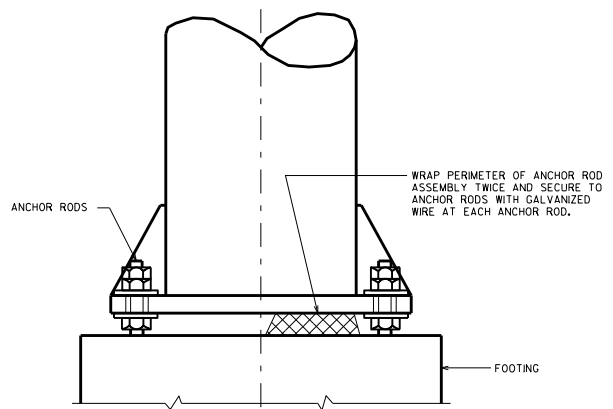

RODENT SCREEN
(ONLY REQ'D WHEN ELECTRICAL DEVICES ARE INSTALLED)

HANDHOLE DETAILS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

- ☐ "CLEANING PARAPETS" LIMITS
- ▲ "PIGMENTED SURFACE SEALER" LIMITS
- "PROTECTIVE SURFACE TREATMENT" LIMITS




PARAPET REPAIR DETAIL

502.3200	PROTECTIVE SURFACE TREATMENT	SY
502.3210	PIGMENTED SURFACE SEALER	SY
509.1500	CONCRETE SURFACE REPAIR	SF
509.9050.5	CLEANING PARAPETS	LF


DESIGNER NOTES

DETAILS MAY BE SHOWN ON PLANS IF NECESSARY FOR CLARITY.
INCLUDE APPLICABLE CONCRETE MASONRY BID ITEM TO FILL REPAIRS.

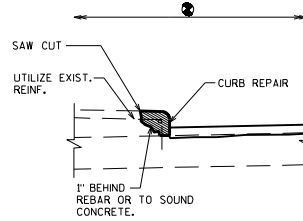

CURB REPAIR DETAIL

502.3200	PROTECTIVE SURFACE TREATMENT	SY
509.1200	CURB REPAIR	LF



NOTE

ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.2.12 OF THE STANDARD SPECIFICATIONS. (PROVIDE NOTE WHEN THE ADHESIVE ANCHOR BID ITEM IS NOT USED, BUT ARE ALLOWED AS AN ALTERNATIVE ANCHORAGE)

- ★ (CHOOSE ONE OF THE FOLLOWING AND PLACE ON PLAN)
- ADHESIVE ANCHORS X/X-INCH. EMBED X" IN CONCRETE.
- ADHESIVE ANCHORS X/X-INCH. EMBED X" IN CONCRETE. ANCHORS SHALL BE APPROVED FOR USE IN CRACKED CONCRETE.


ANCHOR DETAIL (EXAMPLE)

502.41..	ADHESIVE ANCHORS --INCH	EACH
502.42..	ADHESIVE ANCHORS NO. .BAR	EACH
505.0605	BAR STEEL REINFORCEMENT HS COATED STRUCTURES	LB

DESIGNER NOTES

THE DESIGN ENGINEER SHALL PROVIDE ANCHOR DETAILS AS NEEDED. PLANS SHALL INCLUDE ANCHOR "NOTES" WHEN ADHESIVE ANCHORS ARE USED.

ANCHOR DETAIL EXAMPLE APPLICABLE FOR ADHESIVE ANCHORS LOCATED IN UNCRACKED CONCRETE. SEE CHAPTER 40.16 FOR ADDITIONAL GUIDANCE.

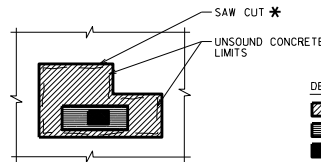


DECK REPAIR DETAIL - PLAN

FOR DESIGNER INFORMATION ONLY (DO NOT PLACE ON PLANS)


509.0301	PREPARATION DECKS TYPE 1	SY
509.0302	PREPARATION DECKS TYPE 2	SY
509.2000	FULL-DEPTH DECK REPAIR	SY
▲509.2500	CONCRETE MASONRY OVERLAY DECKS	CY
*SPV.0090	SAWING PAVEMENT DECK PREPARATION AREAS	LF

- DECK REPAIR LEGEND:**
- ▨ PREPARATION DECKS TYPE 1
 - ▩ PREPARATION DECKS TYPE 2
 - FULL-DEPTH DECK

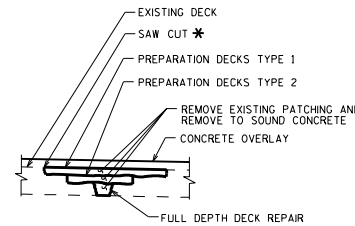

DECK REPAIR DETAIL - SECTION

FOR DESIGNER INFORMATION ONLY (DO NOT PLACE ON PLANS)



FULL-DEPTH DECK REPAIR DETAIL

FOR DESIGNER INFORMATION ONLY (DO NOT PLACE ON PLANS)

509.2000	FULL-DEPTH DECK REPAIR	SY
▲509.2500	CONCRETE MASONRY OVERLAY DECKS	CY
*SPV.0090	SAWING PAVEMENT DECK PREPARATION AREAS	LF

DESIGNER NOTES

DETAILS APPLICABLE TO ALL OVERLAY METHODS AND DECK REPAIRS WITHOUT OVERLAYS.

* "SAWING PAVEMENT DECK PREPARATION AREAS" NOT REQUIRED FOR CONCRETE OVERLAYS.

▲ USE "CONCRETE MASONRY DECK PATCHING" (SPV.0035) FOR DECK REPAIRS UNDER POLYMER, ASPHALTIC, OR POLYMER MOD. ASPHALTIC OVERLAYS. USE "CONCRETE MASONRY DECK PATCHING" FOR DECK REPAIRS WITHOUT OVERLAYS.


RESTRICTIONS ON REMOVAL ITEMS SHALL BE PLACED ON THE PLANS TO PREVENT DAMAGE TO REINFORCING STEEL.

CONCRETE REPAIR DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

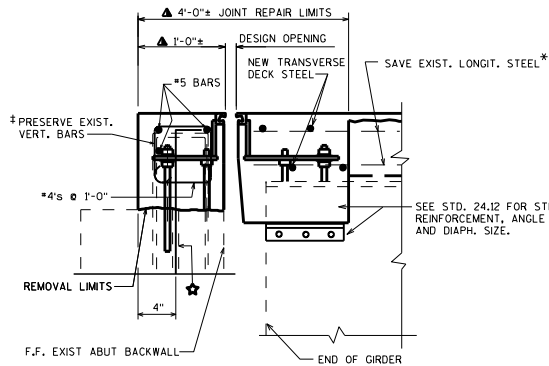


**SECTION THRU JOINT
STEEL GIRDER WITHOUT END DIAPHRAGM**


‡ EXISTING BARS ARE LIKELY TO BE CORRODED AND/OR DAMAGED DURING CONCRETE REMOVAL. PRESERVE AND INCORPORATE AS MUCH REBAR AS PRACTICAL. SUPPLEMENT WITH THE BARS INDICATED BY ★.

★ ADHESIVE ANCHORS NO. 5 BAR, EMBED 1'-6" IN CONCRETE. SPACE AT 1'-0". TURN 10" LEG AS NECESSARY TO FIT.

ALL REPLACEMENT PAVING BLOCK DIMENSIONS SHALL MATCH EXISTING PLAN DIMENSIONS UNLESS DESIGNER DETERMINES OTHERWISE, TYP. FOR ALL SECTIONS SHOWN ON THIS STANDARD.

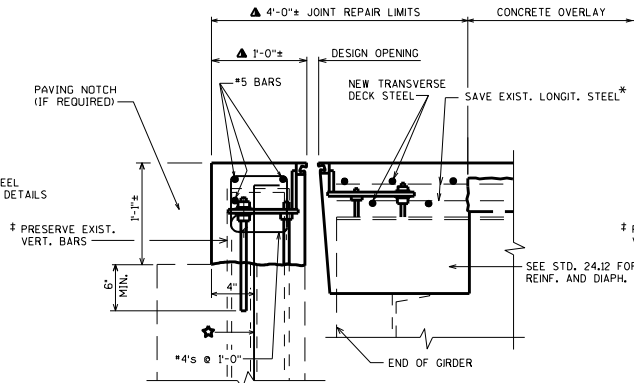


**SECTION THRU PROPOSED JOINT
STEEL GIRDER WITH END DIAPHRAGM
CONCRETE OVERLAY**

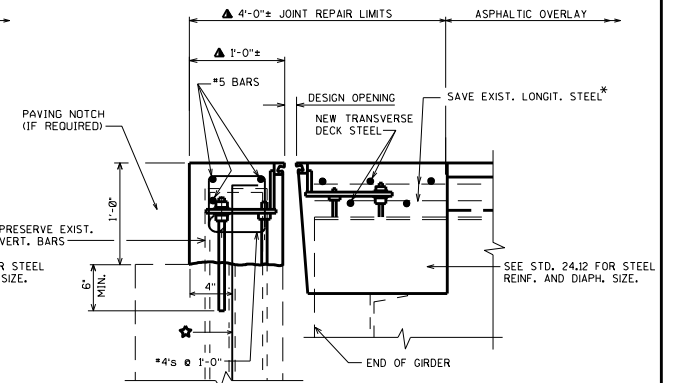


**SECTION THRU PROPOSED JOINT
STEEL GIRDER WITH END DIAPHRAGM
ASPHALTIC OVERLAY**

TOTAL ESTIMATED QUANTITIES


BID ITEMS	UNIT
JOINT REPAIR	SY
EXPANSION DEVICE B-1-	1LS
BAR STEEL REINFORCEMENT HS COATED STRUCTURES	LB

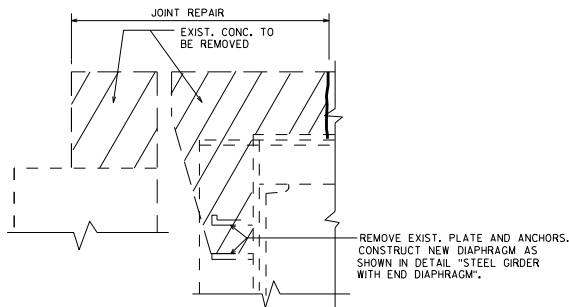

**JOINT REPAIR-REMOVAL
STEEL GIRDER**

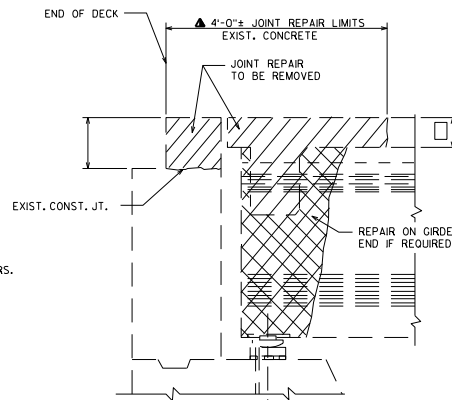

**JOINT REPAIR-REMOVAL
SECTION THRU JOINT-PRESTRESSED GIRDER**

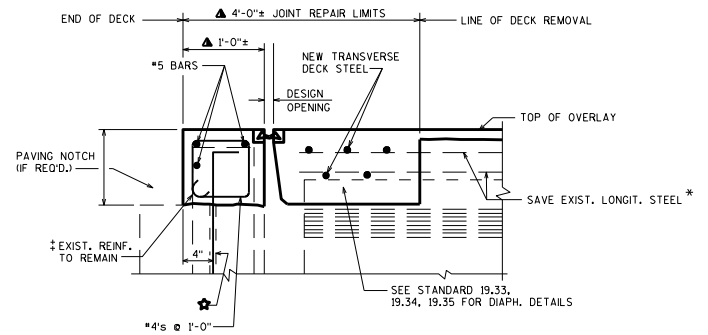

▲ DIMENSIONS GIVEN ARE NORMAL TO C. OF SUBSTRUCTURE UNIT. INCORPORATE EXISTING REINFORCEMENT

SEE STANDARD 28.01 FOR SUPPORTS USED WITH STRIP SEAL - STEEL EXTRUSIONS.


* FOR SKEWS > 20°, WHERE ORIGINAL TRANSVERSE DECK REINFORCEMENT WAS PLACED NORMAL TO THE GIRDERS, SAVE AND INCORPORATE 1'-6" MIN. OF TRANSVERSE REINFORCING BARS.

**STRIP SEALS & DIAPH.
DETAILS FOR OVERLAYS**


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

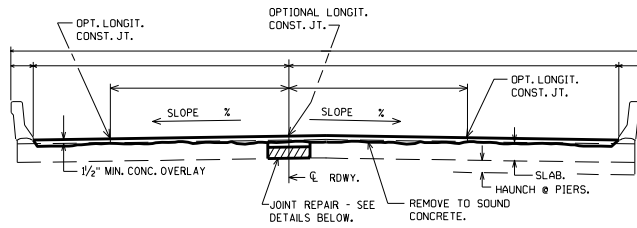


CROSS SECTION THRU ROADWAY LOOKING EAST

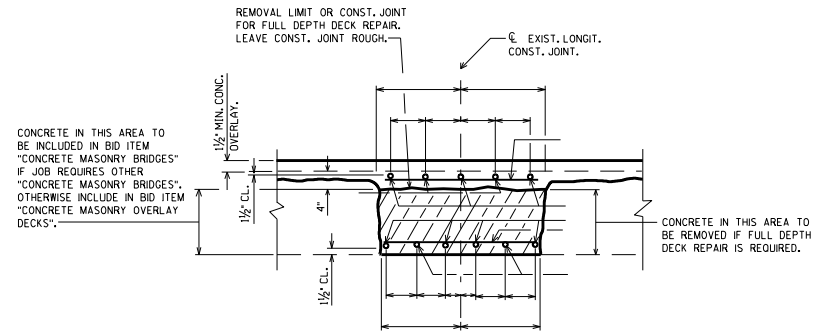

TYP. SECTION THRU JOINT

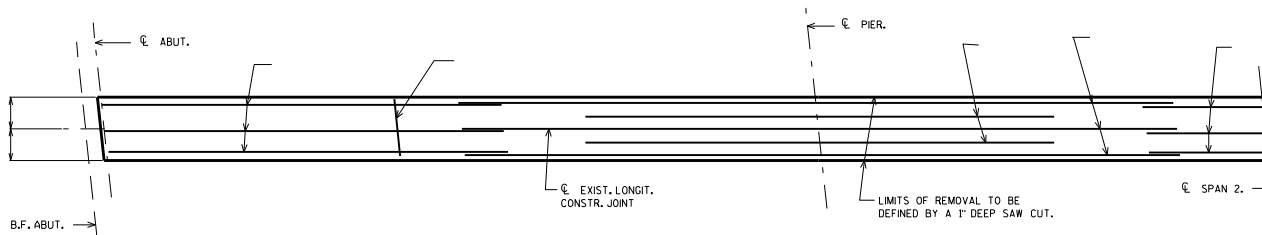


HALF PLAN SHOWING TOP BAR STEEL REINF.

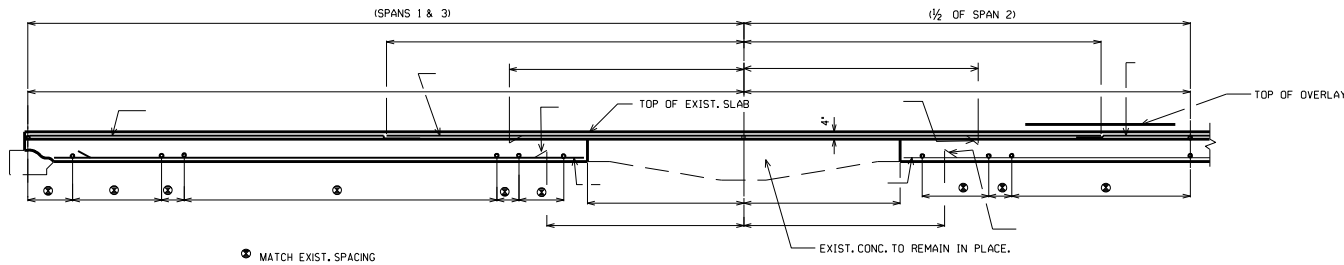

HALF LONGIT. SECTION

TOTAL ESTIMATED QUANTITIES


BID ITEMS	
JOINT REPAIR	SY
BAR STEEL REINFORCEMENT HS COATED STRUCTURES	LB
CONCRETE MASONRY BRIDGES	CY
CONCRETE MASONRY OVERLAY DECKS	CY

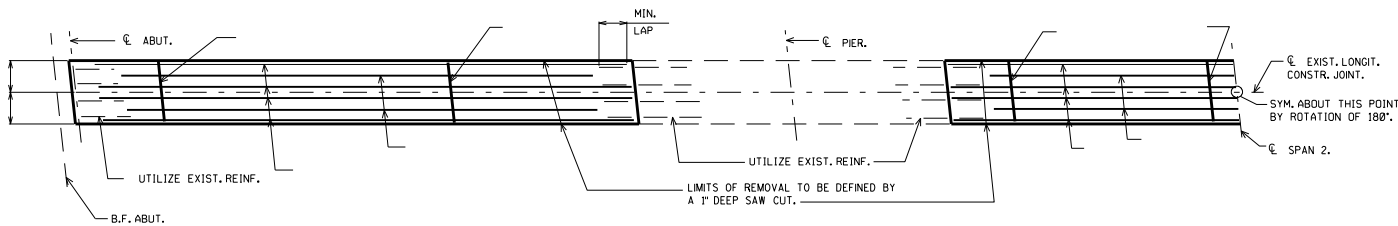


HALF PLAN SHOWING BOTTOM BAR STEEL REINF

(REQUIRED ONLY FOR FULL DEPTH DECK REPAIR)


LONGIT. CONST. JOINT REPAIRS	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

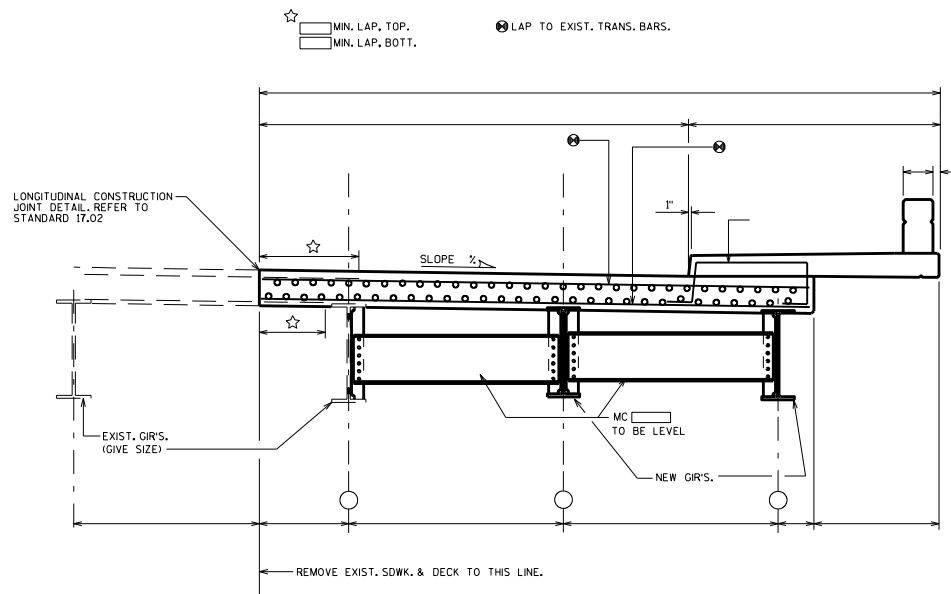

CROSS SECT. THRU RDWY.

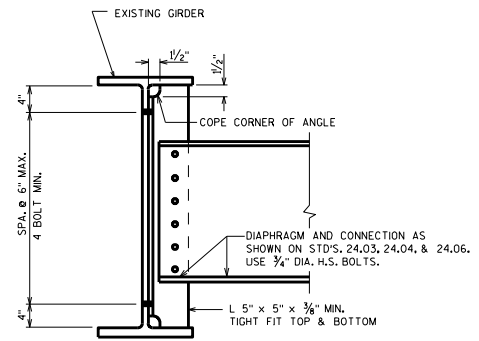


DIAPHRAGM CONNECTION TO EXISTING STEEL GIRDER

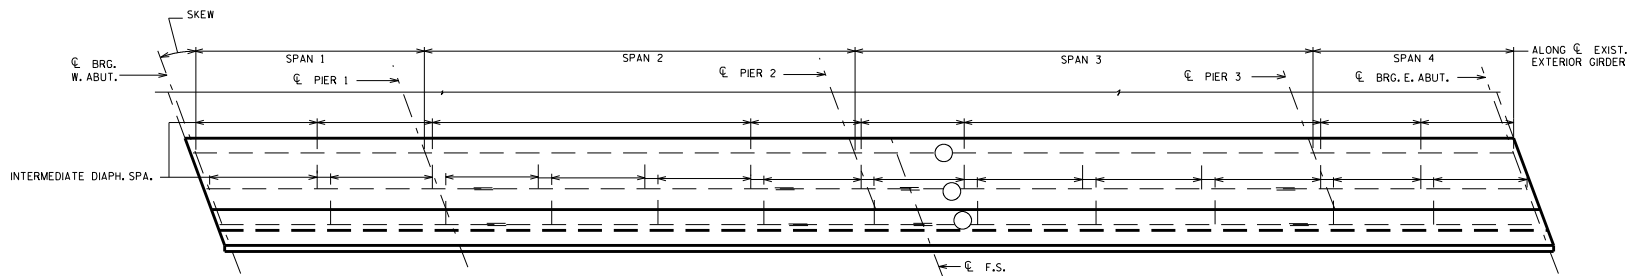


PLAN

SLAB WIDENING	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

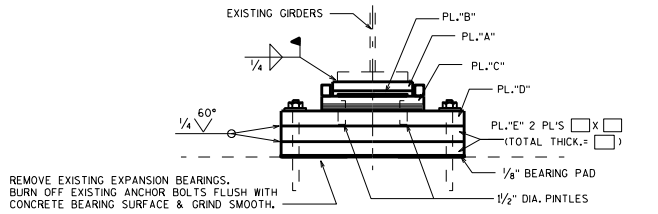

FRONT ELEVATION

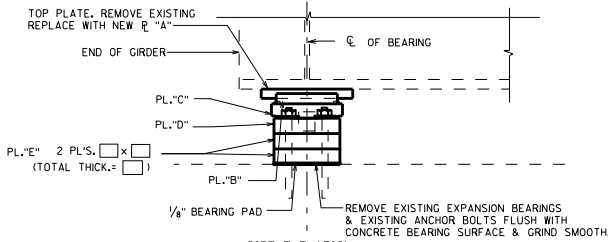

SIDE ELEVATION

EXPANSION BEARING REPLACEMENT - STEEL GIRDERS
STEEL BEARINGS

SEE STANDARD 27.08 FOR BEARING DETAILS



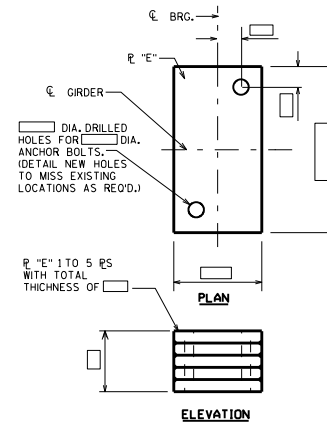


PLATE 'E' DETAILS

(SEE STD. 40.10 FOR CONCRETE BLOCK ALTERNATE)

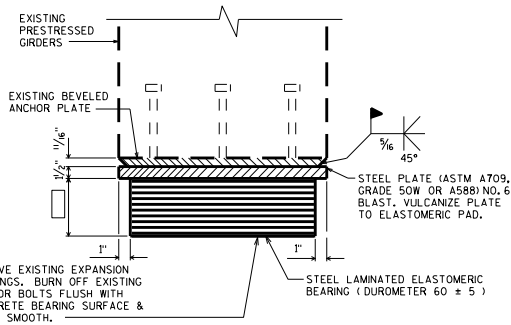


FRONT ELEVATION

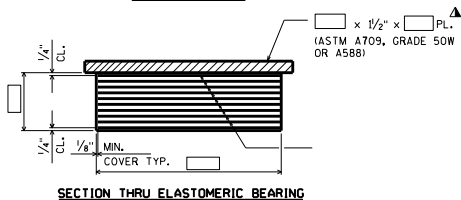

SECTION THRU ELASTOMERIC BEARING

EXPANSION BEARING REPLACEMENT - PRESTRESSED GIRDERS
ELASTOMERIC BEARINGS

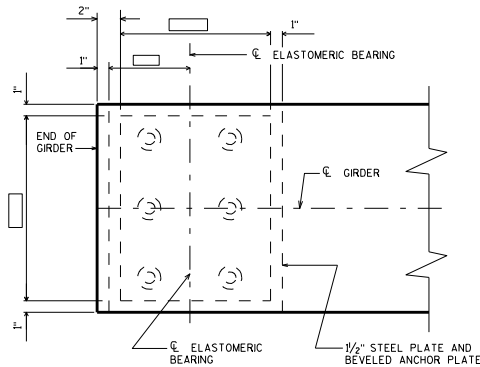

NOTES

ALL MATERIAL USED FOR BEARINGS SHALL BE PAID AT THE UNIT PRICE BID FOR "BEARING PADS ELASTOMERIC LAMINATED."

GRIND EXIST. WELD THAT ATTACHED EXIST. TOP PLATE TO EXIST. BOT. FLANGE. GRIND AFFECTED AREAS SMOOTH.

DESIGNER NOTES


THE STEEL TOP PLATE THICKNESS MAY BE REDUCED (1" MIN.) TO MATCH THE OVERALL EXISTING BEARING HEIGHT. WHEN THE THICKNESS IS REDUCED, THE FOLLOWING NOTE SHALL BE LOCATED ON THE PLANS:

"WELDING PROCEDURES SHALL BE ESTABLISHED BY THE CONTRACTOR TO RESTRICT THE MAXIMUM TEMPERATURE REACHED BY SURFACES IN CONTACT WITH ELASTOMER TO 200°F (93°C). TEMPERATURES SHALL BE CONTROLLED BY TEMPERATURE INDICATING WAX PENCILS OR OTHER SUITABLE MEANS APPROVED BY THE ENGINEER."


▲ CHECK 27.2.1 ELASTOMERIC BEARINGS IN THE BRIDGE MANUAL FOR REQUIREMENTS TO SEE IF THIS PLATE SHOULD BE OMITTED.

TOP STEEL PLATE MAY NOT BE OMITTED.

SEE STANDARD 27.07 FOR ADDITIONAL INFORMATION.

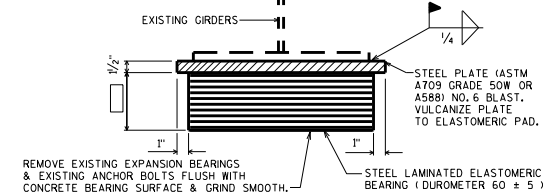

FRONT ELEVATION

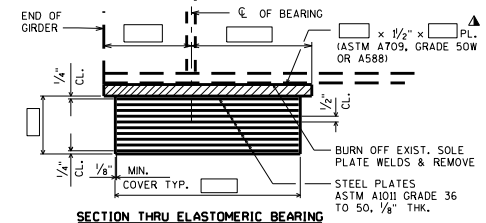

SECTION THRU ELASTOMERIC BEARING

EXPANSION BEARING REPLACEMENT - STEEL GIRDERS
ELASTOMERIC BEARINGS

NOTES & DESIGNER NOTES


SEE "EXPANSION BEARING REPLACEMENT - PRESTRESSED GIRDERS" ON THIS STANDARD.

EXPANSION BEARING REPLACEMENT DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16

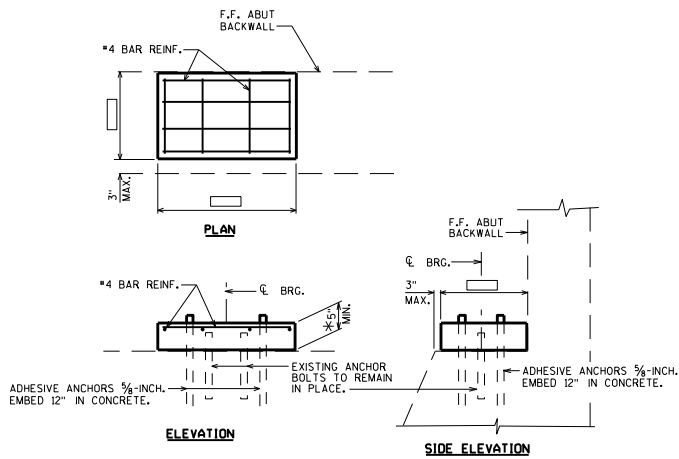

CONCRETE BEARING BLOCK DETAILS

(MAY BE USED IN LIEU OF PLATE 'E' AS SHOWN ON STD. 40.08)

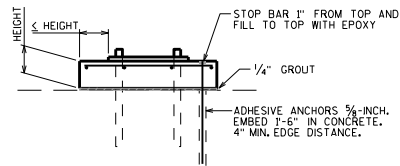

PRECAST CONCRETE BLOCK DETAIL

DEPTH = MIN. 5", MAX. 1'-0" *


ANCHOR IN AT LEAST 4 LOCATIONS (ANCHORS INCLUDE ADHESIVE ANCHORS, ANCHOR BOLTS OR COMBINATION).

GROUT 1/4" BENEATH PRECAST ELEMENT - ELIMINATE STRESS CONCENTRATION AND REDUCE CRACKING.

PRECAST BLOCK (OR ANY CONCRETE BLOCK) MUST EXTEND BEYOND BEARING A DISTANCE EQUAL TO, OR GREATER THAN, THE HEIGHT OF THE CONCRETE BLOCK *. THIS IS TO ACCOUNT FOR 45-DEGREE DOWNWARD AND OUTWARD STRESS DISTRIBUTION. THIS PROVISION CAN BE DISREGARDED IF A FULL-DEPTH CONCRETE DIAPHRAGM IS USED IN CONJUNCTION WITH A 1/2" THICK ELASTOMERIC PAD (FIXED SEAT).

REINFORCEMENT SHOULD BE IN BOTH DIRECTIONS UTILIZING #4 @ 1'-0" MAXIMUM SPACING.

BURN EXISTING ANCHOR BOLTS OFF FLUSH WITH BEAM SEAT.

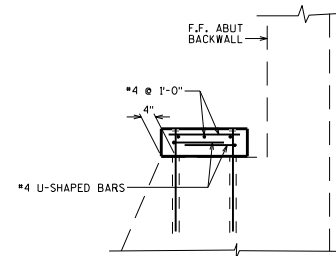

* ALTERNATE DETAIL

TO BE USED FOR CASES WHERE HEIGHT EXCEEDS 1'-0" OR INSUFFICIENT EDGE DISTANCE (PRECAST OPTION SHOWN)


CONCRETE BEARING BLOCK DETAILS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION


APPROVED: Bill Oliva

DATE:
7-16


STANDARD 40.10

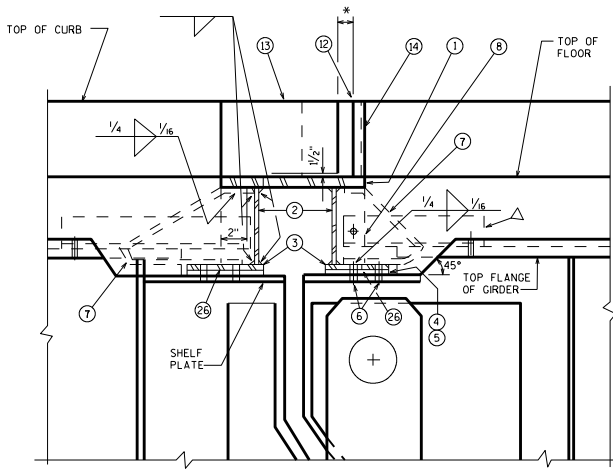


SECTION THRU JOINT
MUD PLATES NOT SHOWN

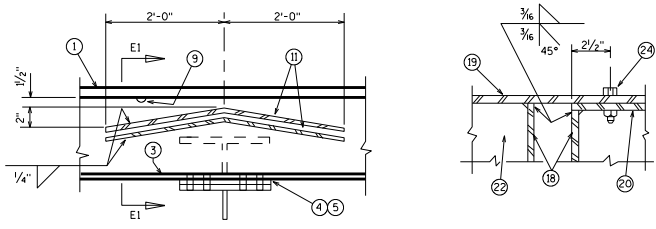


SECTION THRU MUD PLATES
TYPICAL ALL GIRDERS



SECTION E1

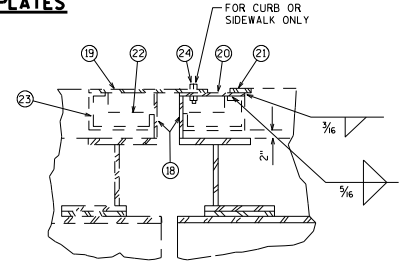


SECTION A-A

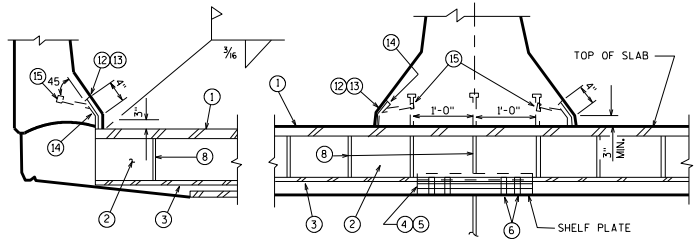


DETAIL AT PARAPET

DETAIL AT MEDIAN

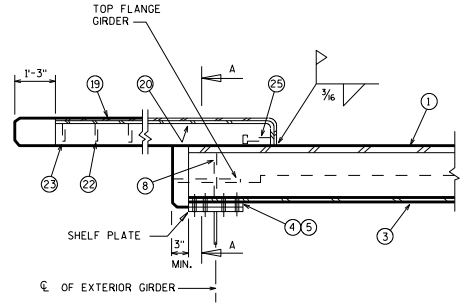


SECTION THRU SIDEWALK

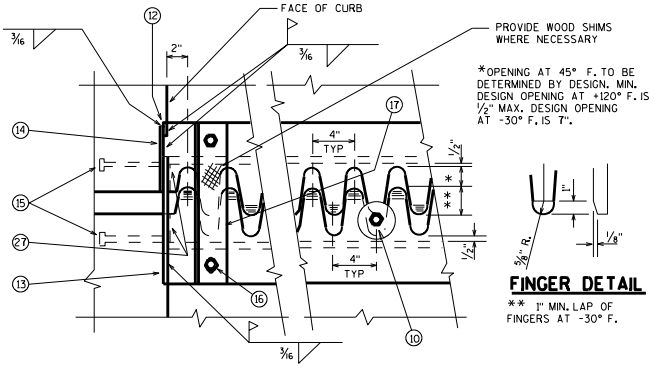

PART PLAN OF FINGER PLATE AT BRUSH CURB
NO SKEW

FINGER DETAIL
** 1" MIN. LAP OF FINGERS AT -30° F.

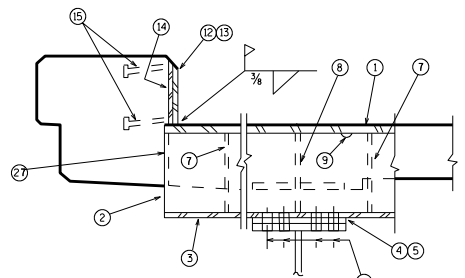

SECTION THRU JOINT AT BRUSH CURB

MUD PLATES NOT SHOWN
△ ANGLE 3/4" x 3/4" x 3/4" FIELD DRILL 3/4" DIA. ERECTION BOLT HOLES OR WELD TO STIFFENER OR TOP FLG.

LEGEND

1. FINGER PLATE. SIZE TO BE DETERMINED BY DESIGN.
2. WEB PLATE. SIZE TO BE DETERMINED BY DESIGN.
3. FLANGE PLATE. SIZE TO BE DETERMINED BY DESIGN.
4. BEVELED SHIM PLATE 3/8" THICK. 1/8" DIA. HOLES FOR NO. 6.
5. 3/4" LAMINATED SHIM WITH SLOTTED OPENINGS
6. 3/4" DIA. ERECTION BOLTS. DRILL HOLES IN SHELF PLATE IN THE FIELD.
7. ANCHOR BAR 5/8" DIA. AT 1'-0" CENTERS. BEND AS SHOWN.
8. STIFFENER BAR 3/8" THICK. 1/2" FILLET WELD ALL AROUND. PLACE AT C/L OF GIRDER AND AT +2'-0" CENTERS BETWEEN GIRDERS.
9. 1/4" VENT HOLES AT 3'-0" CENTERS.
10. 3/4" DIA. ADJUSTING BOLT AT APPROX. 4'-0" CENTERS WITH TWO 3/8" DIA. X 3/8" PLATE WASHERS. ONE ON EACH SIDE OF FINGER PLATE.
11. MUD PLATE 1/4" THICK
12. 3/8" PLATE. BEND AS SHOWN.
13. 3/8" PLATE BEND AS SHOWN.
14. 3/8" PLATE BEND AS SHOWN.
15. 3/8" DIA. STUDS X 6 5/16" LONG. WELD TO PLATES NO. 13 AND NO. 14.
16. 3/4" DIA. BOLT FOR SHIPPING. TACK WELD NUT TO BOTTOM OF PLATE NO. 1.
17. 3" DIA. X 3" DIA. X 1/4" + 5'-0" SPACING. SLOTTED HOLE 1/8" X 2 3/8" IN ONE END OF ANGLE AS SHOWN. FOR BOLT NO. 16.
18. CLOSING PLATE 3/8" CUT AS SHOWN. SEE WELD DETAIL
19. 3/8" PLATE. BEND AS SHOWN.
20. 3/8" PLATE. BEND AS SHOWN.
21. 3/8" PLATE. BEND AS SHOWN.
22. 3/8" PLATE. WELD ALL AROUND. 1/4" FILLET WELD TO PLATES NO. 18, 19, & 20.
23. 3/8" DIA. STUDS X 6 5/16" LONG. BEND AFTER WELD.
24. 3/4" DIA. BOLT WITH SO. NUT. GREASE FOR EASY REMOVAL. 1/8" X 1 1/4" SLOTTED HOLE IN PL. NO. 19. LONG DIMENSION OF HOLE PARALLEL TO C/L OF ROADWAY. TACK WELD NUT TO PLATE NO. 20 + 2'-0" SPA.
25. 3/8" DIA. STUDS X 6 5/16" LONG. WELD TO PLATE NO. 20.
26. FLANGE PLATE. SAME THICKNESS AS PLATE NO. 3 AND SAME WIDTH AS SHELF PLATE. SHOP BUTT WELD TO PLATE NO. 3.
27. 3/8" CLOSING PLATE. WELD TO PLATES NO. 1 AND NO. 2.

NOTES

REMOVE ANGLE NO. 17 AND ADJUSTING BOLT NO. 10 AFTER VERTICAL AND HORIZONTAL ALIGNMENT IS SECURE IN FIELD. FILL HOLES WITH HOT POURED JOINT SEALER.
IN SOME CASES THE GIRDER FLANGES AND WEB PLATES DO NOT HAVE TO BE CUT TO ACCOMMODATE THE FINGER JOINT SECTION, THE SLAB DEPTH MAY BE UTILIZED EFFECTIVELY.

FINGER TYPE EXPANSION JOINT - PLATE GIRDER	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

PRE-TENSION

$f'_s = 270,000$ P.S.I.
 $f_s = 0.75 \times 270,000 = 202,500$ P.S.I. for low relaxation strands.
 P_i PER 0.5" DIA. STRAND = $0.1531 \times 202,500 = 31.00$ KIPS
 P_i PER 0.6" DIA. STRAND = $0.217 \times 202,500 = 43.94$ KIPS

(5)

$$\frac{y_B}{r^2} = \frac{-24.73}{330.46} = -0.07484 \text{ IN./IN.}^2$$

$$f_B (\text{Init.}) = \frac{(4)}{(3)} \left(\frac{K}{\text{Sq. In.}} \right)$$

54" GIRDER

$A = 789$ SQ. IN.
 $r^2 = 330.46$ IN.²
 $y_T = 29.27$ IN.
 $y_B = -24.73$ IN.
 $I = 260,730$ IN.⁴
 $S_T = 8,908$ IN.³
 $S_B = -10,543$ IN.³
 WT. = 822 #/FT.

(COMPRESSION IS POSITIVE)



N	(1)	(2)	(3)	(4)	(5)	(5)
NO.	e_s	$(1 + \frac{e_s y_B}{r^2})$	$(A/(2))$	$P(\text{Init.}) = A_s f_s$	$P(\text{Init.}) = A_s f_s$	$f_B (\text{Init.}) = (4)/(3)$
STRANDS	(inches)		(sq. in.)	0.5" DIA. STRANDS (KIPS)	0.6" DIA. STRANDS (KIPS)	0.5" DIA. STRANDS (K/Sq. In.)

STANDARD PATTERNS FOR UNDRAPED STRANDS





16	-20.23	2.514	313.84	496	703	1.580	2.240
18	-19.84	2.485	317.51	558	791	1.757	2.491
20	-19.13	2.432	324.42	620	879	1.911	2.709
22	-18.37	2.375	332.21	682	967	2.053	2.911
24	-17.55	2.313	341.12	744	1055	2.181	3.093
26	-17.18	2.286	345.14	806	1143	2.335	3.312
28	-17.02	2.274	346.97	868	1230	2.502	3.545
30	-16.33	2.222	355.09	930	1318	2.619	3.712
32	-16.23	2.215	356.21	992	1406	2.785	3.947
34	-15.54	2.163	364.77	1054	1494	2.889	4.096
36	-15.50	2.160	365.28	1116	1582	3.055	4.331

STANDARD PATTERNS FOR DRAPED STRANDS

16	-22.23	2.664	296.17	496	703	1.675	2.374
18	-21.84	2.634	299.54	558	791	1.863	2.641
20	-21.73	2.626	300.46	620	879	2.064	2.926
22	-21.64	2.619	301.26	682	967	2.264	3.210
24	-21.57	2.614	301.84	744	1055	2.465	3.495
26	-21.19	2.586	305.10	806	1143	2.642	3.746
28	-21.16	2.584	305.34	868	1230	2.843	4.028
30	-20.99	2.571	306.88	930	1318	3.031	4.295
32	-20.85	2.560	308.20	992	1406	3.219	4.562
34	-20.73	2.551	309.29	1054	1494	3.408	4.830
36	-20.39	2.526	312.35	1116	1582	3.573	5.065
38	-20.31	2.520	313.10	1178	1670	3.762	5.334
40	-20.23	2.514	313.84	1240	1758	3.951	5.602
42	-20.06	2.501	315.47	1302	1846	4.127	5.852
44	-19.91	2.490	316.87	1364	1933	4.305	6.100
46	-19.60	2.467	319.82	1426		4.459	
48	-19.48	2.458	320.99	1488		4.636	
50	-19.37	2.450	322.04	1550		4.813	
52	-19.19	2.436	323.89	1612		4.977	
54	-19.03	2.424	325.50	1674		5.143	

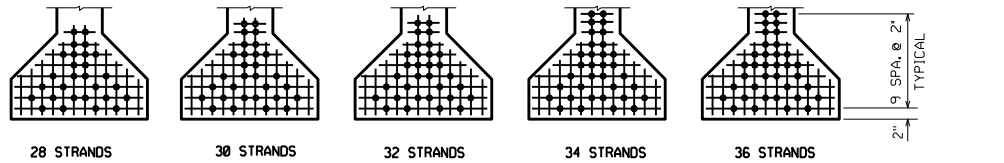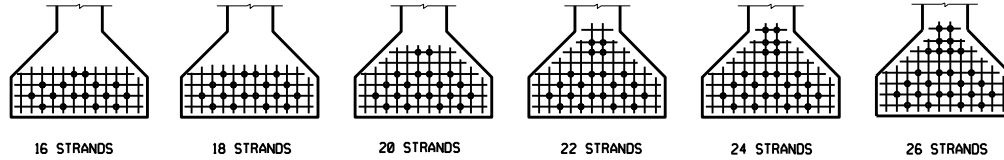

STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.5" DIA. AND 0.6" DIA. STRANDS

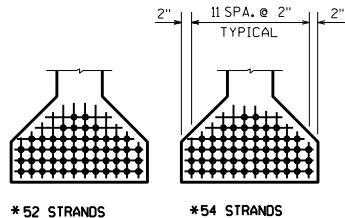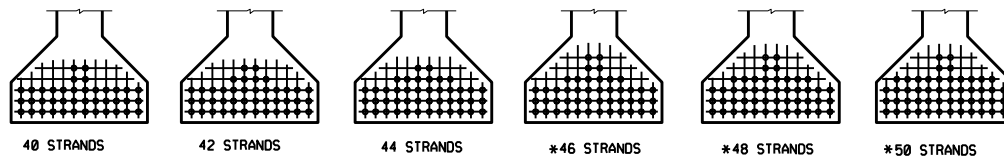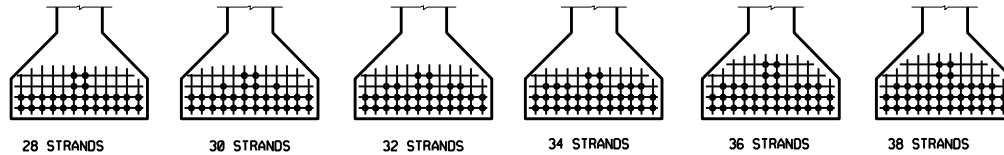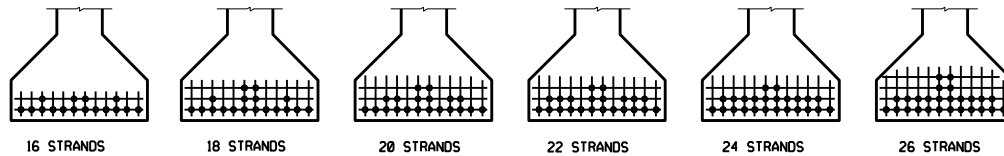

ARRANGEMENT AT C/SPAN - FOR GIRDERS WITH DRAPED 0.5" DIA. AND 0.6" DIA. STRANDS


*0.5" DIA. STRANDS ONLY

54" PRETENSIONED GIRDER DESIGN DATA

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE: 7-16

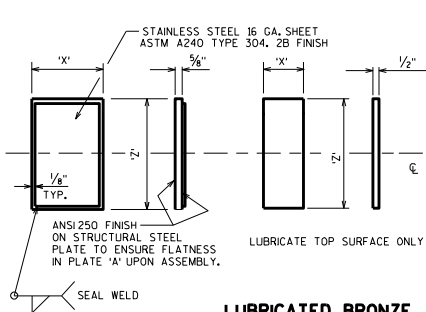


TOP PLATE "A"

LUBRICATE TOP SURFACE ONLY


LUBRICATED BRONZE

PLATE "B"

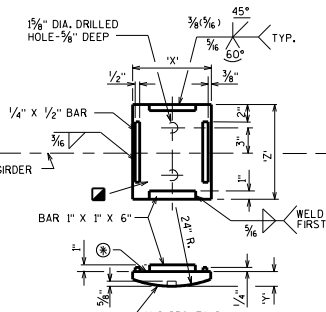


ROCKER PLATE "C"

☑ PROVIDE A METHOD FOR HANDLING PLATE "C" DURING GALVANIZING.

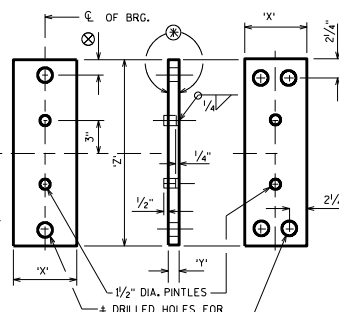

MASONRY PLATE "D"

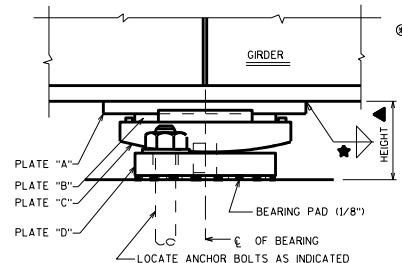

EXPANSION BEARING ASSEMBLY

NOTES

- FOR BEARING NOTES, CLEARANCE DIAGRAM, AND WHEN TO BEVEL ROCKER PLATES, SEE STANDARD 27.02.
- FINISH THESE SURFACES ANS1250 IF DIMENSION "Y" IS GREATER THAN 2".
- ANCHOR BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AS REQUIRED BY ASTM DESIGNATION A153, CLASS "C". PLATE "C" & "D" SHALL BE GALVANIZED. FOR UNPAINTED STRUCTURES PLATE "C" & "D" SHALL BE SHOP PAINTED AFTER GALVANIZING. PLATE "A" SHALL BE SHOP PAINTED. USE WELDABLE PRIMER ON PLATE "A".
- AT ABUTMENTS WHEN THE "X" DIMENSION OF PLATE "A" EXCEEDS 12" INCREASE STANDARD DISTANCE FROM CL OF BRG. TO END OF GIRDER.
- ALL MATERIAL INCLUDING SHIMS, BUT EXCLUDING STAINLESS STEEL SHEET, BRONZE PLATE, PINTLES, ANCHOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO ASTM A709 GRADE 50W.
- WELD SIZE, REFER TO STANDARD 24.2.
- ADJUST HEIGHT IF TAPERED BEARINGS ARE REQUIRED.
- FABRICATOR MAY INCREASE PLATE "A" OR PLATE "D" THICKNESS AS AN ALTERNATE TO SHIMS.
- DIMENSION IS 2" WHEN 1/2" DIA. ANCHOR BOLTS ARE USED AND 2 1/4" WHEN 1/2" DIA. ANCHOR BOLTS ARE USED.

FOR NEW OR REPLACEMENT STEEL BEARINGS, INCLUDING STEEL BEARINGS USED FOR BRIDGE WIDENINGS, USE TYPE "A-T" AS SHOWN ON STANDARD 27.08. THIS STANDARD IS FOR INFORMATIONAL PURPOSES ONLY.

10" BEARING

CAP. KIPS	PLATE A		PLATE B		PLATE C		PLATE D		HEIGHT FEET		
	X	Z	X	Z	X	Y	Z	X		Y	Z
75	9"	10"	5"	10"	7"	1 1/4"	1'-0 1/4"	8"	1 1/2"	1'-8"	.354
105	11"	10"	7"	10"	9"	1 1/4"	1'-0 1/4"	8"	1 1/2"	1'-8"	.375
135	1'-1"	10"	9"	10"	11"	1 1/4"	1'-0 1/4"	8"	1 1/2"	1'-8"	.396
160	1'-3"	10"	11"	10"	1'-1"	2 3/8"	1'-0 1/4"	9"	1 1/2"	1'-8"	.432
190	1'-5"	10"	1'-1"	10"	1'-3"	2 7/8"	1'-0 1/4"	10"	1 3/4"	1'-8"	.495
220	1'-7"	10"	1'-3"	10"	1'-5"	3 1/8"	1'-0 1/4"	1'-0"	2"	1'-8"	.599
250	1'-9"	10"	1'-5"	10"	1'-7"	3 5/8"	1'-0 1/4"	1'-1"	2 3/8"	1'-8"	.630
280	1'-11"	10"	1'-7"	10"	1'-9"	4 1/8"	1'-0 1/4"	1'-3"	2 7/8"	1'-8"	.755
310	2'-1"	10"	1'-9"	10"	1'-11"	4 5/8"	1'-0 1/4"	1'-4"	2 7/8"	1'-8"	.755

12" BEARING

CAP. KIPS	PLATE A		PLATE B		PLATE C		PLATE D		HEIGHT FEET		
	X	Z	X	Z	X	Y	Z	X		Y	Z
90	9"	1'-0"	5"	1'-0"	7"	1 1/4"	1'-2 1/4"	8"	1 1/2"	1'-10"	.354
125	11"	1'-0"	7"	1'-0"	9"	1 1/4"	1'-2 1/4"	8"	1 1/2"	1'-10"	.375
160	1'-1"	1'-0"	9"	1'-0"	11"	1 1/4"	1'-2 1/4"	8"	1 1/2"	1'-10"	.396
195	1'-3"	1'-0"	11"	1'-0"	1'-1"	2 3/8"	1'-2 1/4"	9"	1 1/2"	1'-10"	.432
230	1'-5"	1'-0"	1'-1"	1'-0"	1'-3"	2 7/8"	1'-2 1/4"	11"	2"	1'-10"	.516
265	1'-7"	1'-0"	1'-3"	1'-0"	1'-5"	3 1/8"	1'-2 1/4"	1'-1"	2 3/8"	1'-10"	.630
300	1'-9"	1'-0"	1'-5"	1'-0"	1'-7"	3 5/8"	1'-2 1/4"	1'-2"	2 3/8"	1'-10"	.630
335	1'-11"	1'-0"	1'-7"	1'-0"	1'-9"	4 1/8"	1'-2 1/4"	1'-4"	2 7/8"	1'-10"	.755
370	2'-1"	1'-0"	1'-9"	1'-0"	1'-11"	4 5/8"	1'-2 1/4"	1'-5"	2 7/8"	1'-11"	.755

14" BEARING

CAP. KIPS	PLATE A		PLATE B		PLATE C		PLATE D		HEIGHT FEET		
	X	Z	X	Z	X	Y	Z	X		Y	Z
105	9"	1'-2"	5"	1'-2"	7"	1 1/4"	1'-4 1/4"	8"	1 1/2"	2'-0"	.354
145	11"	1'-2"	7"	1'-2"	9"	1 1/4"	1'-4 1/4"	8"	1 1/2"	2'-0"	.375
185	1'-1"	1'-2"	9"	1'-2"	11"	1 1/4"	1'-4 1/4"	8"	1 1/2"	2'-0"	.396
225	1'-3"	1'-2"	11"	1'-2"	1'-1"	2 3/8"	1'-4 1/4"	10"	1 3/4"	2'-0"	.453
270	1'-5"	1'-2"	1'-1"	1'-2"	1'-3"	2 7/8"	1'-4 1/4"	1'-0"	2"	2'-0"	.516
310	1'-7"	1'-2"	1'-3"	1'-2"	1'-5"	3 1/8"	1'-4 1/4"	1'-1"	2 3/8"	2'-0"	.630
350	1'-9"	1'-2"	1'-5"	1'-2"	1'-7"	3 5/8"	1'-4 1/4"	1'-3"	2 7/8"	2'-1"	.672
390	1'-11"	1'-2"	1'-7"	1'-2"	1'-9"	4 1/8"	1'-4 1/4"	1'-4"	2 7/8"	2'-1"	.755
435	2'-1"	1'-2"	1'-9"	1'-2"	1'-11"	4 5/8"	1'-4 1/4"	1'-6"	3 1/8"	2'-1"	.838

16" BEARING

CAP. KIPS	PLATE A		PLATE B		PLATE C		PLATE D		HEIGHT FEET		
	X	Z	X	Z	X	Y	Z	X		Y	Z
120	9"	1'-4"	5"	1'-4"	7"	1 1/4"	1'-6 1/4"	8"	1 1/2"	2'-2"	.354
165	11"	1'-4"	7"	1'-4"	9"	1 1/4"	1'-6 1/4"	8"	1 1/2"	2'-2"	.375
215	1'-1"	1'-4"	9"	1'-4"	11"	1 1/4"	1'-6 1/4"	9"	1 1/2"	2'-2"	.396
260	1'-3"	1'-4"	11"	1'-4"	1'-1"	2 3/8"	1'-6 1/4"	11"	2"	2'-2"	.474
310	1'-5"	1'-4"	1'-1"	1'-4"	1'-3"	2 7/8"	1'-6 1/4"	1'-0"	2"	2'-2"	.516
355	1'-7"	1'-4"	1'-3"	1'-4"	1'-5"	3 1/8"	1'-6 1/4"	1'-2"	2 3/8"	2'-3"	.630
400	1'-9"	1'-4"	1'-5"	1'-4"	1'-7"	3 5/8"	1'-6 1/4"	1'-3"	2 7/8"	2'-3"	.672
450	1'-11"	1'-4"	1'-7"	1'-4"	1'-9"	4 1/8"	1'-6 1/4"	1'-5"	2 7/8"	2'-3"	.755
500	2'-1"	1'-4"	1'-9"	1'-4"	1'-11"	4 5/8"	1'-6 1/4"	1'-7"	3 1/8"	2'-3"	.838

18" BEARING

CAP. KIPS	PLATE A		PLATE B		PLATE C		PLATE D		HEIGHT FEET		
	X	Z	X	Z	X	Y	Z	X		Y	Z
135	9"	1'-6"	5"	1'-6"	7"	1 1/4"	1'-8 1/4"	8"	1 1/2"	2'-4"	.354
185	11"	1'-6"	7"	1'-6"	9"	1 1/4"	1'-8 1/4"	8"	1 1/2"	2'-4"	.375
240	1'-1"	1'-6"	9"	1'-6"	11"	1 1/4"	1'-8 1/4"	9"	1 1/2"	2'-4"	.396
295	1'-3"	1'-6"	11"	1'-6"	1'-1"	2 3/8"	1'-8 1/4"	11"	2"	2'-4"	.474
350	1'-5"	1'-6"	1'-1"	1'-6"	1'-3"	2 7/8"	1'-8 1/4"	1'-1"	2 3/8"	2'-5"	.547
400	1'-7"	1'-6"	1'-3"	1'-6"	1'-5"	3 1/8"	1'-8 1/4"	1'-2"	2 3/8"	2'-5"	.630
455	1'-9"	1'-6"	1'-5"	1'-6"	1'-7"	3 5/8"	1'-8 1/4"	1'-4"	2 7/8"	2'-5"	.672
505	1'-11"	1'-6"	1'-7"	1'-6"	1'-9"	4 1/8"	1'-8 1/4"	1'-6"	3 1/8"	2'-5"	.838
560	2'-1"	1'-6"	1'-9"	1'-6"	1'-11"	4 5/8"	1'-8 1/4"	1'-8"	3 1/8"	2'-5"	.838

20" BEARING

CAP. KIPS	PLATE A		PLATE B		PLATE C		PLATE D		HEIGHT FEET		
	X	Z	X	Z	X	Y	Z	X		Y	Z
150	9"	1'-8"	5"	1'-8"	7"	1 1/4"	1'-10 1/4"	8"	1 1/2"	2'-6"	.354
210	11"	1'-8"	7"	1'-8"	9"	1 1/4"	1'-10 1/4"	8"	1 1/2"	2'-6"	.375
270	1'-1"	1'-8"	9"	1'-8"	11"	1 1/4"	1'-10 1/4"	10"	1 3/4"	2'-6"	.417
325	1'-3"	1'-8"	11"	1'-8"	1'-1"	2 3/8"	1'-10 1/4"	11"	2"	2'-6"	.474
385	1'-5"	1'-8"	1'-1"	1'-8"	1'-3"	2 7/8"	1'-10 1/4"	1'-1"	2 3/8"	2'-7"	.547
445	1'-7"	1'-8"	1'-3"	1'-8"	1'-5"	3 1/8"	1'-10 1/4"	1'-3"	2 7/8"	2'-7"	.672
505	1'-9"	1'-8"	1'-5"	1'-8"	1'-7"	3 5/8"	1'-10 1/4"	1'-5"	2 7/8"	2'-7"	.672
565	1'-11"	1'-8"	1'-7"	1'-8"	1'-9"	4 1/8"	1'-10 1/4"	1'-7"	3 1/8"	2'-7"	.838
625	2'-1"	1'-8"	1'-9"	1'-8"	1'-11"	4 5/8"	1'-10 1/4"	1'-9"	3 1/8"	2'-7"	.838

ANCHOR BOLT NOTES:

FOR SPAN LENGTHS UP TO 100'-0", USE A TYPE I MASONRY PLATE "D" WITH (2) 1/4" DIA. X 1'-5" LONG ANCHOR BOLTS.

FOR SPAN LENGTHS FROM 100'-0" UP TO 150'-0", USE A TYPE I MASONRY PLATE "D" WITH (2) 1/2" DIA. X 1'-10" LONG ANCHOR BOLTS.

FOR SPAN LENGTHS GREATER THAN 150'-0", USE A TYPE II MASONRY PLATE "D" WITH (4) 1/2" DIA. X 1'-10" LONG ANCHOR BOLTS.



† DRILLED HOLES FOR ANCHOR BOLTS IN MASONRY PLATE "D" SHALL HAVE A DIAMETER 3/8" LARGER THAN ANCHOR BOLT.

EXPANSION BEARING DETAILS TYPE 'A'-STEEL GIRDERS




STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

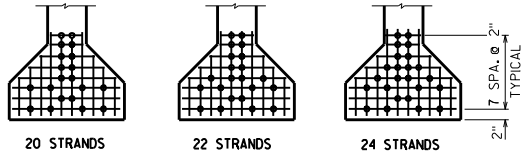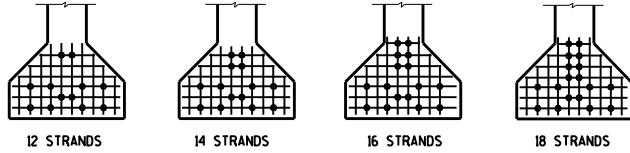

STANDARD ARRANGEMENTS TO RAISE CENTER OF GRAVITY TO AVOID DRAPING OF 0.6" DIA. STRANDS

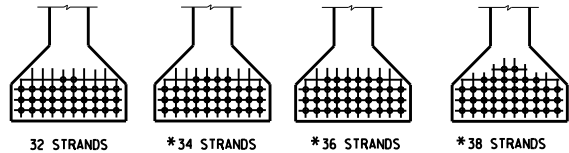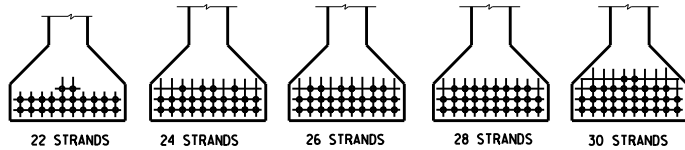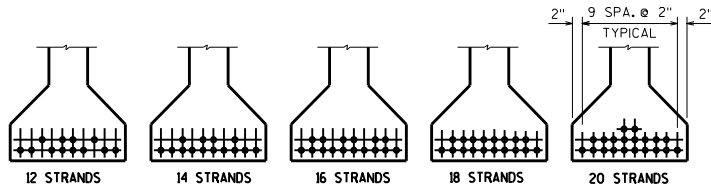

45" GIRDER

A = 560 SQ. IN.
 $r^2 = 223.91 \text{ IN.}^2$
 $y_T = 24.73 \text{ IN.}$
 $y_B = -20.27 \text{ IN.}$
 $I = 125,390 \text{ IN.}^4$
 $S_T = 5,070 \text{ IN.}^3$
 $S_B = -6,186 \text{ IN.}^3$
 WT. = 583 #/FT.

PRE-TENSION

$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands.
 $P_i \text{ PER } 0.5" \text{ DIA. STRAND} = 0.1531 \times 202,500 = 31.00 \text{ KIPS}$
 $P_i \text{ PER } 0.6" \text{ DIA. STRAND} = 0.217 \times 202,500 = 43.94 \text{ KIPS}$
 $\frac{y_B}{r^2} = \frac{-20.27}{223.91} = -0.09053 \text{ IN./IN.}^2$

(COMPRESSION IS POSITIVE)


N NO. STRANDS	(1) e_s (inches)	(2) $(1 + \frac{e_s y_B}{r^2})$	(3) $(A/(2))$ (sq. in.)	(4) $P(\text{ini}+) = A_s f_s$ 0.5" DIA. STRANDS (KIPS)	(4) $P(\text{ini}+) = A_s f_s$ 0.6" DIA. STRANDS (KIPS)	(5) $f_B (\text{ini}+) = (4)/(3)$ 0.5" DIA. STRANDS (K/Sq. in.)	(5) $f_B (\text{ini}+) = (4)/(3)$ 0.6" DIA. STRANDS (K/Sq. in.)
STANDARD PATTERNS FOR UNDRAPED STRANDS							
12	-14.94	2.352	238.10		527		2.213
14	-14.27	2.292	244.33		615		2.517
16	-13.27	2.201	254.43		703		2.763
18	-13.15	2.190	255.71		791		3.093
20	-12.27	2.111	265.28		879		3.313
22	-12.27	2.111	265.28		967		3.645
24	-12.10	2.095	267.30		1055		3.947
STANDARD PATTERNS FOR DRAPED STRANDS							
12	-17.60	2.593	215.97	372	527	1.722	2.440
14	-17.70	2.602	215.22	434	615	2.017	2.858
16	-17.52	2.586	216.55	496	703	2.290	3.246
18	-17.38	2.573	217.64	558	791	2.564	3.634
20	-17.07	2.545	220.04	620	879	2.818	3.995
22	-17.01	2.540	220.47	682	967	3.093	4.386
24	-16.77	2.518	222.40	744	1055	3.345	4.744
26	-16.58	2.501	223.91	806	1143	3.600	5.105
28	-16.41	2.486	225.26	868	1230	3.853	5.460
30	-16.13	2.460	227.64	930	1318	4.085	5.790
32	-16.02	2.450	228.57	992	1406	4.340	6.151
34	-15.80	2.430	230.45	1054		4.574	
36	-15.60	2.412	232.17	1116		4.807	
38	-15.32	2.387	234.60	1178		5.021	

ARRANGEMENT AT $\frac{1}{4}$ SPAN - FOR GIRDERS WITH DRAPED 0.5" DIA. AND 0.6" DIA. STRANDS
 *0.5" DIA. STRANDS ONLY


**45" PRESTRESSED GIRDER
 DESIGN DATA**

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

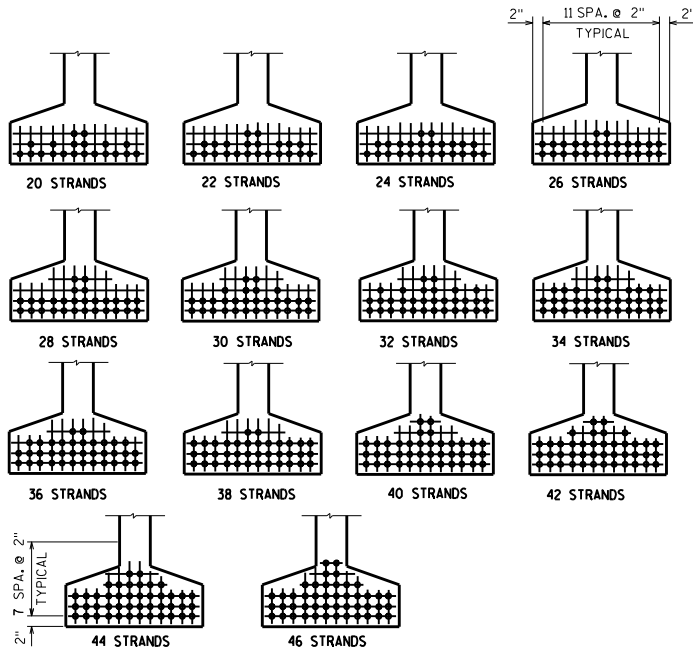

ARRANGEMENT AT \bar{C} SPAN FOR GIRDERS WITH DRAPED 0.5" DIA. STRANDS

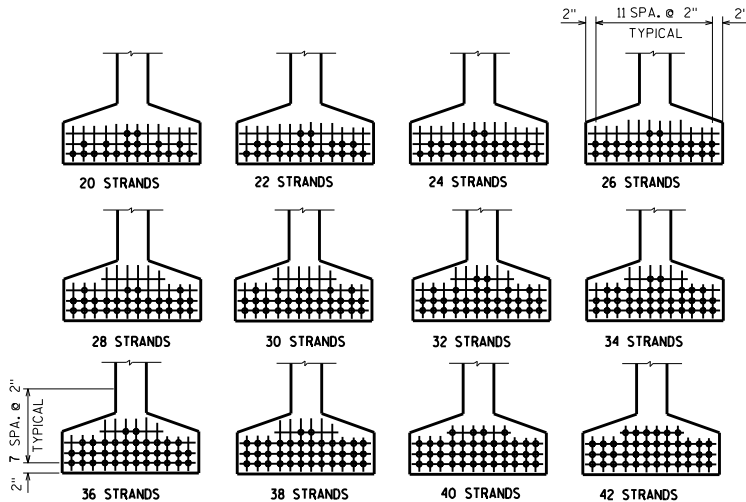

ARRANGEMENT AT \bar{C} SPAN FOR GIRDERS WITH DRAPED 0.6" DIA. STRANDS

(COMPRESSION IS NEGATIVE)

N NO. STRANDS	(1) e_s 0.5" DIA. STRANDS (inches)	(2) $(1 + \frac{e_s y_B}{r^2})$ 0.5" DIA. STRANDS	(3) $(A/(2))$ 0.5" DIA. STRANDS (sq. in.)	(4) $P(\text{ini}+) = A_s f_s$ 0.5" DIA. STRANDS (KIPS)	(5) $f_B (\text{ini}+)=(4)/(3)$ 0.5" DIA. STRANDS (K/Sq. In.)
20	-31.62	2.659	291.090	620	2.130
22	-31.53	2.655	291.530	682	2.339
24	-31.45	2.650	292.080	744	2.547
26	-31.39	2.647	292.410	806	2.756
28	-31.05	2.629	294.410	868	2.948
30	-30.89	2.621	295.310	930	3.149
32	-30.75	2.614	296.100	992	3.350
34	-30.62	2.607	296.890	1054	3.550
36	-30.51	2.601	297.580	1116	3.750
38	-30.41	2.596	298.150	1178	3.951
40	-30.12	2.581	299.880	1240	4.135
42	-29.95	2.572	300.930	1302	4.327
44	-29.80	2.564	301.870	1364	4.519
46	-29.49	2.548	303.770	1426	4.694

STANDARD PATTERNS - 0.5" DIA. DRAPED STRANDS

70" GIRDER

A = 774 SQ. IN.
 $r^2 = 659.70 \text{ IN.}^2$
 $y_T = 35.38 \text{ IN.}$
 $y_B = -34.62 \text{ IN.}$
 $I = 510,613 \text{ IN.}^4$
 $S_T = 14,430 \text{ IN.}^3$
 $S_B = -14,750 \text{ IN.}^3$
 WT. = 0.806 KIPS/FT. +
 6.6 KIPS FOR BOTH END BLOCKS

(COMPRESSION IS NEGATIVE)

N NO. STRANDS	(1) e_s 0.6" DIA. STRANDS (inches)	(2) $(1 + \frac{e_s y_B}{r^2})$ 0.6" DIA. STRANDS	(3) $(A/(2))$ 0.6" DIA. STRANDS (sq. in.)	(4) $P(\text{ini}+) = A_s f_s$ 0.6" DIA. STRANDS (KIPS)	(5) $f_B (\text{ini}+)=(4)/(3)$ 0.6" DIA. STRANDS (K/Sq. In.)
20	-31.62	2.659	291.090	879	3.020
22	-31.53	2.655	291.530	967	3.317
24	-31.45	2.650	292.080	1055	3.612
26	-31.39	2.647	292.410	1143	3.909
28	-31.19	2.637	293.520	1230	4.191
30	-31.02	2.628	294.520	1318	4.475
32	-30.74	2.614	296.100	1406	4.748
34	-30.62	2.607	296.890	1494	5.032
36	-30.51	2.601	297.580	1582	5.316
38	-30.41	2.596	298.150	1670	5.601
40	-30.22	2.586	299.300	1758	5.874
42	-30.05	2.577	300.350	1846	6.146

STANDARD PATTERNS - 0.6" DIA. DRAPED STRANDS

PRE-TENSION


$f'_s = 270,000 \text{ P.S.I.}$
 $f_s = 0.75 \times 270,000 = 202,500 \text{ P.S.I.}$
 for low relaxation strands
 Pi PER 0.5" DIA. STRAND
 $= 0.1531 \times 202,500 = 31.00 \text{ KIPS}$
 Pi PER 0.6" DIA. STRAND
 $= 0.217 \times 202,500 = 43.94 \text{ KIPS}$
 $\frac{y_B}{r^2} = \frac{-34.62}{659.70} = -0.05248 \text{ IN./IN.}^2$

**70" PRESTRESSED GIRDER
 DESIGN DATA**

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

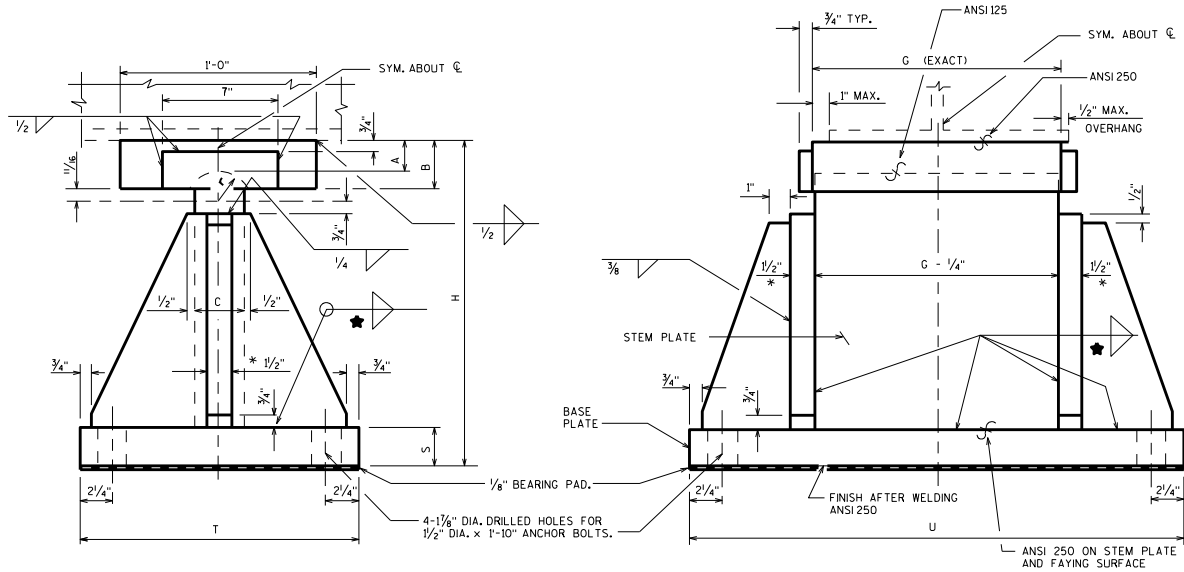

FIXED SHOE

★ 400 K ≤ REACTION < 1000 K, USE 5/8" WELD.
 1000 K ≤ REACTION ≤ 1500 K, USE 3/4" WELD

* FOR REACTIONS ≥ 1000 KIPS
 USE 2" STIFFENERS.

NOTES
 FABRICATOR MAY INCREASE 'BASE PLATE' THICKNESS AS AN ALTERNATE TO SHIMS.
 ALL STRUCTURAL STEEL BEARING PLATES SHALL BE FLAT ROLLED STEEL PLATES WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL.
 ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS, ON WELDED BEARINGS. FINAL MACHINING CAN BE PERFORMED BEFORE WELDING IS COMPLETED.
 ALL MATERIAL FOR BEARINGS INCLUDING SHIMS BUT EXCLUDING ANCHOR BOLTS, NUTS, AND WASHERS SHALL CONFORM TO ASTM SPECIFICATION TYPE A709 GRADE 50W STEEL.
 ALL ANCHOR BOLTS, NUTS, AND WASHERS SHALL CONFORM TO ASTM SPECIFICATION TYPE A709 GRADE 36 STEEL. ANCHOR BOLTS SHALL BE THREADED 3". PROVIDE ONE STANDARD WROUGHT WASHER AND ONE HEX NUT PER BOLT. PROJECT ANCHOR BOLTS "S" PLATE THICKNESS + 2/4" ABOVE TOP OF CONCRETE MASONRY. CHAMFER ANCHOR BOLTS PRIOR TO THREADING.
 AFTER WELDING SHOE ASSEMBLY, FINISH BOTTOM OF BASE PLATE TO A FLAT SURFACE.
 ALL SURFACES MARKED "F" SHALL BE MACHINE FINISHED BY AN AUTOMATIC PROCESS. THE CONTACT AREA OF BOTTOM SURFACE OF THE GIRDER FLANGE SHALL BE MACHINE FINISHED.
 ANCHOR BOLT DISTANCES ALONG "T" OR "U" MAY BE INCREASED FROM MINIMUM SHOWN WHEN A COMMON GRID DETAIL IS DESIRED FOR SEVERAL BEARINGS.
 FOR UNPAINTED STRUCTURES THE UPPER 6" OF THE ANCHOR BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED AS REQUIRED BY ASTM DESIGNATION A153, CLASS C OR B633.
 ALL MATERIALS IN TYPE "B" FIXED SHOE BEARINGS, INCLUDING SHIMS, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR "BEARING ASSEMBLIES FIXED B-...".

OR MATERIAL OF EQUIVALENT YIELD STRENGTH AND ELONGATION.

USE AASHTO LRFD SERVICE LOADS FOR BEARING SELECTION. CONSIDER ONLY DEAD LOAD AND HL-93 LIVE LOADS INCLUDING 33% DYNAMIC LOAD ALLOWANCE. THE BEARINGS ON THIS STANDARD WERE DESIGNED USING THE STANDARD SPECIFICATION.

TABLE OF DIMENSIONS

REACTION (KIPS)	A	B	C	G VALUES						H	r		S	T
				G=1'-7"	G=1'-9"	G=1'-11"	G=2'-1"	G=2'-3"	G=2'-5"		STEM	PLATE		
				U	U	U	U	U	U					
400-499	1 1/8"	2 3/8"	3"	2'-8"	2'-8"	2'-10"	3'-0"	—	—	1'-6"	1 1/8"	1 3/4"	2 3/8"	1'-4"
500-599	1 1/8"	2 3/8"	3"	3'-0"	3'-0"	3'-0"	3'-0"	—	—	1'-7"	1 1/8"	1 3/4"	2 3/8"	1'-5"
600-699	1 1/8"	2 3/8"	3"	—	3'-3"	3'-3"	3'-3"	3'-3"	—	1'-9"	1 1/8"	1 3/4"	2 3/8"	1'-6"
700-799	2 3/8"	3 3/8"	3 1/2"	—	—	3'-6"	3'-6"	3'-6"	3'-6"	1'-10"	1 1/8"	1 3/4"	2 3/8"	1'-7"
800-899	2 3/8"	3 3/8"	3 1/2"	—	—	3'-9"	3'-9"	3'-9"	3'-9"	2'-0"	1 1/8"	1 3/4"	2 3/8"	1'-8"
900-999	2 3/8"	3 3/8"	3 1/2"	—	—	3'-10"	3'-10"	3'-10"	3'-10"	2'-1"	1 1/8"	1 3/4"	2 3/8"	1'-10"
1000-1099	2 3/8"	3 3/8"	4"	—	—	4'-0"	4'-0"	4'-0"	4'-0"	2'-3"	2 3/8"	2 3/4"	3 3/8"	1'-11"
1100-1199	2 3/8"	3 3/8"	4"	—	—	4'-2"	4'-2"	4'-2"	4'-2"	2'-4"	2 3/8"	2 3/4"	3 3/8"	2'-0"
1200-1299	2 3/8"	3 3/8"	4"	—	—	—	4'-4"	4'-4"	4'-4"	2'-5"	2 3/8"	2 3/4"	3 3/8"	2'-1"
1300-1399	2 3/8"	3 3/8"	4"	—	—	—	4'-6"	4'-6"	4'-6"	2'-6"	2 3/8"	2 3/4"	3 3/8"	2'-2"
1400-1500	2 3/8"	3 3/8"	4"	—	—	—	4'-8"	4'-8"	4'-8"	2'-7"	2 3/8"	2 3/4"	3 3/8"	2'-3"

**TYPE 'B' - STEEL GIRDERS
 FIXED SHOE**

STATE OF WISCONSIN
 DEPARTMENT OF TRANSPORTATION
 STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva DATE: 7-16

★ FOR CULVERT WINGS:

WITH WING WALL THICKNESS ≥ 8" USE:
ADHESIVE ANCHORS 3/8" INCH,
EMBED 5" IN CONCRETE.
SEE DETAIL "A"




WITH WING WALL THICKNESS < 8" USE:
3/4" DIA. THRU WALL THREADED ROD
SEE DETAIL "B"

USE 1/8" X 1 7/8" LONG SLOTTED HOLES

FOR BRIDGE WINGS:

ADHESIVE ANCHORS 1-INCH,
EMBED 10" IN CONCRETE.
SEE DETAIL "A"

USE 1/8" X 2 1/2" LONG SLOTTED HOLES

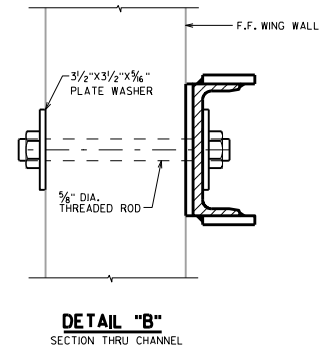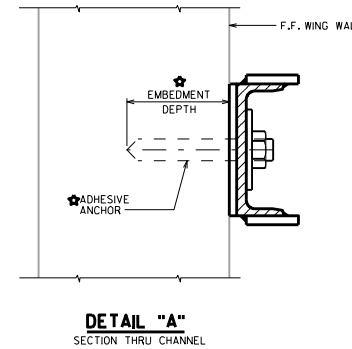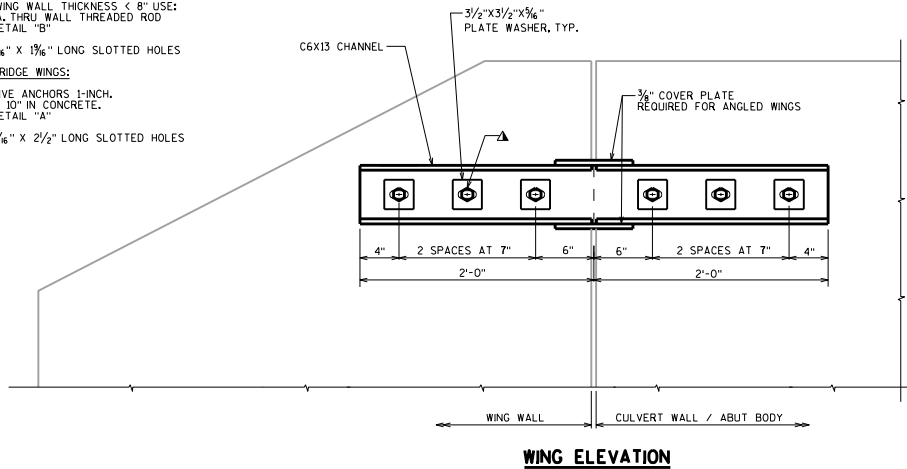

NOTES

WING STRAPPING DETAIL FOR THE PURPOSE OF MITIGATING INWARD WING TIPPING, AS AN ALTERNATIVE TO THE PREFERRED METHOD OF WING REPLACEMENT.

BID ITEM SHALL BE "STRAPPING B-XX-XXX" WHICH INCLUDES ALL ITEMS SHOWN.

WISDOT REGIONAL BRIDGE MAINTENANCE ENGINEER TO APPROVE USE OF DETAIL PRIOR TO INSTALLATION.

ALL PROVIDED STEEL MATERIAL SHALL CONFORM TO ASTM A36.



ALL STRUCTURAL STEEL SHOWN SHALL BE GALVANIZED, THREADED RODS, MASONRY ANCHORS, NUTS AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153 CLASS C.

CUTTING AND DRILLING OF CHANNEL SHALL BE DONE IN FABRICATION SHOP, PRIOR TO GALVANIZING.

IF WELDING COVER PLATE IN FIELD, PRIOR TO WELDING, REMOVE GALVANIZING FROM AREA TO BE WELDED, TOUCH UP WITH PAINT ALL AREAS LACKING GALVANIZING WHEN COMPLETE.

CAULK AROUND PERIMETER OF CHANNEL AND FILL PORTION OF HOLE AROUND ANCHOR BOLT AND SHIM WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.

ADHESIVE ANCHORS SHALL CONFORM TO SECTION 502.2.12 OF THE STANDARD SPECIFICATIONS.

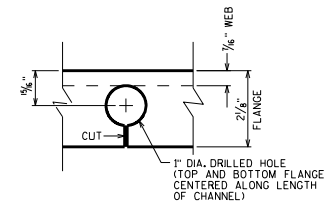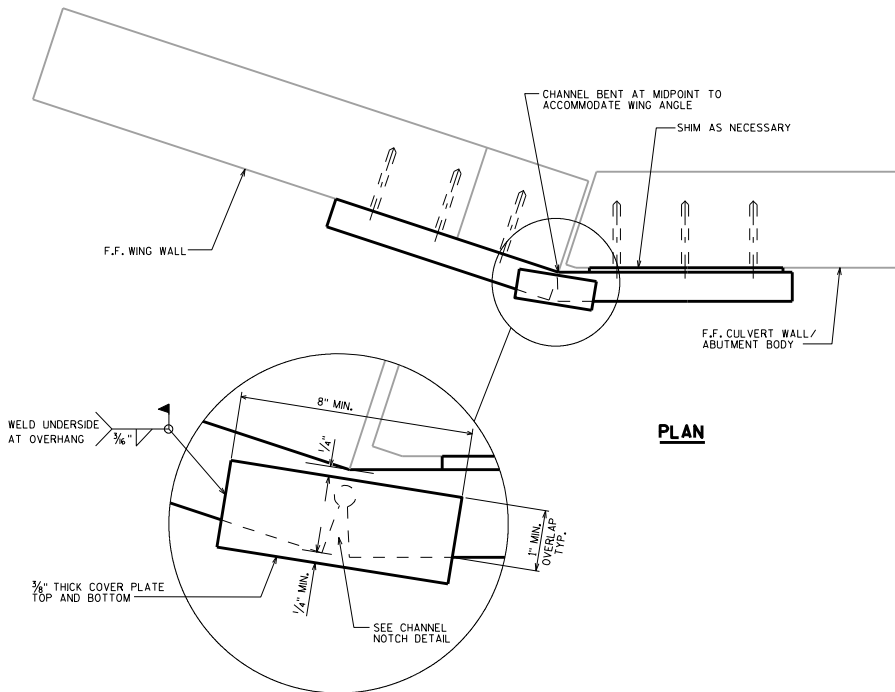



CHANNEL NOTCH DETAIL
FOR USE WITH ANGLED WINGS ONLY

WING STRAPPING

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: *Bill Oliva*

DATE:
7-16


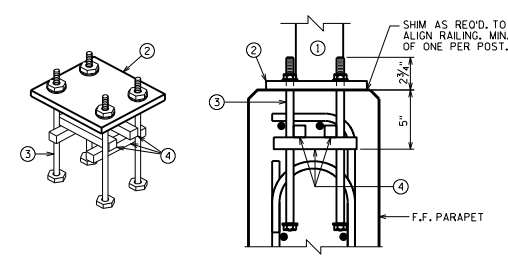
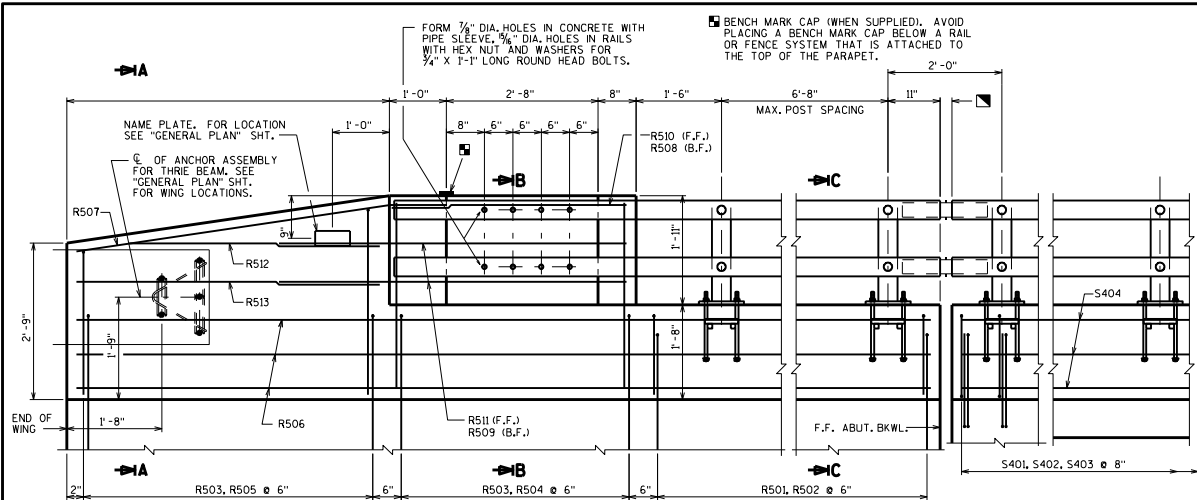


ANCHOR BOLTS FOR RAIL POSTS

STRIP SEAL EXP. JT. @ ABUT. FOR TYPE A1 ABUT., USE 1/2" FILLER TO TOP OF PARAPET. SEE STD. 12.01/12.02

INSIDE ELEVATION

OPTIONAL CONSTRUCTION JOINTS IN THE PARAPETS MAY BE USED. RUN BAR REINF. THRU THE JOINT. LAP LONGIT. BARS A MIN. OF 1'-5". MIN CONSTR. JT. SPACING OF 80'-0". DEFINE CONSTR. JT. WITH A 3/4" "V"-GROOVE.


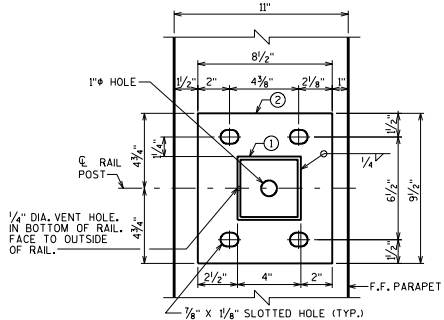
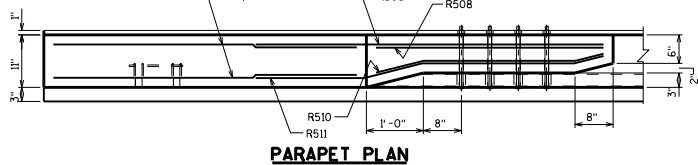



BASE PLATE


DESIGNER NOTES

DETAILS LIMITED TO SKEWS < 40°. SEE STANDARD 40.25 FOR RAILING DETAILS


RAILING WEIGHT = 30 LB/FT

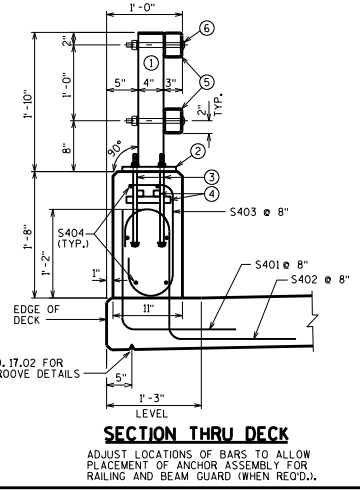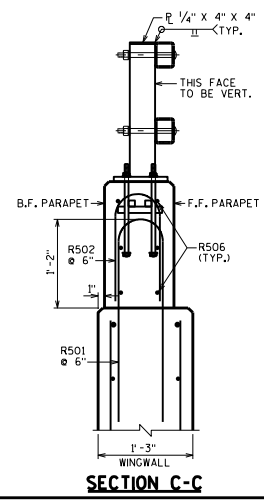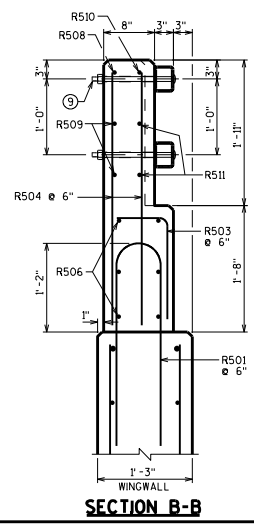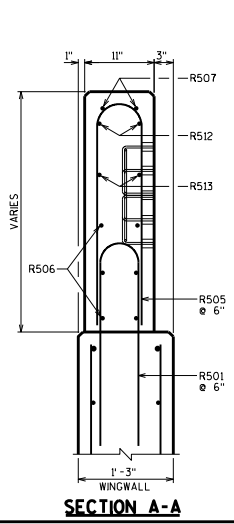


RAILING TUBULAR TYPE 'PF'	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: <u>7-16</u>

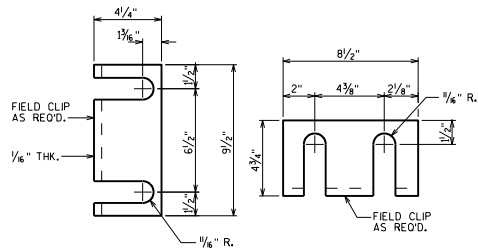

POST SHIM DETAILS




SHOP RAIL SPLICE DETAIL
(LOCATION MUST BE SHOWN ON SHOP DRAWINGS)

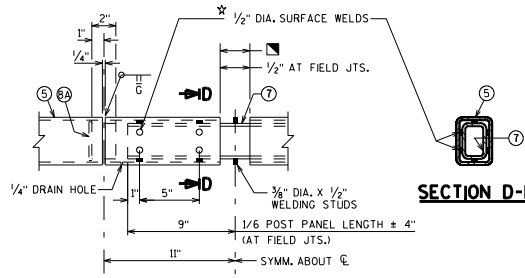

FIELD ERECTION JOINT DETAIL


* MIN. 3/8" FLAT SURFACE DIA. PUNCHINGS OR STUDS MAY BE USED AS AN ALTERNATE.




S401

S402


S403




R501, R502, R505



R503



R507



R511

R510

BILL OF BARS

NOTE: THE FIRST OR FIRST TWO DIGITS OF THE BAR MARK SIGNIFIES THE BAR SIZE.

BAR MARK	NO. REQ'D.	LENGTH	BENT	BAR SERIES	LOCATION
S401	X	3'-0"	X		PARAPET VERT.
S402	X	4'-1"	X		PARAPET VERT.
S403	X	2'-9"	X		PARAPET VERT.
S404	X				PARAPET HORIZ.
R501	X	5'-9"	X		PARAPET VERT.
R502	X	3'-1"	X		PARAPET VERT.
R503	X	1'-11"	X		PARAPET VERT.
R504	X	3'-4"			PARAPET VERT.
R505	X	6'-2"	X	▲	PARAPET VERT.
R506	X				PARAPET HORIZ.
R507	X		X		PARAPET HORIZ.
R508	X	4'-0"			PARAPET HORIZ.
R509	X	5'-8"			PARAPET HORIZ.
R510	X	4'-0"	X		PARAPET HORIZ.
R511	X	6'-0"	X		PARAPET HORIZ.
R512	X				PARAPET HORIZ.
R513	X				PARAPET HORIZ.

▲ LENGTH SHOWN FOR BAR IS AN AVERAGE LENGTH AND SHOULD ONLY BE USED FOR BAR WEIGHT CALCULATIONS. SEE BAR SERIES TABLE FOR ACTUAL LENGTHS.

NOTES

BID ITEM SHALL BE "RAILING TUBULAR TYPE PF B--", WHICH SHALL INCLUDE ALL STEEL ITEMS SHOWN, AND PAINTING.

POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUTS.

NO. 2, NO. 7 AND NO. 8 SHALL CONFORM TO ASTM A709 GRADE 36. STRUCTURAL TUBING, NO. 1 AND NO. 5, SHALL CONFORM TO ASTM A500 GRADE B.

ANCHORAGES SHALL BE ACCURATELY PLACED TO PROVIDE CORRECT ALIGNMENT OF RAILING. SET POSTS NORMAL TO GRADE.

CUT BOTTOM OF POST TO MAKE POST VERTICAL IN TRANSVERSE DIRECTION. STEEL SHIMS SHALL BE PROVIDED & USED UNDER BASE PLATES WHERE REQUIRED FOR ALIGNMENT.

FILL BOLT SLOT OPENINGS IN SHIMS AND PLATE NO. 2 AND CAULK AROUND PERIMETER OF PLATE NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.

ALL JOINTS IN CONCRETE PARAPET ARE TO BE VERTICAL.

AFTER FABRICATION, ALL MATERIAL, EXCEPT ANCHORAGE NO. 3 & 4 & SHIMS SHALL BE PAINTED WITH A THREE COAT ZINC-RICH EPOXY SYSTEM PER WISDOT STANDARD SPECIFICATION, SECTION 517, EPOXY SYSTEM. SHIMS SHALL BE GIVEN ONE COAT OF ZINC RICH PRIMER PAINT. THE FINISH COLOR SHALL BE FEDERAL COLOR NO.

1/4" DIA. VENT HOLES TO BE LOCATED AT LOW END OF RAILS.

RAILING SHALL BE FABRICATED IN LENGTHS THAT INCLUDE 3 OR 4 POSTS.

TOUCH-UP PAINTING TO BE DONE AT COMPLETION OF STEEL RAILING INSTALLATION TO THE SATISFACTION OF THE ENGINEER AT NO EXTRA COST.

SEE STD. 30.07 FOR BEAM GUARD ANCHOR ASSEMBLY DETAILS.

THIS RAILING MEETS NCHRP REPORT 350 EVALUATION CRITERIA FOR TEST LEVEL 2 (TL-2).

□ ROWLY OPENING OR 2 1/2" MIN. FOR STRIP SEAL EXP. JOINT & 1/2" OPENING FOR A1 ABUTMENT.

LEGEND


- 1 TS 4 x 4 x 0.25 X 1'-9 1/4" STRUCTURAL TUBING WITH 3/8" DIA. HOLES FOR BOLT NO. 6. PLACE POSTS VERTICAL IN TRANSVERSE DIRECTION. WELD TO NO. 2. PLACE POSTS NORMAL TO GRADE LINE
- 2 PLATE 3/4" X 8 1/2" X 9 1/2" WITH 3/8" X 1 1/4" SLOTTED HOLES FOR ANCHOR BOLTS NO. 3. WELD TO NO. 1 AS SHOWN. SLOTS PARALLEL TO SHORT SIDE OF PLATE.
- 3 3/8" DIA. X 1'-1" LONG ASTM A325 HEX BOLTS (GALVANIZED) WITH A325 NUT AND WASHER. 4 REOD. PER POST. THREAD 3" AND PLACE NORMAL TO PLATE NO. 2. EMBED A MIN. OF 10". CHAMFER TOP OF BOLTS BEFORE THREADING.
- 4 BAR 3/4" SQ. X 7" LONG. WELD TO ANCHOR BOLTS NO. 3 (GALVANIZED).
- 5 TS 4 X 3 X 0.25 STRUCTURAL TUBING, ATTACH TO NO. 1 WITH BOLTS NO. 6. PROVIDE 3/8" DIA. HOLE FOR NO. 6.
- 6 3/4" DIA. X 9" LONG ROUND HEAD BOLTS, ASTM A307, WITH HEX NUT AND WASHERS AND LOCK WASHER. (1 REOD. AT EACH RAIL TO POST LOCATION)
- 7 RECTANGULAR SLEEVE FABRICATED FROM 1/4" PLATES. 1'-6" LONG.
- 8 RECTANGULAR SLEEVE FABRICATED FROM 1/4" PLATES. PROVIDE "SLIDING FIT" WITH MIN. OUT TO OUT DIMENSION OF 3 3/8" X 2 3/8".
- 9 RECTANGULAR SLEEVE FABRICATED FROM 1/4" PLATES. PROVIDE "SLIDING FIT" WITH MIN. OUT TO OUT DIMENSION OF 3 3/8" X 2 3/8" WITH 3/8" PLATE AT ONE END WELDED ALL AROUND TO BLOCK WATER.
- 10 3/4" DIA. X 1'-1" LONG ROUND HEAD BOLTS, ASTM A307, WITH HEX NUT AND WASHERS

RAILING TUBULAR TYPE 'PF' DETAILS


STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva


DATE:
7-16

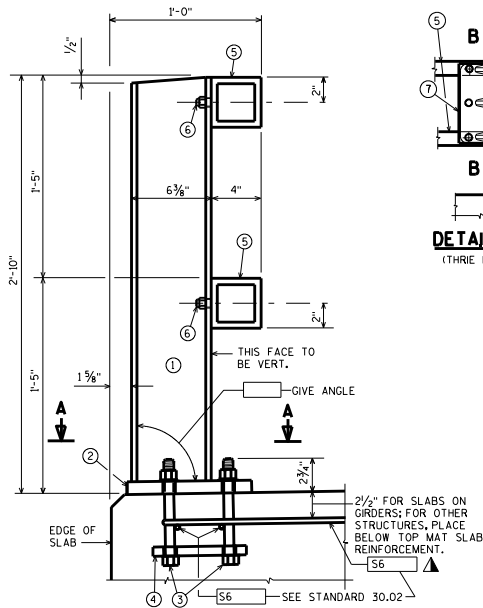


SECTION THRU RAILING ON DECK

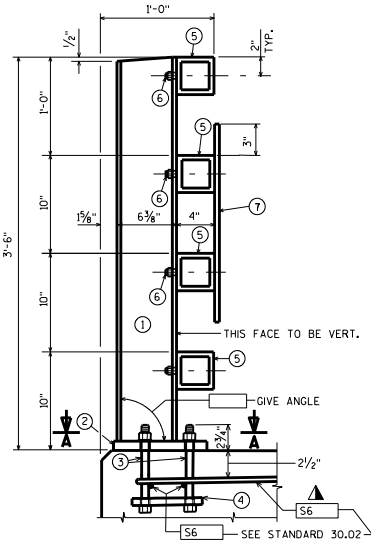


SECTION THRU RAILING ON SIDEWALK

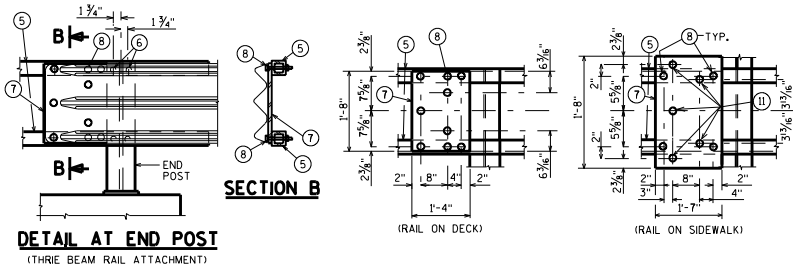

DETAIL AT END POST
(THREE BEAM RAIL ATTACHMENT)

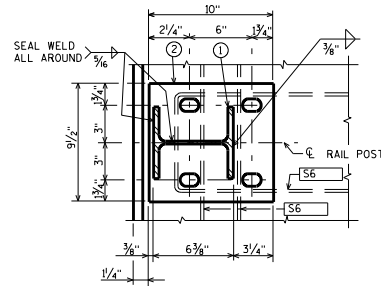


SECTION A




DETAIL FOR END POSTS

WITH OR WITHOUT THREE BEAM RAIL ATTACHMENT
(END POST MAY BE LOCATED ON SUPERSTRUCTURE OR WINGWALLS)

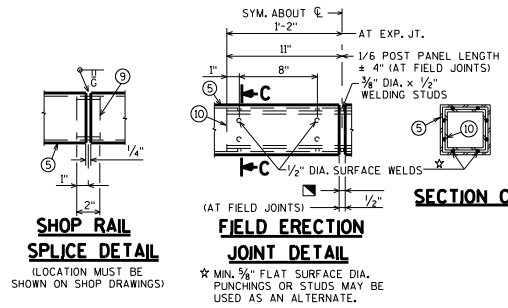


SHOP RAIL SPLICE DETAIL
(LOCATION MUST BE SHOWN ON SHOP DRAWINGS)

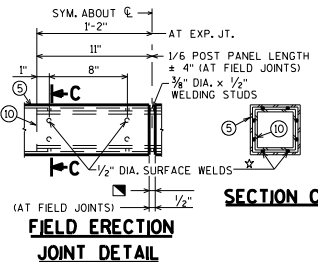

FIELD ERECTION JOINT DETAIL


* MIN. 3/8" FLAT SURFACE DIA. PUNCHINGS OR STUDS MAY BE USED AS AN ALTERNATE.

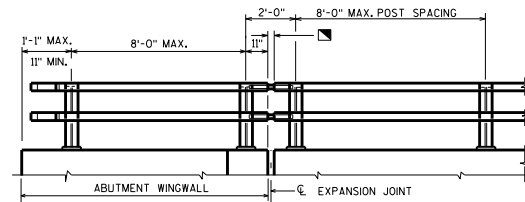


PART ELEVATION OF RAILING

THIS RAILING IS NO LONGER USED AND IS SHOWN FOR INFORMATIONAL PURPOSES ONLY:

FOR 2'-10" RAILING ON DECK:
RAILING WEIGHT = 37 LB/LF (BASED ON 8'-0" POST SPACING.)



POST SHIM DETAIL
(4 PER POST)

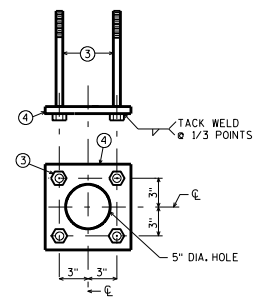

ANCHORAGE DETAIL


LEGEND

- ① W6 x 25 WITH 1/4" DIA. HOLES ON EACH SIDE OF POST FOR STUD NO. 6. CUT BOTTOM OF POST TO MATCH CROSS SLOPE OF ROADWAY (OR SIDEWALK, AS APPLICABLE). PLACE POST VERTICAL. PLACE POSTS NORMAL TO GRADE LINE.
- ② PLATE 1" x 9 1/2" x 10" WITH 1/6" x 1/2" SLOTTED HOLES FOR ANCHOR BOLTS NO. 3. WELD TO NO. 1 AS SHOWN.
- ③ A325 - 7/8" DIA. HEX BOLTS (GALVANIZED) WITH A325 NUT & WASHER. 14" LONG AT END POSTS AND AT POSTS ON CONCRETE SLAB SUPERSTRUCTURES WHERE THE SLAB THICKNESS IS > 15". USE 8" LONG AT ALL OTHER LOCATIONS. 4 REOD. PER POST. THREAD 3" AND PLACE NORMAL TO PLATE NO. 2. CHAMFER TOP OF BOLTS BEFORE THREADING.
- ④ 1/4" x 8" x 8" FLAT BAR WITH 1/6" DIA. HOLES FOR ANCHOR BOLTS NO. 3
- ⑤ TS 4 x 4 x 0.25 STRUCTURAL TUBING, CONFORMING TO ASTM DESIGNATION A501 OR A500 GRADE B. ATTACH TO NO. 1 WITH STUDS NO. 6.
- ⑥ 5/8" DIA. x 1 1/2" LONG SHOP WELDED STUDS WITH HEX NUT AND 2" WASHERS (2 REOD. AT EACH RAIL TO POST LOCATION.)
- ⑦ PLATE 3/8" x 1'-4" (1'-7" ON SDWK.) x 1'-8". BOLT TO RAIL AS SHOWN IN DETAIL. REQUIRED AT THREE BEAM GUARD RAIL ATTACHMENTS ONLY. PLACE SYMMETRICALLY ABOUT TUBES NO. 5.
- ⑧ 1" DIA. HOLES IN PLATE NO. 7 & TUBES NO. 5 FOR 7/8" DIA. A325 BOLTS W/HEX NUTS AND WASHERS.
- ⑨ SQUARE SLEEVE FABRICATED FROM 1/4" PLATE. PROVIDE "SLIDING FIT" WITH A MINIMUM OUT TO OUT DIMENSION OF 3 13/32".
- ⑩ TS 3 x 3 x 0.25 x (2'-4" AT EXPANSION JOINTS) & (1'-10" AT FIELD JOINTS) LONG. PROVIDE 1/2" DIA. SURFACE WELDS ON ALL SIDES AS SHOWN. GRIND WELDS TO FIT FREE INTO I.D. OF NO. 5. PROVIDE 3/8" DIA. x 1/2" WELDING STUDS ON TOP AND BOTTOM SURFACES AT CENTERLINE.
- ⑪ 7/8" DIA. x 1/2" LONG THREADED SHOP WELDED STUDS. (REOD. FOR SDWK. RAIL ONLY.)


NOTES

- BID ITEM SHALL BE "RAILING TUBULAR TYPE F B--", WHICH INCLUDES ALL ITEMS SHOWN.
- RAILING SHALL BE FABRICATED IN LENGTHS THAT INCLUDE 3 OR 4 POSTS.
- POST BASE PLATES SHALL BE FLAT WITH ALL SURFACES SMOOTH AND FREE FROM WARP AND ALL EDGES SMOOTH, STRAIGHT AND VERTICAL. ALL PLATE CUTS SHALL BE MACHINE OR MACHINE FLAME CUT.
- FOR RAILING NOT TO BE PAINTED, ALL MATERIAL EXCEPT ANCHORAGE DETAIL NO. 4 SHALL BE GALVANIZED AFTER FABRICATION. PRIOR TO GALVANIZING, ALL STEEL RAILING POSTS & STEEL TUBING SHALL BE GIVEN A NO. 6 BLAST CLEANING BY SSPC SPECIFICATIONS.
- FOR RAILING TO BE PAINTED, ALL MATERIAL EXCEPT ANCHORAGE DETAIL NO. 3 & 4, SHALL BE PAINTED WITH A THREE-COAT ZINC RICH EPOXY SYSTEM. PRIOR TO PAINTING, ALL STEEL RAILING POSTS & STEEL TUBING SHALL BE GIVEN A NO. 11 NEAR WHITE BLAST CLEANING BY SSPC SPECIFICATIONS.
- ALL MATERIALS USED IN FABRICATION SHALL BE MADE FROM MATERIALS CONFORMING TO ASTM A709 GRADE 36 UNLESS NOTED OTHERWISE.
- FILL BOLT SLOT OPENINGS IN POST SHIMS AND PLATE NO. 2 WITH NON-STAINING GRAY NON-BITUMINOUS JOINT SEALER.
- STEEL POST SHIMS MAY BE USED UNDER POSTS WHERE REOD. FOR ALIGNMENT.
- PLACE FIRST BOTTOM LONGITUDINAL BAR CLEAR OF DRIP GROOVE.

TUBULAR STEEL RAILING TYPE 'F'	
STATE OF WISCONSIN DEPARTMENT OF TRANSPORTATION STRUCTURES DEVELOPMENT SECTION	
APPROVED: <u>Bill Oliva</u>	DATE: 7-16

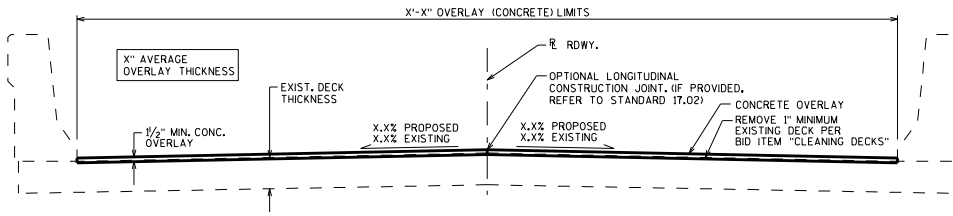

CROSS SECTION THRU ROADWAY
LOOKING NORTH

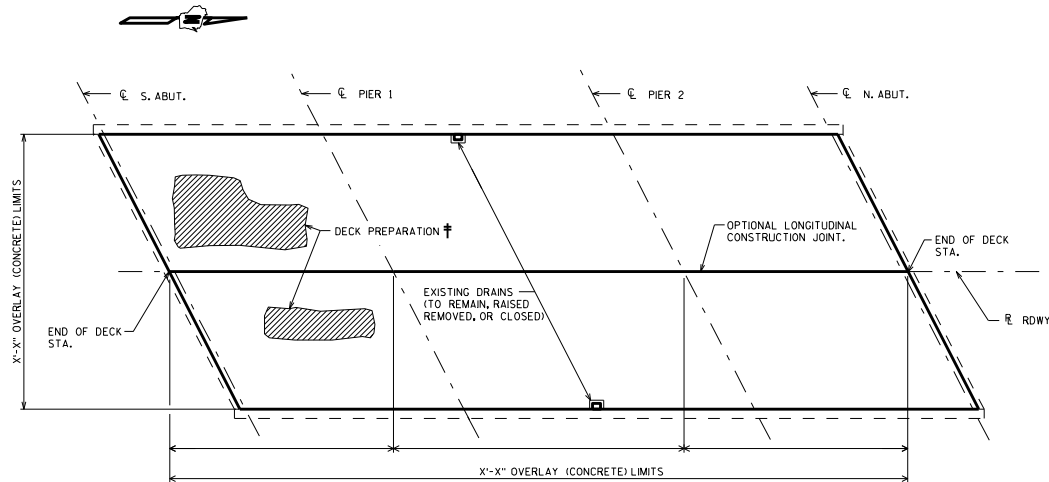

PLAN
TOP OF DECK SHOWN

† SURVEY TYPE:
SURVEY COMPLETED DATE: ___/___/____

DESIGNER NOTES

- PLAN VIEW APPLICABLE TO ALL OVERLAY METHODS AND DECK REPAIRS WITHOUT OVERLAYS.
- FOR CROSS SECTIONS NOT IN SUPERELEVATION TRANSITIONS, THE PREFERRED MINIMUM SLOPE IS 2%.
- PROVIDE AN AVERAGE OVERLAY THICKNESS ON THE PLANS. THE AVERAGE OVERLAY THICKNESS IS THE MINIMUM OVERLAY THICKNESS PLUS 1/2" TO ACCOUNT FOR VARIATIONS IN THE DECK SURFACE. CHANGES IN CROSS-SLOPE INCREASE THE AVERAGE OVERLAY THICKNESS. QUANTITIES ARE BASED ON THE AVERAGE OVERLAY THICKNESS.
- DO NOT PROVIDE A PROFILE GRADE LINE ON THE PLANS.
- DO NOT INCLUDE BID ITEM "SAWING PAVEMENT DECK PREPARATION AREAS" FOR DECK PREPARATION.
- * REMOVAL OF 1" OF EXISTING DECK UNDER BID ITEM "CLEANING DECKS" IS NOT INTENDED FOR PREVIOUSLY OVERLAD DECKS. EXISTING CONCRETE COVER (1" MIN.) SHALL BE MAINTAINED AND CONSIDERED WHEN DETERMINING CONCRETE REMOVALS. DO NOT INCLUDE BID ITEM "CLEANING DECKS" WHEN REMOVING EXISTING OVERLAY.
- † PROVIDE (IF AVAILABLE) DECK CONDITION ASSESSMENT SURVEY ON PLANS. INCLUDE SURVEY TYPE AND DATE COMPLETED.
- JOINT REPAIR AREAS SHOULD NOT BE INCLUDED IN DECK REPAIR AREAS OR OVERLAY QUANTITIES. SEE STANDARD 40.04.
- INCLUDE THE BID ITEM "ADJUSTING FLOOR DRAINS" WHEN DRAINS ARE TO BE RAISED.
- RESTRICTIONS ON REMOVAL ITEMS SHALL BE PLACED ON THE PLANS TO PREVENT DAMAGE TO REINFORCING STEEL.

DESIGN DATA

LIVE LOAD:
INVENTORY RATING: HS-
OPERATING RATING: HS-
MAXIMUM STANDARD PERMIT VEHICLE LOAD = ... KIPS

MATERIAL PROPERTIES:
CONCRETE MASONRY OVERLAY DECKS $f'c = 4,000$ P.S.I.

NOTES

- DRAWINGS SHALL NOT BE SCALED.
- DIMENSIONS SHOWN ARE BASED ON THE ORIGINAL STRUCTURE PLANS.
- PROTECTIVE SURFACE TREATMENT SHALL BE APPLIED TO THE ENTIRE TOP SURFACE OF THE NEW CONCRETE OVERLAY.
- A MINIMUM OF 1-INCH OF CONCRETE SHALL BE REMOVED FROM THE ENTIRE BRIDGE DECK UNDER THE BID ITEM "CLEANING DECKS".
- PREPARATION DECKS TYPE 1, PREPARATION DECKS TYPE 2, AND FULL-DEPTH DECK REPAIR AREAS ARE BASED ON THE PLANS AND AS DETERMINED BY THE ENGINEER. DECK PREPARATION AND FULL-DEPTH DECK REPAIRS SHALL BE FILLED WITH "CONCRETE MASONRY OVERLAY DECKS".
- ANY EXCAVATION REQUIRED TO COMPLETE THE OVERLAY OR JOINT REPAIRS AT THE ABUTMENTS TO BE CONSIDERED INCIDENTAL TO THE BID ITEM "CONCRETE MASONRY OVERLAY DECKS".
- PROFILE GRADE LINE SHALL BE DETERMINED IN THE FIELD BASED ON A MINIMUM OVERLAY THICKNESS OF 1/2" PLACED ABOVE THE DECK SURFACE AFTER SURFACE PREPARATION. EXPECTED AVERAGE OVERLAY THICKNESS IS 2" (OR AS GIVEN ON THE PLANS). IF EXPECTED AVERAGE OVERLAY THICKNESS IS EXCEEDED BY MORE THAN 1/2", CONTACT THE STRUCTURE'S DESIGN SECTION.
- DRAINS REMOVED OR CLOSED IS INCIDENTAL TO THE BID ITEM "CONCRETE MASONRY OVERLAY DECKS".

TOTAL ESTIMATED QUANTITIES

BID ITEM NUMBER	BID ITEMS	UNIT	TOTAL
502.3200	PROTECTIVE SURFACE TREATMENT	SY	
509.0301	PREPARATION DECKS TYPE 1	SY	
509.0302	PREPARATION DECKS TYPE 2	SY	
509.0500	CLEANING DECKS	SY	
509.2000	FULL-DEPTH DECK REPAIR	SY	
509.2500	CONCRETE MASONRY OVERLAY DECKS	CY	
POSSIBLE ADDITIONAL BID ITEMS			
502.3210	PIGMENTED SURFACE SEALER	SY	
* 509.9005.S	REMOVING CONCRETE MASONRY DECK OVERLAY	SY	
514.0900	ADJUSTING FLOOR DRAINS	EACH	


THIS IS A PARTIAL LIST OF POSSIBLE BID ITEMS. BID ITEMS MAY NEED TO BE ADDED OR REMOVED TO FIT EACH INDIVIDUAL CASE.

CONCRETE OVERLAY

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

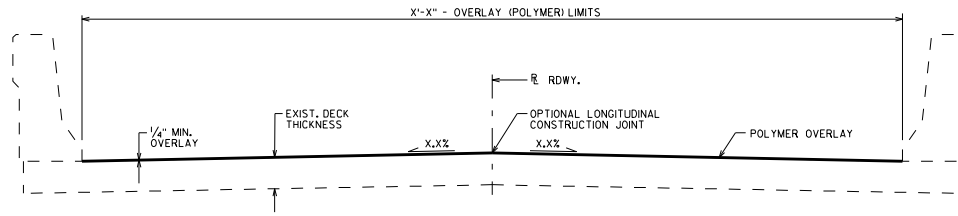

CROSS SECTION THRU ROADWAY
LOOKING NORTH

DESIGNER NOTES

REPAIRS USING CONCRETE REQUIRE A MINIMUM CURE TIME OF 28 DAYS BEFORE PLACING OVERLAY. ALTERNATIVES TO CONCRETE DECK PATCHES MAY BE USED TO SHORTEN TIME REQUIRED FOR PLACING OVERLAY.
DO NOT PROVIDE A PROFILE GRADE LINE ON THE PLANS.

DESIGN DATA

LIVE LOAD:
INVENTORY RATING: HS-...
OPERATING RATING: HS-...
MAXIMUM STANDARD PERMIT VEHICLE LOAD = ... KIPS

MATERIAL PROPERTIES:
CONCRETE MASONRY - DECK PATCHING f'c = 4,000 P.S.I.

NOTES


DRAWINGS SHALL NOT BE SCALED.
DIMENSIONS SHOWN ARE BASED ON THE ORIGINAL STRUCTURE PLANS.
DECK SURFACE PREPARATION IS INCLUDED IN THE BID ITEM "POLYMER OVERLAY".
AREAS OF "PREPARATION DECKS TYPE 1" SHALL BE DEFINED BY A SAW CUT.
PREPARATION DECKS TYPE 1, PREPARATION DECKS TYPE 2, AND FULL-DEPTH DECK REPAIR AREAS ARE BASED ON THE PLANS AND AS DETERMINED BY THE ENGINEER. DECK PREPARATION AND FULL-DEPTH DECK REPAIRS SHALL BE FILLED WITH "CONCRETE MASONRY DECK PATCHING".

TOTAL ESTIMATED QUANTITIES

BID ITEM NUMBER	BID ITEMS	UNIT	TOTAL
509.0301	PREPARATION DECKS TYPE 1	SY	
509.0302	PREPARATION DECKS TYPE 2	SY	
509.2000	FULL-DEPTH DECK REPAIR	SY	
509.5100.S	POLYMER OVERLAY	SY	
SPV.0035	CONCRETE MASONRY DECK PATCHING	CY	
SPV.0090	SAWING PAVEMENT DECK PREPARATION AREAS	LF	

THIS IS A PARTIAL LIST OF POSSIBLE BID ITEMS. BID ITEMS MAY NEED TO BE ADDED OR REMOVED TO FIT EACH INDIVIDUAL CASE.

REHABILITATION OVERLAY

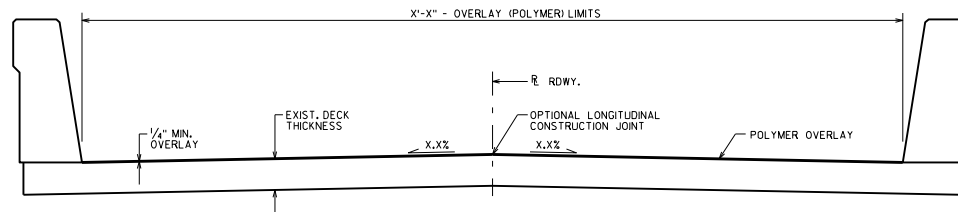

CROSS SECTION THRU ROADWAY
LOOKING NORTH

DESIGNER NOTES

PREVENTATIVE OVERLAY INTENDED FOR USE ON DECKS WITH A MINIMUM AGE OF 28 DAYS AND A MAXIMUM AGE OF 2 YEARS. AN ADDITIONAL CONTRACT MAY BE REQUIRED FOR APPLYING THE OVERLAY DUE TO SCHEDULE AND DECK AGE CONSIDERATIONS.
WHEN BID ITEM "POLYMER OVERLAY" IS USED RATING SHOULD INCLUDE THE 5 PSF OVERLAY.

DESIGN DATA

LIVE LOAD:
DESIGN LOADING: HL-93
INVENTORY RATING FACTOR: RF=1...
OPERATING RATING FACTOR: RF=1...
MAXIMUM STANDARD PERMIT VEHICLE LOAD = ... KIPS

STRUCTURE IS DESIGNED FOR A FUTURE WEARING SURFACE OF 20 POUNDS PER SQUARE FOOT.

NOTES

DRAWINGS SHALL NOT BE SCALED.
DECK SURFACE PREPARATION IS INCLUDED IN THE BID ITEM "POLYMER OVERLAY".

TOTAL ESTIMATED QUANTITIES

BID ITEM NUMBER	BID ITEMS	UNIT	TOTAL
509.5100.S	POLYMER OVERLAY	SY	


PREVENTATIVE OVERLAY

POLYMER OVERLAY

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16

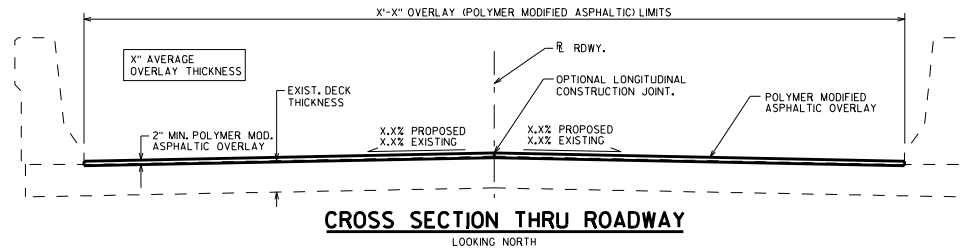

CROSS SECTION THRU ROADWAY

LOOKING NORTH

DESIGNER NOTES

CONCRETE OVERLAYS ARE THE CURRENT PREFERRED METHOD TO OVERLAY A BRIDGE.

REPAIRED AREAS REQUIRE A MINIMUM CURE TIME OF 7 DAYS BEFORE PLACING OVERLAY. ALTERNATIVES TO CONCRETE DECK PATCHES MAY BE USED TO SHORTEN TIME REQUIRED FOR PLACING OVERLAY.

PROVIDE AN AVERAGE OVERLAY THICKNESS ON THE PLANS. THIS AVERAGE OVERLAY THICKNESS VALUE IS BASED ON THE THEORETICAL AVERAGE OVERLAY THICKNESS PLUS 1/2" TO ACCOUNT FOR VARIATIONS IN THE DECK SURFACE. QUANTITIES ARE BASED ON THE AVERAGE OVERLAY THICKNESS.

DO NOT PROVIDE A PROFILE GRADE LINE ON THE PLANS.

OVERLAYS NOT REQUIRING SHEET MEMBRANE WATERPROOFING ARE PREFERRED.

DESIGNER TO CONTACT THE REGIONAL BRIDGE MAINTENANCE ENGINEER TO DETERMINE IF POLYMER MODIFIED ASPHALTIC MATERIAL IS AVAILABLE.

RESTRICTIONS ON REMOVAL ITEMS SHALL BE PLACED ON THE PLANS TO PREVENT DAMAGE TO REINFORCING STEEL.

TOTAL ESTIMATED QUANTITIES

BID ITEM NUMBER	BID ITEMS	UNIT	TOTAL
509.0301	PREPARATION DECKS TYPE 1	SY	
509.0302	PREPARATION DECKS TYPE 2	SY	
509.2000	FULL-DEPTH DECK REPAIR	SY	
SPV.0035	CONCRETE MASONRY DECK PATCHING	CY	
SPV.0090	SAWING PAVEMENT DECK PREPARATION AREAS	LF	
509.3500.S	HMA OVERLAY POLYMER-MODIFIED	TON	
POSSIBLE ADDITIONAL BID ITEMS			
509.9005.S	REMOVING CONCRETE MASONRY DECK OVERLAY	SY	
509.9010.S	REMOVING ASPHALTIC CONCRETE DECK OVERLAY (STRUCTURE)	SY	

THIS IS A PARTIAL LIST OF POSSIBLE BID ITEMS. BID ITEMS MAY NEED TO BE ADDED OR REMOVED TO FIT EACH INDIVIDUAL CASE.

DESIGN DATA

LIVE LOAD:
INVENTORY RATING: HS-...
OPERATING RATING: HS-...
MAXIMUM STANDARD PERMIT VEHICLE LOAD = ... KIPS

MATERIAL PROPERTIES:
CONCRETE MASONRY - DECK PATCHING f'c = 4,000 P.S.I.

NOTES

DRAWINGS SHALL NOT BE SCALED.

DIMENSIONS SHOWN ARE BASED ON THE ORIGINAL STRUCTURE PLANS.

AREAS OF "PREPARATION DECKS TYPE 1" SHALL BE DEFINED BY A SAW CUT.


PREPARATION DECKS TYPE 1, PREPARATION DECKS TYPE 2, AND FULL-DEPTH DECK REPAIR AREAS ARE BASED ON THE PLANS AND AS DETERMINED BY THE ENGINEER. DECK PREPARATION AND FULL-DEPTH DECK REPAIRS SHALL BE FILLED WITH "CONCRETE MASONRY DECK PATCHING".

ANY EXCAVATION REQUIRED TO COMPLETE THE OVERLAY OR JOINT REPAIR AT THE ABUTMENTS TO BE CONSIDERED INCIDENTAL TO THE BID ITEM "HMA OVERLAY POLYMER-MODIFIED".

THE PLAN QUANTITY FOR THE BID ITEM "HMA OVERLAY POLYMER-MODIFIED" IS BASED ON THE AVERAGE OVERLAY THICKNESS.

PROFILE GRADE LINE SHALL BE DETERMINED IN THE FIELD BASED ON A MINIMUM OVERLAY THICKNESS OF 2" PLACED ABOVE THE DECK SURFACE. EXPECTED AVERAGE OVERLAY THICKNESS IS 2 1/2" (OR AS GIVEN ON THE PLANS). IF EXPECTED AVERAGE OVERLAY THICKNESS IS EXCEEDED BY MORE THAN 1/2", CONTACT THE STRUCTURES DESIGN SECTION.

POLYMER MODIFIED ASPHALTIC OVERLAY

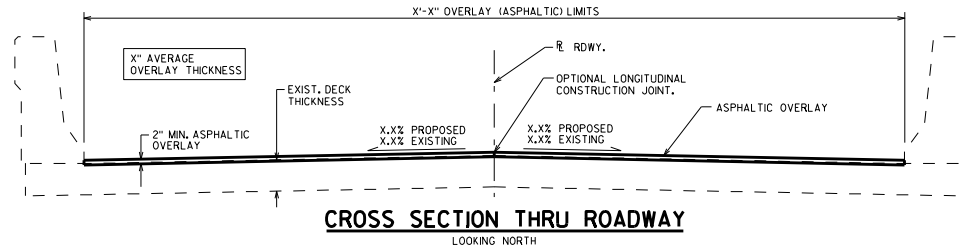

CROSS SECTION THRU ROADWAY

LOOKING NORTH

DESIGNER NOTES

CONCRETE OVERLAYS ARE THE CURRENT PREFERRED METHOD TO OVERLAY A BRIDGE.

REPAIRS USING CONCRETE REQUIRE A MINIMUM CURE TIME OF 7 DAYS BEFORE PLACING OVERLAY. ALTERNATIVES TO CONCRETE DECK PATCHES MAY BE USED TO SHORTEN TIME REQUIRED FOR PLACING OVERLAY.

PROVIDE AN AVERAGE OVERLAY THICKNESS ON THE PLANS. THIS AVERAGE OVERLAY THICKNESS VALUE IS BASED ON THE THEORETICAL AVERAGE OVERLAY THICKNESS PLUS 1/2" TO ACCOUNT FOR VARIATIONS IN THE DECK SURFACE. QUANTITIES ARE BASED ON THE AVERAGE OVERLAY THICKNESS.

DO NOT PROVIDE A PROFILE GRADE LINE ON THE PLANS.

OVERLAYS NOT REQUIRING SHEET MEMBRANE WATERPROOFING ARE PREFERRED.

COORDINATE ASPHALTIC DESIGN WITH REGION BRIDGE MAINTENANCE AND ROADWAY ENGINEERS.

THE PLAN QUANTITY FOR THE BID ITEM "HMA PAVEMENT TYPE E-X" IS BASED ON (INSERT VALUE) LBS/CF X (AVERAGE OVERLAY THICKNESS) X (OVERLAY AREA). ASSUME 112 LBS/(SY-IN) IF NO ADDITIONAL INFORMATION IS PROVIDED.

THE PLAN QUANTITY FOR THE BID ITEM "ASPHALTIC MATERIAL PGXX-XX" IS BASED ON (INSERT VALUE) % OF BID ITEM "HMA PAVEMENT TYPE E-X". ASSUME 6% IF NO ADDITIONAL INFORMATION IS PROVIDED.

THE PLAN QUANTITY FOR THE BID ITEM "TACK COAT" IS BASED ON AN APPLICATION RATE OF 0.05 TO 0.07 GALLONS/SY. ASSUME 0.07 GALLONS/SY IF PLACING OVER MILLED HMA OR CONCRETE.

RESTRICTIONS ON REMOVAL ITEMS SHALL BE PLACED ON THE PLANS TO PREVENT DAMAGE TO REINFORCING STEEL.

TOTAL ESTIMATED QUANTITIES

BID ITEM NUMBER	BID ITEMS	UNIT	TOTAL
455.0XXX	ASPHALTIC MATERIAL PGXX-XX	TON	
455.0605	TACK COAT	GAL	
460.1XXX	HMA PAVEMENT TYPE E-X	TON	
509.0301	PREPARATION DECKS TYPE 1	SY	
509.0302	PREPARATION DECKS TYPE 2	SY	
509.2000	FULL-DEPTH DECK REPAIR	SY	
SPV.0035	CONCRETE MASONRY DECK PATCHING	CY	
SPV.0090	SAWING PAVEMENT DECK PREPARATION AREAS	LF	
POSSIBLE ADDITIONAL BID ITEMS			
509.9005.S	REMOVING CONCRETE MASONRY DECK OVERLAY	SY	
509.9010.S	REMOVING ASPHALTIC CONCRETE DECK OVERLAY (STRUCTURE)	SY	

THIS IS A PARTIAL LIST OF POSSIBLE BID ITEMS. BID ITEMS MAY NEED TO BE ADDED OR REMOVED TO FIT EACH INDIVIDUAL CASE.

DESIGN DATA

LIVE LOAD:
INVENTORY RATING: HS-...
OPERATING RATING: HS-...
MAXIMUM STANDARD PERMIT VEHICLE LOAD = ... KIPS

MATERIAL PROPERTIES:
CONCRETE MASONRY - DECK PATCHING f'c = 4,000 P.S.I.

NOTES

DRAWINGS SHALL NOT BE SCALED.

DIMENSIONS SHOWN ARE BASED ON THE ORIGINAL STRUCTURE PLANS.

AREAS OF "PREPARATION DECKS TYPE 1" SHALL BE DEFINED BY A SAW CUT.

PREPARATION DECKS TYPE 1, PREPARATION DECKS TYPE 2, AND FULL-DEPTH DECK REPAIR AREAS ARE BASED ON THE PLANS AND AS DETERMINED BY THE ENGINEER. DECK PREPARATION AND FULL-DEPTH DECK REPAIRS SHALL BE FILLED WITH "CONCRETE MASONRY DECK PATCHING".

ANY EXCAVATION REQUIRED TO COMPLETE THE OVERLAY OR JOINT REPAIR AT THE ABUTMENTS TO BE CONSIDERED INCIDENTAL TO THE BID ITEM "HMA PAVEMENT TYPE E-X".

THE PLAN QUANTITY FOR THE BID ITEM "HMA PAVEMENT TYPE E-X" IS BASED ON THE AVERAGE OVERLAY THICKNESS.

PROFILE GRADE LINE SHALL BE DETERMINED IN THE FIELD BASED ON A MINIMUM OVERLAY THICKNESS OF 2" PLACED ABOVE THE DECK SURFACE. EXPECTED AVERAGE OVERLAY THICKNESS IS 2 1/2" (OR AS GIVEN ON THE PLANS). IF EXPECTED AVERAGE OVERLAY THICKNESS IS EXCEEDED BY MORE THAN 1/2", CONTACT THE STRUCTURES DESIGN SECTION.

ASPHALTIC OVERLAY

POLYMER MODIFIED ASPHALTIC AND ASPHALTIC OVERLAYS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION
STRUCTURES DEVELOPMENT SECTION

APPROVED: Bill Oliva

DATE:
7-16